



**237A  
DISINFECTANT, SANITIZER,  
DESTAINER AND DEODORIZER**

<b>ACTIVE INGREDIENT</b>	
SODIUM HYPOCHLORITE	12.50%w
<b>INERT INGREDIENTS</b>	87.50%w
TOTAL	100.00%w
AV. CHLORINE 14.25% (vol.)	

**WARNING**

**KEEP OUT OF REACH OF CHILDREN.**  
See first aid statement and other precautions on  
right side of panel.

EPA REG. NO.: 9594-7

NET GALS.

**WARNING**

Harmful if Swallowed. Strong Oxidant. May produce chemical burns.  
Do not get on skin or in eyes.

**FIRST AID:**

In case of skin and eye contact, flush with plenty of water. If skin  
irritation persists, get medical attention. For eyes, get prompt medical  
attention.

INTERNAL - Give milk, water, or egg whites. Call Physician Immediately.

DEGRADES WITH AGE. USE A TEST KIT AND INCREASE DOSAGE  
AS NECESSARY TO OBTAIN REQUIRED LEVEL OF AV. CHLORINE.

DO NOT MIX WITH ACIDIC TYPE CLEANING COMPOUNDS.


RINSE EMPTY CONTAINER THOROUGHLY WITH WATER AND  
DISCARD IT.

**INTERNATIONAL CHEMICAL CORPORATION**

MANUFACTURED IN CALIF.

ANNATI, O.  
HEIM, CALIF.

ES AND V... SES IN B... CITIES

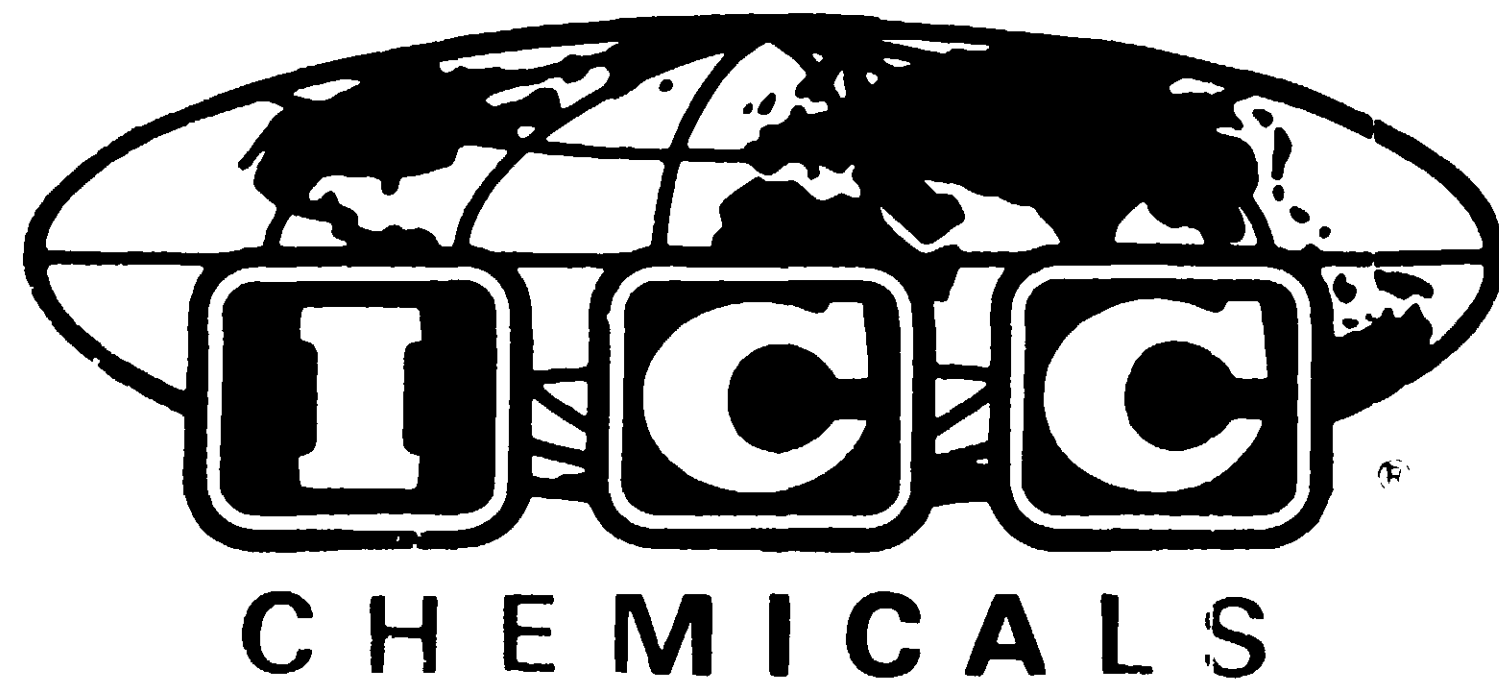

237A  
DISINFECTANT, SANITIZER,  
DYE STAINER AND DEODORIZER

DIRECTIONS:

NECESSARY QUANTITIES  
DISINFECTANT

WASHING

FOR WHITE DYES

**INTERCONTINENTAL CHEMICAL CORPORATION**

MANUFACTURING PLANT  
SACRAMENTO, CALIF.

CINCINNATI  
ANAHEIM, CALIF.

OFFICE

WAREHOUSE

PRINCIPAL



# ICC W-64

## DIRECTIONS

ICC W-64 is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and other deposits. An initial slug addition of 4.2 to 11.4 fluid ounces of ICC W-64 per 1000 gallons of water to provide a concentration of 33 to 82.5 parts per million of ICC W-64 based on the total weight of water in the system is recommended. Repeat initial dosage until control is evident. Subsequent slug additions of 1.14 to 11.4 fluid ounces of ICC W-64 per 1000 gallons of water (8.25 to 82.5 parts per million of ICC W-64) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

## FOR ALGAE CONTROL IN COOLING TOWERS

### ACTIVE INGREDIENT:

Poly [oxyethylene (dimethyliminio) ethylene  
 . . (dimethyliminio) ethylene dichloride] . . . . . 14.4%

INERT INGREDIENT . . . . . 85.6%  
 100.0%

## CAUTION

### KEEP OUT OF REACH OF CHILDREN

See additional cautions on right side panel

Net . . . . . Gallons

EPA REG. NO: 9594-8



UNDER THE FEDERAL INSECTICIDE AND RODENTICIDE ACT AND ECONOMIC POISON REGISTER. EPA REG. NO. 9594-8

## CAUTION

Harmful if swallowed. Do not get in eyes. Avoid contact with skin. In case of contact, flush with plenty of water for at least 15 minutes. If irritation persists, get medical attention. Avoid contamination of food.

Rinse empty container thoroughly with water and discard container.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply ICC W-64 only as specified on this label. Do not contaminate water by cleaning of equipment or disposal of waste.