

M-11-25-82

**STATEMENT OF PRACTICAL TREATMENT**

IF SWALLOWED - Call a physician or Poison Control Center immediately. Gastric lavage is indicated if material was taken internally. DO NOT INDUCE VOMITING; vomiting may cause aspiration pneumonia.  
IF INHALED - Remove victim to fresh air. Apply artificial respiration if indicated.  
IF ON SKIN - Remove contaminated clothing and wash affected areas with soap and water.  
IF IN EYES - Flush eyes with plenty of water. Get medical attention immediately.

**PRECAUTIONARY STATEMENTS**

**HAZARDS TO HUMANS & DOMESTIC ANIMALS**

**CAUTION**

Harmful if swallowed, inhaled or absorbed through the skin. Avoid contact with skin, eyes or clothing. Avoid breathing spray mist. Avoid contamination of feed or foodstuffs.

**ENVIRONMENTAL HAZARDS**

This product is toxic to fish and wildlife. Keep out of lakes, streams or ponds. Do not contaminate water by cleaning of equipment, or disposal of wastes. Apply this product only as specified on this label.

**PHYSICAL OR CHEMICAL HAZARDS**

Do not use, pour, spill or store near heat or open flame


**DIRECTIONS FOR USE**

It is a violation of Federal law to use this product in a manner inconsistent with its labeling.

**DISPOSAL**

Do not reuse empty container. Wrap container and put in trash collection

**"DO-IT-YOURSELF" CONCENTRATE  
FOR TERMITE CONTROL**

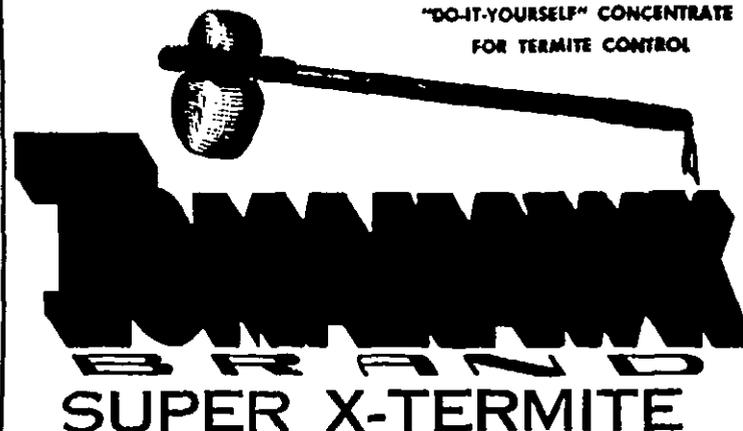

THIS PRODUCT CONTAINS 4 lbs. of TECHNICAL CHLORDANE per GAL.

| ACTIVE INGREDIENTS:    | % by WT. |
|------------------------|----------|
| TECHNICAL CHLORDANE    | 45.00%   |
| HEAVY AROMATIC NAPHTHA | 25.75%   |
| PETROLEUM DISTILLATES  | 25.75%   |
| INERT INGREDIENTS:     | 3.50%    |
| TOTAL                  | 100.00%  |

\*Equivalent to 27.00% Octachloro-4,7-methanetetrahydroindane and 18.80% of related compounds

**KEEP OUT OF REACH OF CHILDREN**

**CAUTION**


SEE STATEMENT OF PRACTICAL TREATMENT AND OTHER PRECAUTIONARY STATEMENTS ON SIDE PANEL

EPA Reg. No. 224-177 NET CONTENTS ONE-HALF GALLON EPA Est. 224-KY-1

DISTRIBUTED BY  
**BELKNAP, INC., LOUISVILLE, KENTUCKY 40202**

12000000

"DO-IT-YOURSELF" CONCENTRATE  
FOR TERMITE CONTROL

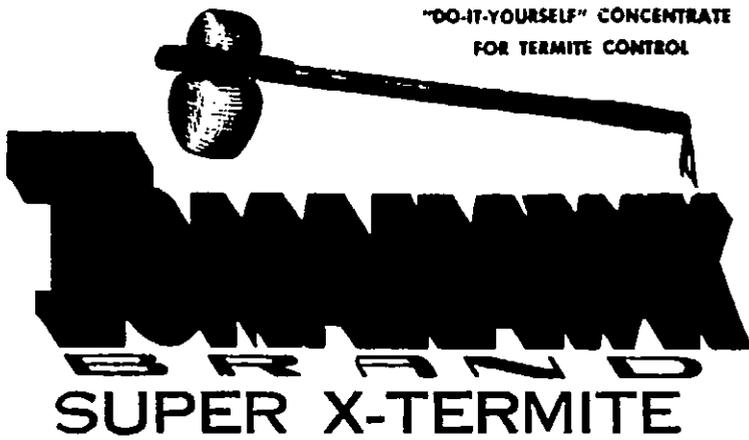

THIS PRODUCT CONTAINS 4 lbs. of TECHNICAL CHLORDANE per GAL.

| ACTIVE INGREDIENTS:    | % by Wt. |
|------------------------|----------|
| TECHNICAL CHLORDANE    | 45.00%   |
| HEAVY AROMATIC NAPHTHA | 25.75%   |
| PETROLEUM DISTILLATES  | 25.75%   |
| INERT INGREDIENTS:     | 3.50%    |
| TOTAL                  | 100.00%  |

\*Equivalent to 27.80% Octachloro-4,7-methanetetrahydroindane and 18.80% of related compounds

**KEEP OUT OF REACH OF CHILDREN  
CAUTION**

SEE STATEMENT OF PRACTICAL TREATMENT  
AND OTHER PRECAUTIONARY STATEMENTS ON SIDE PANEL

EPA Reg. No. 224-177 NET CONTENTS ONE-HALF GALLON EPA Est. 224-KY-1

DISTRIBUTED BY  
**BELKNAP, INC., LOUISVILLE, KENTUCKY 40202**

ACCEPTED

JAN 12 1983

U.S. Dept. of Agriculture  
Federal Insecticide,  
Fungicide, and Rodenticide Act,  
as amended, for the pesticide  
regulated under  
EPA Reg. No. 224-177

**SUBTERRANEAN TERMITES  
DIRECTIONS FOR HOMEOWNER USE  
MIXING DIRECTIONS**

Mix the contents of this container with 48 parts water or at the rate of 5 1/3 tablespoons of this concentrate per gallon of water. Stir thoroughly to get good mixture of concentrate and water. Apply this mixture as directed.

**TERMITE CONTROL IN EXISTING STRUCTURES  
Buildings with Basements or Crawl-Spaces**

First remove all wood debris and wood forms. Around pipes, pipes, chimney bases and along foundations of poured concrete dig a trench 6 inches wide and 4 inches deep. For brick and block foundations dig the trench about 12 inches deep. If footing is more than 12 inches deep, make holes with a crowbar, pipe or a rod, about one foot apart that extend from the trench bottom to the top of the footing. Make holes closer in hard packed clay soils. NEVER DIG BELOW THE TOP OF THE FOOTING. Apply the emulsion in the trench at a rate of 4 gallons per 10 linear feet per foot of depth. Apply half of this to the back fill. Likewise, treat along the inside of foundations of crawl-space buildings. Cover treated soil with a thin layer of untreated soil.

For raised porches, terraces, and entrance slabs, drill holes at one foot intervals, 6 inches from the foundation, and pour one half gallon of emulsion into each hole. Refill holes. Slabs with heat ducts or radiating heat pipes should be treated by commercial pest control operator.

The object is to establish a treated soil barrier which will prevent termite entry. Other critical areas may also require treatment, particularly if there are inaccessible areas, basements or slab-type construction. It is suggested that you contact the Agricultural Cooperative Extension Service for advice or consult a Commercial Pest Control Service.

Avoid contamination of public and private water supplies by following these precautions: Do not allow a hose or any type of faucet extension to reach into the termite chemical solution while filling or mixing this material with water. Use anti-back flow or anti-siphonage equipment on all filling equipment. These devices can be purchased at hardware or plumbing supply stores. Use of anti-back flow equipment will help to insure that the user of this toxic chemical will not contaminate domestic water supplies. Refer to Federal (Federal Housing Administration), state and local specifications for safe distances of treatment areas from wells. Soil in the vicinity of wells, cisterns or ponds should not be treated if its water saturated, subject to excessive saturation due to accumulation of water or if the soil to be treated around the perimeter of the structure is at a grade lower than surrounding yard property area. If this is the situation treat as follows: Do not Apply Under Pressure. Soil should be removed to a safe area from well or domestic water contamination, treated, allowed to stand undisturbed for two to four hours then returned to the trench which has been lined with 4 mil plastic sheeting. Be careful not to puncture the plastic sheeting when returning soil to the trench. Do not treat structures that contain cisterns or wells.

**WARRANTY STATEMENT**

Belknap Inc. MAKES NO WARRANTY OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE OR OTHERWISE EXPRESS OR IMPLIED concerning this product or its use, which extend beyond the statements on this label.