

CIMEN LABEL

# Antimicrobial 7287

Asseptura  
Slump in  
P. 2  
Best Available Image  
6/29/84

Controls bacteria, fungi, and yeasts in paper mills, metalworking fluids containing water, and enhanced oil recovery systems; controls bacteria, fungi, and algae in industrial recirculating water cooling towers and in once-through fresh and sea water industrial cooling water systems; controls slime-forming bacteria and fungi in air-washer systems.

### FOR INDUSTRIAL USE ONLY

Active Ingredients:  
2,2-Dibromo-3-nitropropionamide ..... 20%  
Inert Ingredients: ..... 80%  
E.P.A. Registration No. 464-426  
E.P.A. Est. 464 MI-1

**KEEP OUT OF REACH OF CHILDREN**

## DANGER

**PRECAUTIONARY STATEMENTS**  
Hazardous to Humans and Domestic Animals  
**CAUSES SEVERE BURNS OF EYES • EYE CONTACT MAY CAUSE LOSS OF VISION • MAY BURN THE SKIN • MAY BE HARMFUL OR FATAL IF SWALLOWED**

Do Not Get In Eyes, on Skin, or on Clothing  
Chemical Worker's Goggles Must Be Worn When Handling • Wash Thoroughly After Handling

**FIRST AID:** In case of eye contact, immediately flush eyes with plenty of water for at least 15 minutes. Call a physician. In case of skin contact, immediately wash skin with soap and plenty of water. Wash contaminated clothing before reuse. Get medical attention if irritation persists. If swallowed, immediately induce vomiting by giving two glasses of water and sticking finger down throat. Repeat until vomit is clear. Call a physician. Never give anything by mouth to an unconscious person.

**ENVIRONMENTAL HAZARDS**  
This product is toxic to fish. Apply this product only as specified on this label. Do not contaminate water by cleaning of equipment, or disposal of wastes. **NOTE:** Do not discharge into lakes, streams, ponds, or public waters unless in accordance with a NPDES permit. For guidance, contact your regional office of the EPA.

In case of an emergency endangering life or property involving this product, call collect 517-436-4400.

### STORAGE AND DISPOSAL

Do not contaminate water, food, or feed by storage or disposal.

**Storage:** To maintain product quality, store at temperatures below 50°C. Keep container tightly closed when not in use.

**Pesticide Disposal:** Pesticide wastes are acutely hazardous. Improper disposal of excess pesticide, spray mixture, or rinsate is a violation of Federal law. If these wastes cannot be disposed of by use according to label instructions, contact your State Pesticide or Environmental Control Agency, or the hazardous Waste representative at the nearest EPA Regional Office for guidance.

**Container Disposal:** Do not reuse empty container. Triple rinse (or equivalent). Then offer for recycling or reconditioning, or puncture and dispose of in a sanitary landfill, or by other procedures approved by state and local authorities.

### DIRECTIONS FOR USE

It is a violation of Federal Law to use this product in a manner inconsistent with the label.

**NOTE: ADD ANTIMICROBIAL 7287 SEPARATELY TO THE SYSTEM. DO NOT MIX WITH OTHER ADDITIVES, IN ORDER TO AVOID DECOMPOSITION OF ANTIMICROBIAL 7287 DUE TO THE HIGH PH OF MANY ADDITIVE FORMULATIONS.**

### PAPER MILLS

For the control of bacterial, fungal, and yeast growths in pulp, paper, and paperboard mills, add ANTIMICROBIAL 7287 at the rate of 0.15-0.35 lb ANTIMICROBIAL 7287 (on a dry basis) per ton of paper. Addition may be continuous or intermittent, depending upon the type of system and the severity of contamination. It should be made with a metering pump at a location that will insure uniform distribution of ANTIMICROBIAL 7287 in the mass of fiber and water, such as the beaters, Jordan meter or discharge, broke chests, furnish chests, save-alls, and white-water tanks.

Heavily fouled systems should be cleaned out, then treated with 0.15-0.35 lb ANTIMICROBIAL 7287 (on a dry basis), as necessary for control.

Moderately fouled systems should be treated continuously with 0.15-0.35 lb ANTIMICROBIAL 7287 (on a dry basis) until the slime accumulation is controlled. Addition rates can then be reduced to 0.15-0.25 lb ANTIMICROBIAL 7287 (on a dry basis) on a continuous or intermittent basis, as needed for

control. Disturbed slime may cause breaks in the paper and a clean-up of the paper machine may be advisable.

Slightly fouled systems should be treated continuously with 0.15-0.35 lb ANTIMICROBIAL 7287 (on a dry basis) until the slime is controlled, then added on an intermittent basis to maintain control.

### METALWORKING FLUIDS CONTAINING WATER

This product is effective in metalworking fluid concentrates which have been diluted in water at ratios of 1:100-1:4.

For controlling (or inhibiting) the growth of bacteria, fungi, and yeasts that may deteriorate metalworking fluids containing water, add ANTIMICROBIAL 7287 to the fluid in the collection tank. Additions should be made with a metering pump.

**Initial or Slug Dose:** When the system is just noticed by fouling, add 0.25 gal ANTIMICROBIAL 7287 (1,000 gal of metalworking fluid to the system). Repeat until control is achieved.

**Subsequent Dose:** When microbial control is evident, add 0.1-0.2 gal ANTIMICROBIAL 7287 (1,000 gal of metalworking fluid per day, or as needed to maintain control). Additions can be made continuously or intermittently. Slug the system as required.

### ENHANCED OIL RECOVERY SYSTEMS

For controlling slime-forming bacteria, sulfide-producing bacteria, yeasts, and fungi in oil field water, polymer or micellar floods, water-disposal systems, or other oil field water systems, add 1-80 ppm ANTIMICROBIAL 7287 (0.8-6.4 gal ANTIMICROBIAL 7287 per 2400 barrels of water) depending on the severity of contamination. Additions should be made with a metering pump either continuously or intermittently.

### Continuous Feed Method

When the system is noticeably fouled, add 10-80 ppm ANTIMICROBIAL 7287 (0.8-6.4 gal ANTIMICROBIAL 7287 per 2400 barrels of water) continuously until the desired degree of control is achieved. Subsequently, treat with 1-5 ppm ANTIMICROBIAL 7287 (0.1-1.2 gal ANTIMICROBIAL 7287 per 2400 barrels of water) continuously or as needed to maintain control.

### Intermittent or Slug Method

When the system is noticeably fouled, or to maintain control of the system, add 10-80 ppm ANTIMICROBIAL 7287 (0.8-6.4 gal ANTIMICROBIAL 7287 per 2400 barrels of water) intermittently for 4-8 hours per day, and from 1-4 times per week, or as needed depending on the severity of contamination.

Addition of ANTIMICROBIAL 7287 may be made at free water knockouts, before or after the inject pumps and injection well headers.

**NOTE:** For control of bacteria, yeast, and fungi aqueous solutions of biopolymer used in flood operations, add 15-80 ppm ANTIMICROBIAL 7287 (12-6.4 gal ANTIMICROBIAL 7287 per 2400 barrels water). Additions of ANTIMICROBIAL 7287 should be made with a metering pump immediately after production of the aqueous biopolymer solution to prevent loss of viscosity.

### INDUSTRIAL RECIRCULATING WATER COOLING TOWERS

Add ANTIMICROBIAL 7287 to the basin (or any other point of uniform mixing). Addition should be made with a metering pump. It may be continuous, intermittent, or dependent on the severity of the contamination when treatment is begun and the retention time in the system.

Optimum performance with this product is attained by continuous or intermittent treatment. If shock treatment is used, the blowdown should be discontinued for 24-48 hours.

### FOR CONTROL OF BACTERIA

Add 0.00095-0.0095 gal ANTIMICROBIAL 7287 (1,000 gal of water in the system, depending on the severity of contamination).

### Intermittent or Slug Method

Initial Dose: When the system is noticeably fouled, add 0.0048-0.0095 gal ANTIMICROBIAL 7287 (1,000 gal of water in the system). Repeat until control is achieved.

Subsequent Dose: When microbial control is evident, add 0.0024-0.0095 gal ANTIMICROBIAL 7287 (1,000 gal of water in the system every 4 days, or as needed) to maintain control.

Badly fouled systems must be cleaned before treatment is begun.

### Continuous Feed Method

Initial Dose: When the system is noticeably fouled, add 0.0048-0.0095 gal ANTIMICROBIAL 7287 (1,000 gal of water to the system).

Subsequent Dose: Maintain this level by pumping a continuous feed of 0.00095-0.0048 gal ANTIMICROBIAL 7287 (1,000 gal of water in the system) per day.

Badly fouled systems must be cleaned before treatment is begun.

182

**ACCEPTED**  
464-426  
JUN 29 1984

Under the Federal Insecticide, Fungicide, and Rodenticide Act, this substance has been found to be a pesticide and is hereby registered under EPA Reg. No.

**FOR CONTROL OF FUNGI AND ALGAE**

Add 0.029-0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system depending on the severity of contamination.

**Intermittent or Slug Method**

**Initial Dose:** When the system is noticeably fouled, add 0.048-0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system. Repeat until control is achieved.

**Subsequent Dose:** When microbial control is evident, add 0.029-0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system daily or as needed to maintain control.

**Badly fouled systems** must be cleaned before treatment is begun.

**Continuous Feed Method**

**Initial Dose:** When the system is noticeably fouled, add 0.048-0.095 gal ANTIMICROBIAL 7287/1,000 gal of water to the system.

**Subsequent Dose:** Maintain this treatment level by pumping a continuous feed of 0.029-0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system per day.

**Badly fouled systems** must be cleaned before treatment is begun.

**ONCE-THROUGH INDUSTRIAL COOLING WATER SYSTEMS**

For controlling bacteria, fungi, and algae in once-through and closed-cycle fresh and sea water cooling systems, cooling ponds, canals, and lagoons, add ANTIMICROBIAL 7287 to the system inlet water or before any other contaminated area in the system. Addition should be made with a metering pump; it may be continuous or intermittent depending on the severity of the contamination when treatment is begun, and the retention time in the system.

**FOR CONTROL OF BACTERIA**

Add 1-12 ppm ANTIMICROBIAL 7287 based on the flow rate through the system, depending on the severity of contamination.

**Intermittent Method**

**Initial Dose:** When the system is noticeably fouled, add 6-12 ppm ANTIMICROBIAL 7287. Minimum treatment intervals should be 15 minutes. Repeat until control is achieved.

**Subsequent Dose:** When microbial control is evident, add 3-12 ppm ANTIMICROBIAL 7287 intermittently as needed to maintain control.

**Badly fouled systems** must be cleaned before treatment is begun.

**Continuous Feed Method**

**Initial Dose:** When the system is noticeably fouled, add 6-12 ppm ANTIMICROBIAL 7287 continuously to the system.

**Subsequent Dose:** When microbial control is evident, pump a continuous feed of 1-6 ppm ANTIMICROBIAL 7287 to the system.

**Badly fouled systems** must be cleaned before treatment is begun.

**FOR CONTROL OF FUNGI AND ALGAE**

Add 36-118 ppm ANTIMICROBIAL 7287 based on the flow rate through the system, depending on the severity of contamination.

**Intermittent Method**

**Initial Dose:** When the system is noticeably fouled, add 60-118 ppm ANTIMICROBIAL 7287 to the system. The minimum treatment interval should be 15 minutes. Repeat until control is achieved.

**Subsequent Dose:** When microbial control is evident, add 36-118 ppm ANTIMICROBIAL 7287 to the system daily or as needed to maintain control. The minimum treatment interval should be 15 minutes.

**Badly fouled systems** must be cleaned before treatment is begun.

**Continuous Feed Method**

**Initial Dose:** When the system is noticeably fouled, add 60-118 ppm ANTIMICROBIAL 7287 to the system.

**Subsequent Dose:** When microbial control is evident, pump a continuous feed of 36-118 ppm ANTIMICROBIAL 7287 to the system.

**Badly fouled systems** must be cleaned before treatment is begun.

**AIR-WASHER SYSTEMS**

Add 0.0015 - 0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system, depending upon the severity of contamination to control slime-forming bacteria and fungi in industrial air-washer systems.

**Intermittent or Slug Method**

**Initial Dose:** When the system is noticeably fouled, add 0.003-0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system. Repeat until control is achieved.

**Subsequent Dose:** When microbial control is evident, add 0.0015 - 0.047 gal ANTIMICROBIAL 7287/1,000 gal of water in the system every 2 days or as needed to maintain control.

**Badly fouled systems** must be cleaned before treatment is begun.

**Continuous Feed Method**

**Initial Dose:** When the system is noticeably fouled, add 0.003 - 0.095 gal ANTIMICROBIAL 7287/1,000 gal of water in the system.

**Subsequent Dose:** Maintain this level by pumping a continuous feed of 0.0015 - 0.047 gal ANTIMICROBIAL 7287/1,000 gal of water in the system per day.

**Badly fouled systems** must be cleaned before treatment is begun.


**Note:** For use only in industrial air-washer systems that maintain effective mist eliminating components.

**Notice:** Seller warrants that the product conforms to its chemical description and is reasonably fit for the purposes stated on the label when used in accordance with directions under normal conditions of use, but neither this warranty nor any other warranty of MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, express or implied, extends to the use of this product contrary to label instructions, or under abnormal conditions, or under conditions not reasonably foreseeable to seller, and buyer assumes the risk of any such use.



**NOTICE**

Do Not Ship or Store with Food, Feeds, Drugs, or Clothing

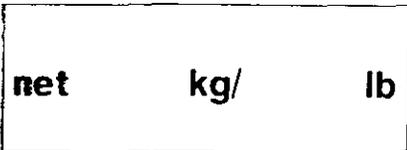

\* Trademark of THE DOW CHEMICAL COMPANY

08463-L1

F284



**THE DOW CHEMICAL COMPANY**  
Midland, Michigan 48640 U.S.A.

**107MM**