

18 MAR 1994

Donna L. Butler
PPG Industries, Inc.
One PPG Place - 36 W
Pittsburgh, PA 15272

Subject: PPG Calcium Hypochlorite Tablets
EPA Registration No. 748-295
Your Amendment Dated October 22, 1993

Dear Ms. Butler:

This is in response to your addition of the supplemental booklet to the product labeling.

The amendment referred to above, submitted in connection with registration under the Federal Insecticide, Fungicide, and Rodenticide Act, as amended, is acceptable subject to the comments listed below. A stamped copy of the labeling is enclosed for your records.

1. In the supplemental booklet, under "Agricultural Uses," in the "Poultry Plants" section (page 6 in the draft), in the instructions for treating poultry dressing areas, move the "10 minutes" contact-time instruction from the pre-cleaning sentence to the next sentence. (I.e., the 10-minute contact time applies to disinfection, not to pre-cleaning.)

2. Submit five (5) copies of your final printed labeling before you release the product for shipment bearing the amended labeling.

If you have any questions about these comments, please call Wallace Powell at 703-305-6938.

Sincerely,



Ruth G. Douglas
Product Manager 32
Antimicrobial Program Branch
Registration Division (7505C)

Enclosure

CONCURRENCES

SYMBOL							
SURNAME							
DATE							

PPG CALCIUM HYPOCHLORITE TABLETS

EPA Reg. No. 748- EOL
EPA Est. No. 2312-PA-1

**KEEP OUT OF REACH OF CHILDREN
DANGER**

ACTIVE INGREDIENT: Calcium Hypochlorite... 65%
INERT INGREDIENTS: 35%
65% Available Chlorine

**ACCEPTED
With COMMENTS
In EPA Letter Dated:
18 MAR 1994**
Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

Manufactured by
PPG INDUSTRIES, INC.
One PPG Place
Pittsburgh, PA 15272
NET WT. 100 lbs.
Emergency Telephone Number: Natrium, WV (304) 843-1300

PRECAUTIONARY STATEMENTS -

HAZARDS TO HUMANS AND DOMESTIC ANIMALS -

DANGER! * Highly Corrosive * Causes Skin and Eye Damage * May be Fatal if Swallowed * Irritating to Nose and Throat * Wear goggles or face shield and rubber gloves when handling. Avoid breathing dust. Remove and wash contaminated clothing and shoes before reuse.

PRACTICAL TREATMENT (First Aid): **EYE/SKIN CONTACT:** Flush with plenty of water for at least 15 minutes, while removing contaminated clothing and shoes. For eye contact, get immediate medical attention. If skin irritation occurs, get medical attention. **INHALATION:** Remove to fresh air. If signs of irritation or discomfort occur, take immediately to a hospital or physician. **SWALLOWING:** If swallowed, drink large quantities of water. Do not induce vomiting. Take immediately to a hospital or physician. If vomiting occurs, administer additional water. If unconscious, or in convulsions, take immediately to a hospital. Do not attempt to induce vomiting or give anything by mouth to an unconscious person.

ENVIRONMENTAL HAZARDS: This pesticide is toxic to fish and aquatic organisms. Do not discharge effluent containing this product into lakes, streams, ponds, estuaries, oceans or public waters unless this product is specifically identified and addressed in an NPDES permit. Do not discharge effluent containing this product to sewer systems without previously notifying the sewage treatment plant authority. For guidance contact your State Water Board or Regional Office of the EPA.

BEST AVAILABLE COPY

PHYSICAL AND CHEMICAL HAZARDS: Strong oxidizing agent! Mix only with water. Use only a clean, dry utensil made of metal or plastic each time product is taken from the container. **Do not add this product to any dispensing device containing remnants of any other product. Such use may cause violent reaction leading to fire or explosion.** Contamination with moisture, acids, organic matter, other chemicals or easily combustible materials such as petroleum or paint products may start a chemical reaction with generation of heat, liberation of hazardous gases and possible generation of a fire or explosion. In case of contamination or decomposition, do not reseal container. If possible isolate container in open air or well-ventilated area. Flood with large volumes of water, if necessary.

STORAGE AND DISPOSAL: Read before using. Keep in original container in a cool, dry, well-ventilated place. Keep container closed when not in use. Keep away from heat sources, sparks, open flames and lighted tobacco products. Use only a clean, dry utensil made of metal or plastic each time product is taken from the container. **Container Disposal** - Do not reuse container. Residual material remaining in empty container can react to cause fire. Thoroughly flush empty container with water then destroy by placing in trash collection. **Pesticide Disposal** - Wastes resulting from the use of this product may be disposed of on site or at an approved waste disposal facility. Do not contaminate water, food, or feed by storage or disposal. **In Case of Fire** - Drench with water. Calcium hypochlorite supplies oxygen; therefore, attempts to smother fire with a wet blanket, carbon dioxide, or a dry chemical extinguisher are ineffective. **In Case of Spill or Leak** - Use extreme caution. Contamination may cause fire or violent reaction. If fire or reaction occurs in area of spill, douse with plenty of water. Otherwise sweep up spilled material, using a clean, dry shovel and broom and dissolve spilled material in water. Then immediately use solution as directed.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended for the pesticide
registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

DIRECTIONS FOR USE: It is a violation of Federal law to use this product in a manner inconsistent with its labeling.

DISINFECTION OF DRINKING WATER (Potable Water):

PUBLIC SYSTEMS - Mix a ratio of 1 ounce of this product to 6000 gallons of water. Begin feeding this solution with a hypochlorinator until a free available chlorine residual of at least 0.2 ppm and no more than 0.6 ppm is attained throughout the distribution system. Check water frequently with a chlorine test kit. Bacteriological sampling must be conducted at a frequency no less than that prescribed by the National Interim Primary Drinking Water Regulations. Contact your local Health Department for further details.

INDIVIDUAL SYSTEMS - Dug Wells - Upon completion of the casing (lining) wash the interior of the casing (lining) with a 100 ppm available chlorine solution using a stiff brush. This solution can be made by thoroughly mixing 1 ounce of this product into 40 gallons of water. After covering the well, pour the sanitizing solution into the well through both the pipe sleeve opening and the pipeline. Wash the exterior of the pump cylinder also with the sanitizing solution. Start pump and pump water until strong odor of chlorine in water is noted. Stop pump and wait at least 24 hours. After 24 hours flush well until all traces of chlorine have been removed from the water. Contact your local Health Department for further details.

INDIVIDUAL WATER SYSTEMS - Drilled, Driven & Bored Wells - Run pump until water is a free from turbidity as possible. Pour a 100 ppm available chlorine sanitizing solution into the well. This solution can be made by thoroughly mixing 1 ounce of this product into 40 gallons of water. Add 5 to 10 gallons of clean, chlorinated water to the well in order to force the sanitizer into the rock formation. Wash the exterior of pump cylinder with the sanitizer. Drop pipeline into well, start pump and pump water until strong odor of chlorine in water is noted. Stop pump and wait at least 24 hours. After 24 hours flush well until all traces of chlorine have been removed from the water. Deep wells with high water levels may necessitate the use of special methods for introduction of the sanitizer into the well. Consult your local Health Department for further details.

INDIVIDUAL WATER SYSTEMS - Flowing Artesian Wells - Artesian wells generally do not require disinfection. If analyses indicate persistent contamination, the well should be disinfected. Consult your local Health Department for further details.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

9 8 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

EMERGENCY DISINFECTION - When boiling of water for 1 minute is not practical, water can be made potable by using this product. Prior to addition of the sanitizer, remove all suspended material by filtration or by allowing it to settle to the bottom. Decant the clarified, contaminated water to a clean container and add 1 grain of this product to 1 gallon of water. One grain is approximately the size of the letter "O" in this sentence. Allow the treated water to stand for 30 minutes. Properly treated water should have a slight chlorine odor, if not, repeat dosage and allow the water to stand an additional 15 minutes. The treated water can then be made palatable by pouring it between clean containers for several times.

SANITIZATION OF NONPOROUS FOOD CONTACT SURFACES

RINSE METHOD - A solution of 100 ppm available chlorine may be used in the sanitizing solution if a chlorine test kit is available. Solutions containing an initial concentration of 100 ppm available chlorine must be tested and adjusted periodically to insure that the available chlorine does not drop below 50 ppm. Prepare a 100 ppm sanitizing solution by thoroughly mixing 1 ounce of this product with 40 gallons of water. If no test kit is available, prepare a sanitizing solution by thoroughly mixing 1 ounce of this product with 20 gallons of water to provide approximately 200 ppm available chlorine by weight. Clean equipment surfaces in the normal manner. Prior to use, rinse all surfaces thoroughly with the sanitizing solution, maintaining contact with the sanitizer for at least 2 minutes. If solution contains less than 50 ppm available chlorine, as determined by a suitable test kit, either discard the solution or add sufficient product to reestablish a 200 ppm residual. Do not rinse equipment with water after treatment and do not soak equipment overnight. Sanitizers used in automated systems may be used for general cleaning but may not be reused for sanitizing purposes.

IMMERSION METHOD - A solution of 100 ppm available chlorine may be used in the sanitizing solution if a chlorine test kit is available. Solutions containing an initial concentration of 100 ppm available chlorine must be tested and adjusted periodically to insure that the available chlorine does not drop below 50 ppm. Prepare a 100 ppm sanitizing solution by thoroughly mixing 1 ounce of this product with 40 gallons of water. If no test kit is available, prepare a sanitizing solution by thoroughly mixing 1 ounce of this product with 20 gallons of water to provide approximately 200 ppm available chlorine by weight. Clean equipment in the normal manner. Prior to use, immerse equipment in the sanitizing solution for at least 2 minutes and allow the sanitizer to drain. If solution contains less than 50 ppm available chlorine, as determined by a suitable test kit, either discard the solution or add sufficient product to reestablish a 200 ppm residual. do not rinse equipment with water after treatment. Sanitizers used in automated systems may be used for general cleaning but may not be reused for sanitizing purposes.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

FLOW/PRESSURE METHOD - Disassemble equipment and thoroughly clean after use. Assemble equipment in operating position prior to use. Prepare a volume of a 200 ppm available chlorine sanitizing solution equal to 110% of volume capacity of the equipment by mixing the product in a ratio of 1 ounce product with 20 gallons of water. Pump solution through the system until full flow is obtained at all extremities, the system is completely filled with the sanitizer and all air is removed from the system. Close drain valves and hold under pressure for at least 2 minutes to insure contact with all internal surfaces. Remove some cleaning solution from drain valve and test with a chlorine test kit. Repeat entire cleaning/sanitizing process if effluent contains less than 50 ppm available chlorine. ~~Rinse system with potable water prior to use.~~

CLEAN-IN-PLACE METHOD - Thoroughly clean equipment after use. Prepare a volume of 200 ppm available chlorine sanitizing solution equal to 110% of volume with 20 gallons of water. Pump solution through the system until full flow is obtained at all extremities, the system is completely filled with the sanitizer and all air is removed from the system. Close drain valves and hold under pressure for at least 10 minutes to insure contact with all internal surfaces. Remove some cleaning solution from drain valve and test with a chlorine test kit. Repeat entire cleaning/sanitizing process if effluent contains less than 50 ppm available chlorine. ~~Rinse system with potable water prior to use.~~

capacity of the equipment by mixing the product in a ratio of 1 ounce product

SPRAY/FOG METHOD - Preclean all surfaces after use. Use a 200 ppm available chlorine solution to control bacteria, mold or fungi and a 600 ppm solution to control bacteriophage. Prepare a 200 ppm sanitizing solution of sufficient size by thoroughly mixing the product in a ratio of 1 ounce product with 20 gallons of water. Prepare a 600 ppm solution by thoroughly mixing the product in a ratio of 3 ounces product with 20 gallons of water. Use spray or fogging equipment which can resist hypochlorite solutions. Always empty and rinse spray/fog equipment with potable water after use. Thoroughly spray or fog all surfaces until wet, allowing excess sanitizer to drain. Vacate area for at least 2 hours. Prior to using equipment, rinse all surfaces treated with a 600 ppm solution with a 200 ppm solution.

SANITIZATION OF POROUS FOOD CONTACT SURFACES

BEST AVAILABLE COPY

- RINSE METHOD** - Prepare a ^{600 ppm} sanitizing solution by thoroughly mixing 3 ounces of this product with 20 gallons of water, to provide approximately 600 ppm available chlorine by weight. Clean surfaces in the normal manner. Prior to use, rinse all surfaces thoroughly with the ^{600 ppm} sanitizing solution, maintaining contact with the sanitizer for at least 2 minutes. ~~Rinse equipment with water after treatment and do not soak equipment overnight.~~

Prepare a 200 ppm sanitizing solution by thoroughly mixing 1 ounce of this product with 20 gallons of water. Prior to using equipment, rinse all surfaces with a 200 ppm available chlorine solution. Do not rinse

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the Pesticide registered under EPA Reg. No. 748-245

Prepare a 200 ppm sanitizing solution by thoroughly mixing 2 ounces of this product with 10 gallons of water. Prior to using,

7 of 48

IMMERSION METHOD - Prepare a ^{600 ppm} sanitizing solution by thoroughly mixing, in an immersion tank, 3 ounces of this product with 20 gallons of water, to provide approximately ~~600 ppm available chlorine by weight~~. Clean equipment in the normal manner. ~~Prior to use~~, immerse equipment in the ^{600 ppm} sanitizing solution for at least 2 minutes and allow the sanitizer to drain. ~~Rinse equipment with water after treatment.~~ Do not rinse and do not soak equipment overnight.

SPRAY/FOG METHOD - Preclean all surfaces after use. Prepare a 600 ppm available chlorine sanitizing solution of sufficient size by thoroughly mixing the product in a ratio of 3 ounces product with 20 gallons of water. Use spray or fogging equipment which can resist hypochlorite solutions. Always empty and rinse spray/fog equipment with potable water after use. Thoroughly spray or fog all surfaces until wet, allowing excess sanitizer to drain. Vacate area for at least 2 hours. Prior to using equipment, rinse all surfaces with a 200 ppm available chlorine solution. Prepare a 200 ppm sanitizing solution by thoroughly mixing 1 ounce of this product with 20 gallons of water.

SANITIZATION OF NONPOROUS NON-FOOD CONTACT SURFACES

RINSE METHOD - Prepare a sanitizing solution by thoroughly mixing 1 ounce of this product with 20 gallons of water to provide approximately 200 ppm available chlorine by weight. Clean equipment surfaces in the normal manner. Prior to use, rinse all surfaces thoroughly with the sanitizing solution, maintaining contact with the sanitizer for at least 2 minutes. Do not rinse equipment with water after treatment and do not soak equipment overnight.

IMMERSION METHOD - Prepare a sanitizing solution by thoroughly mixing, in an immersion tank, 1 ounce of this product with 20 gallons of water to provide approximately 200 ppm available chlorine by weight. Clean equipment in the normal manner. Prior to use, immerse equipment in the sanitizing solution for at least 2 minutes and allow the sanitizer to drain. Do not rinse equipment with water after treatment.

SPRAY/FOG METHOD - Preclean all surfaces after use. Prepare a 200 ppm available chlorine sanitizing solution of sufficient size by thoroughly mixing the product in a ratio of 1 ounce product with 20 gallons of water. Use spray or fogging equipment which can resist hypochlorite solutions. Prior to using equipment, thoroughly spray or fog all surfaces until wet, allowing excess sanitizer to drain. Vacate area for at least 2 hours.

ACCEPTED
with COMMENTS
in EPA Letter Docket

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

80448

DISINFECTION OF NONPOROUS NON-FOOD CONTACT SURFACES

RINSE METHOD - Prepare a disinfecting solution by thoroughly mixing 3 ounces of this product with 20 gallons of water to provide approximately 600 ppm available chlorine by weight. Clean equipment surfaces in the normal manner. Prior to use, rinse all surfaces thoroughly with the disinfecting solution, maintaining contact with the solution for at least 10 minutes. Do not rinse equipment with water after treatment and do not soak equipment overnight.

IMMERSION METHOD - Prepare a disinfecting solution by thoroughly mixing, in an immersion tank, 3 ounces of this product with 20 gallons of water to provide approximately 600 ppm available chlorine by weight. Clean equipment in the normal manner. Prior to use, immerse equipment in the disinfecting solution for at least 10 minutes and allow the solution to drain. Do not rinse equipment with water after treatment.

SANITIZATION OF POROUS NON-FOOD CONTACT SURFACES

RINSE METHOD - Prepare a sanitizing solution by thoroughly mixing 3 ounces of this product with 20 gallons of water to provide approximately 600 ppm available chlorine by weight. Clean equipment surfaces in the normal manner. Prior to use, rinse all surfaces thoroughly with the sanitizing solution, maintaining contact with the sanitizer for at least 2 minutes. Do not rinse equipment with water after treatment and do not soak equipment overnight.

IMMERSION METHOD - Prepare a sanitizing solution by thoroughly mixing, in an immersion tank, 3 ounces of this product with 20 gallons of water to provide approximately 600 ppm available chlorine by weight. Clean equipment in the normal manner. Prior to use, immerse equipment in the sanitizing solution for at least 2 minutes and allow the sanitizer to drain. Do not rinse equipment with water after treatment.

SPRAY/FOG METHOD - After cleaning, sanitize non-food contact surfaces with 600 ppm available chlorine by thoroughly mixing the product in a ratio of 3 ounces of this product with 20 gallons of water. Use spray or fogging equipment which can resist hypochlorite solutions. Always empty and rinse spray/fog equipment with potable water after use. Prior to using equipment, thoroughly spray or fog all surfaces until wet, allowing excess sanitizer to drain. Vacate area for at least 2 hours.

OTHER CALCIUM HYPOCHLORITE USES: Calcium Hypochlorite is also used in the sanitization of water systems, municipal water mains, sewage and industrial waste treatment, pulp bleaching, sanitization in the food industry, restaurants, dairies, and hospitals, odor and taste control in potable water systems, algae control in industrial cooling water systems, and general industrial sanitization. For specific literature on these and other accepted uses, write to PPG INDUSTRIES, INC., One PPG Place, Pittsburgh, PA 15272.

FOR THE FEDERAL BUREAU OF INVESTIGATION
18 MAR 1994
748-295

BEST AVAILABLE COPY

Dept.	Phone #
Fax #	Fax #

9048

USE INSTRUCTIONS FOR PPG 3" CAL-HYPO TABLETS

1. Install the PPG chlorinator per the instruction manual.
2. Load tablets into the PPG chlorinator.
3. Determine the water flow rate of your system in gpm.
4. Determine the chlorine demand of your system.
 - a. When you know the ppm chlorine demand required calculate the lbs/hr chlorine delivery by the following:

$$\text{water flow (gpm)} \times \text{ppm Chlorine Demand} \times 0.0005 = \text{lbs/hr chlorine}$$

- b. If you are currently using chlorine gas, calculate usage on a lbs/hr basis.
- c. If you are currently using sodium hypochlorite, calculate the usage as (at 10% strength):



$$\text{gallons/hr} = \text{lbs/hr chlorine}$$

5. From the chart below, determine the flow rate of water necessary through the chlorinator. Multiple chlorinators may be used for higher delivery rates.
6. Determine that there is a chlorine residual (i.e., 0.5 ppm for drinking water) in the water stream that meets requirements.
7. Operate the chlorinator per the instruction manual.

18 MAR 1997
 Under the Federal Food, Drug, and Cosmetic Act as amended, for the Pesticide registered under EPA Reg. No. 748-295

PPG 3-inch Calcium Hypochlorite Tablet Delivery

Graphs below are representative of average tested delivery values. Multiply the lbs/hr chlorine delivered by 1.5 to determine the lbs/hr of tablets used.

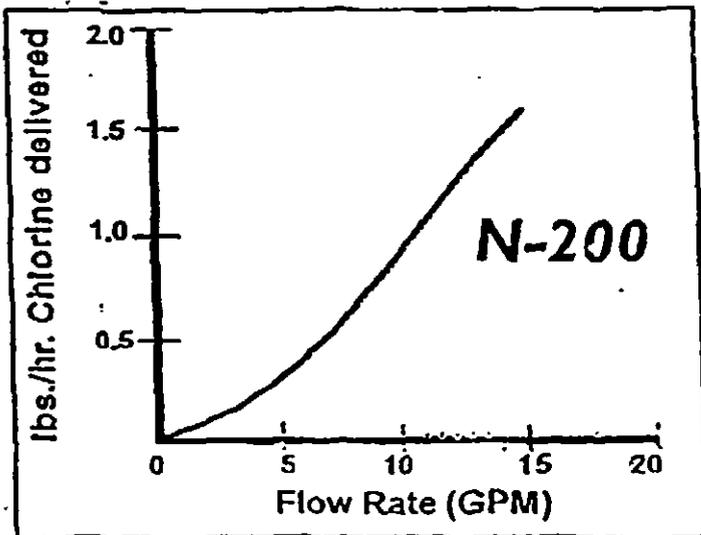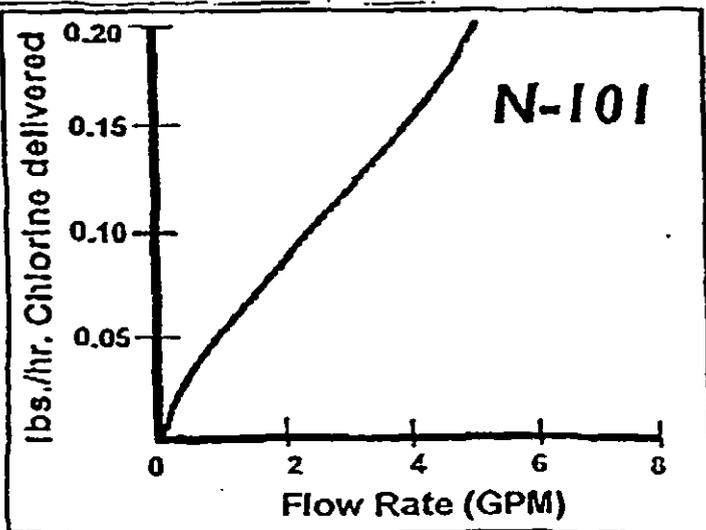

BEST AVAILABLE COPY

10048

PPG Chlorinating Systems

Industrial Applications

REGISTERED
with COMMENTS
in EPA Letter Docket
17 8 MAR 1994
Under the Federal Insecticide
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295



PPG Chlorinator
N-101



PPG 3-inch WHITE
Calcium Hypochlorite
Tablets



PPG Chlorinator
N-200

BEST AVAILABLE COPY

110448

PPG Chlorinating Systems Industrial Applications



Calcium Hypochlorite Product and Application Bulletin

The PPG Chlorinating System consists of the patented PPG Chlorinators and PPG 3-inch Calcium Hypochlorite tablets. The PPG Chlorinating System is the new workhorse in automatic chlorination. This bulletin will introduce a wide range of system applications and installations to suit most sanitizing needs.

PPG Industries is committed to producing quality products which fully meet the needs of our customers. If your application is not listed here, please contact our technical service staff to determine how we can serve you.

Applications

Water Treatment:

- Cooling Water
- Drinking Water
- Potable Water
- Well Water Systems
- Waste Water
- Cooling Tower systems

Food Processing Plants:

- Canneries
- Poultry Processing Plants
- Meat Processing Plants
- Harvested Fruits & Vegetables
- Dairy Industries

Beverage Plants:

- Breweries/Wineries
- Carbonated Beverage Plants
- Cider & Fruit Juice Plants

Approved Uses

The PPG Chlorinating System consists of the PPG Chlorinators used in conjunction with PPG 3-inch **WHITE** Calcium Hypochlorite Tablets

Recommended uses are for water treatment, industrial and food processing applications

- **USDA approved Uses:**
G-4, G-5, G-7, D-2 & Q-4.
- **Kosher approved**
- **Meets AWWA standards**
- **EPA Reg. # 748-138**
- **NSF Standard 60 (pending)**

Approved for use with **COOLERS** in EPA Letter Docket
18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No. 748-295

For more information about PPG Chlorinating Systems, call (800) 421-2025



BEST AVAILABLE COPY

Advantages of PPG Chlorinating Systems

The PPG chlorinating system is designed to provide accurate, consistent and controlled delivery of calcium hypochlorite (65% Available Chlorine) for a wide range of sanitization and water treatment applications. PPG chlorinators do not require electrical power, nor do they have any moving parts or small orifices. As a result of this patented design, the PPG delivery system is reliable to operate and requires very low maintenance.

Safety:

- No dangerous Chlorine gas releases
- No dangerous and corrosive liquid handling or potential for spills
- No odor during operation (Only minimal odor during filling procedure)

Maintenance:

- No chlorine gas corrosion
- No liquid bleach corrosion
- No leaching of metals from pumps, filters, etc. due to low pH
- No costly replacements of metering pumps or gas regulators
- No moving parts to break
- No orifices to plug
- No electrical power required for operation

<p>Approximate Available Chlorine Conversion:</p> <p>1 lb. of Chlorine gas or 1 gal. of Sodium Hypochlorite (10% solution) = 1.5 lbs. of Cal Hypo tablets</p>

Convenience:

- Easier material handling
- Tablets are easy to deliver to limited-access installation sites
- Refill is quick and easy
- Minimal clean-out needed over long periods of time
- Small size and light weight facilitates easy installation

Delivery:

- Accurate & consistent chlorine delivery
- Dependable & simple operation
- Cal Hypo tablets will not lose strength over time like sodium hypochlorite

ACCEPTED
with COMMENTS
in EPA Letter Docket
1 8 MAR 1994
Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the Pesticide
registered under EPA Reg. No.
748-295

BEST AVAILABLE COPY

QUALITY

PPG Industries' commitment to Total Customer Satisfaction is supported by our Corporate Quality Statement: "PPG will provide products and services to our customers that fully meet their requirements, on time, every time. We are dedicated to constant improvements in every area of our business and to doing our job right the first time, so as to achieve Total Customer Satisfaction."

SAFETY

PPG is committed to safe handling of chemicals at every step of the process -- from our manufacturing and distribution process through education of the end user. Our leading participation in the Chemical Manufacturer's Association *Responsible Care*® Program is evidence of our commitment to the health, safety and welfare of our customers, the community and the industry. PPG urges everyone who stores, handles and uses our chemicals to read and follow all label directions, and become familiar with the Material Safety Data Sheets (MSDS) for any product they use.



13044B

PPG Chlorinating Tablets

PPG 3-inch White Calcium Hypochlorite Tablets

Properties	
Chemical Name	Calcium Hypochlorite
Chemical Formula	Ca(OCl) ₂
Molecular Weight	142.994
Dimensions	3 1/8" diameter, 1 1/4" height, 300 grams weight
Chemical Assay of PPG Calcium Hypochlorite	
Active Ingredient -- Calcium Hypochlorite	65%
Inert Ingredients -- Readily Soluble Salts	35%



Handling and Storage

Before using calcium hypochlorite tablets, read all label directions on the container. You should follow all handling and storage directions on the container to ensure accident-free use of this chemical.

Do not skid or drop calcium hypochlorite containers. Store the chemical in a cool, dry place. Be sure the container is tightly closed when not in use.

When you take calcium hypochlorite from the container, use clean, dry rubber gloves. As with any chemical, be sure to wash your hands after handling calcium hypochlorite.

Keep calcium hypochlorite away from any fire or lighted tobacco products. If you mix calcium hypochlorite with any other chemical, a fire or explosion could result.

Potentially volatile chemical combinations with calcium hypochlorite include: other chlorinating compounds (non-cal hypo), cyanuric acid, other chemicals, acids, easily combustible materials such as oil, kerosene, gasoline, paint products and any other organic materials.

In case of fire, drench with water. When calcium hypochlorite is involved in a fire, oxygen is supplied by the chemical. So, attempts to

smother the fire with a wet blanket, carbon dioxide or dry chemical extinguisher will be ineffective.

Do not reuse empty calcium hypochlorite containers. You should thoroughly rinse the containers with water and dispose of them properly, according to local regulations for plastic containers.

More detailed safety information can be found in the Material Safety Data Sheet (MSDS), available on request from PPG.

Packaging and Shipping

PPG Industries supplies calcium hypochlorite in convenient 100-pound plastic drums which can be stacked up to four drums high.

PPG manufactures calcium hypochlorite at its plant in Natrium, West Virginia.

Emergency

In case of a product emergency, call the PPG Emergency Response Center -- staffed to answer 24 hours a day

(304) 843-1300


Approved by EPA Letter Docket
 18 MAR 1994
 Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended for the pesticide registered under EPA Reg. No. 748-295

Technical Service / Customer Service
 The Technical Staff of PPG's Chemicals Group is available for consultation on the handling, storage and use of calcium hypochlorite for all applications. PPG's Technical Staff can also assist with recommendations for chlorinator installations. To access technical service or customer service, call toll-free: **(800) 421-2025** -- Monday thru Friday

BEST AVAILABLE COPY

PPG Automatic Chlorinators

PPG offers two automatic chlorinators to suit application needs. The N-200 model is designed for medium to high delivery applications. The N-101 model is ideal for low to medium delivery installations. Both chlorinators are designed for use with the PPG 3-inch calcium hypochlorite tablet. Both the N-101 and N-200 models offer the features listed below.

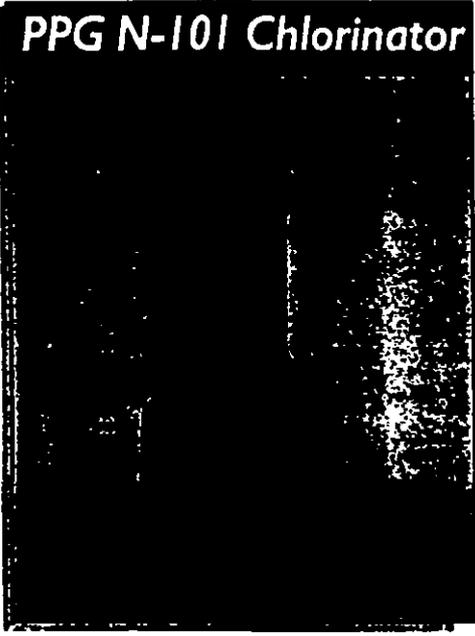



Features:

- Easy to use
- Dependable operation
- Accurate & consistent chlorine delivery due to water flow over constant surface area
- Top-loading refillable cartridge
- No moving parts
- Corrosion-resistant construction




PPG 3-inch Calcium Hypochlorite Tablet Delivery

Graphs shown below are representative of average tested delivery values. Multiply the lbs./hr. chlorine delivered by 1.5 to determine the pounds per hour of tablets used. To calculate the exact amount needed for your application, consult a PPG service representative.

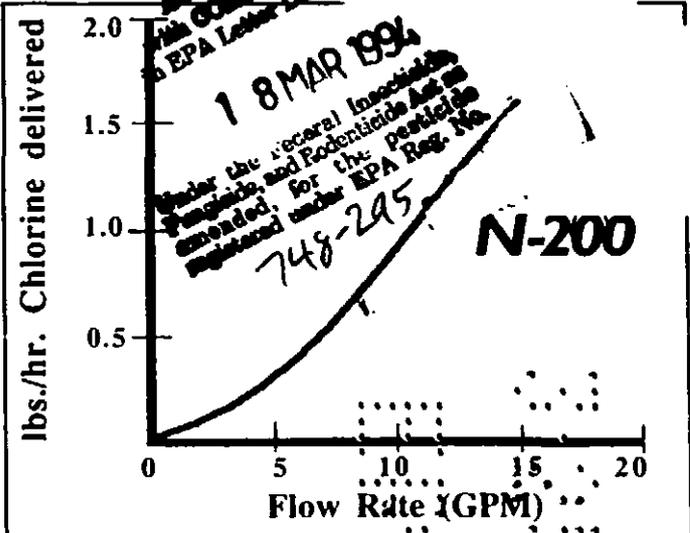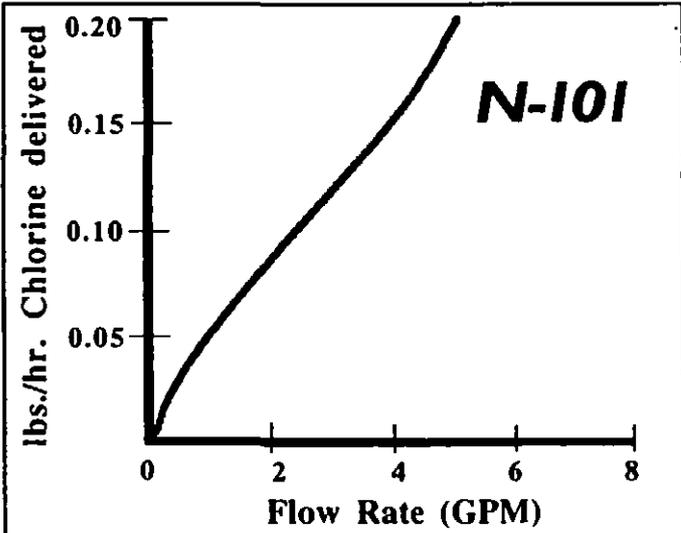

IMPORTANT SAFETY NOTE:
 You should use only PPG 3-inch Calcium Hypochlorite tablets in the PPG chlorinators. If you mix PPG cal-hypo tablets with stablized chlorine or bromine tablets, or with any other sanitizing product, fire or explosion could result.

BEST AVAILABLE COPY

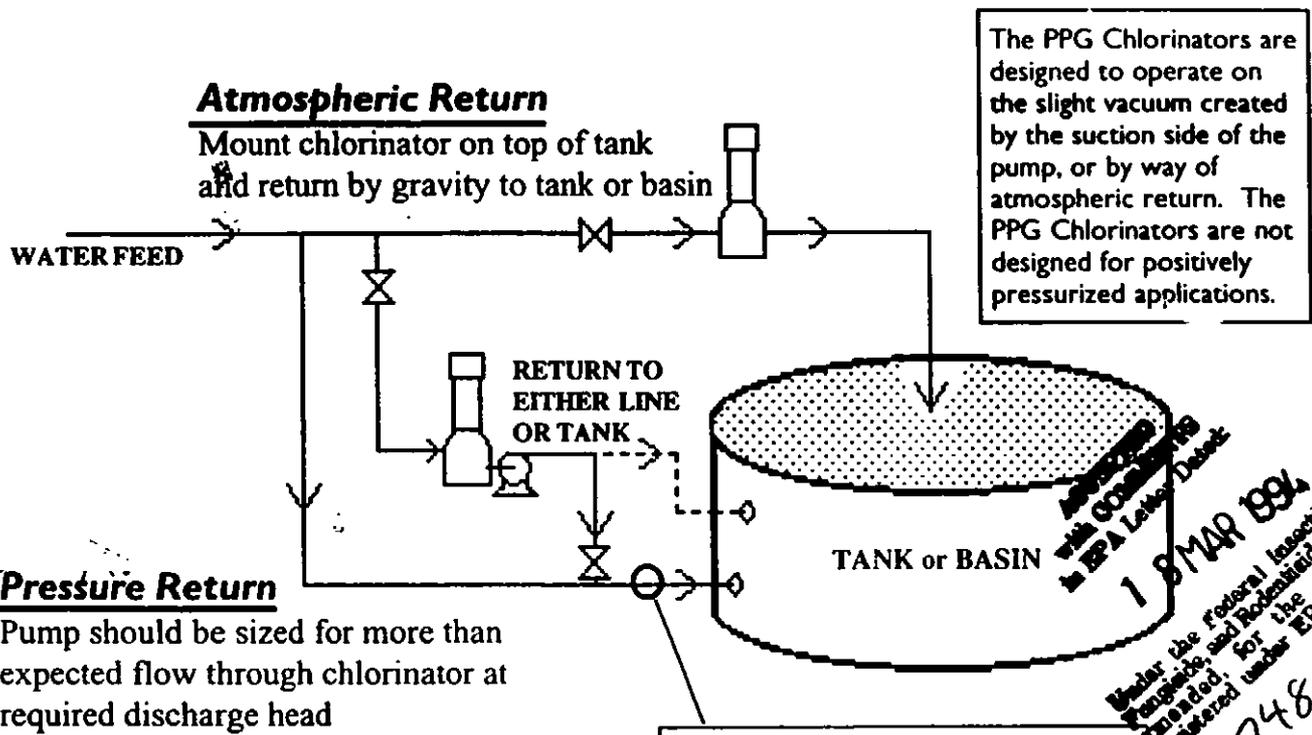


Measure the pressure on the water feed line near the chlorinator return. Once you know the water flow rate and pressure, your industrial pump supplier can recommend the appropriate pump size.

Use potable or "clean" water to feed chlorinator -- not recommended for use with feedwater which contains high solids.

Mixed Flow Installation

By mixing chlorinated water from the chlorinator with unchlorinated water from the water feed line, you can achieve a regulated level of Available Chlorine in the water stored in a holding tank.

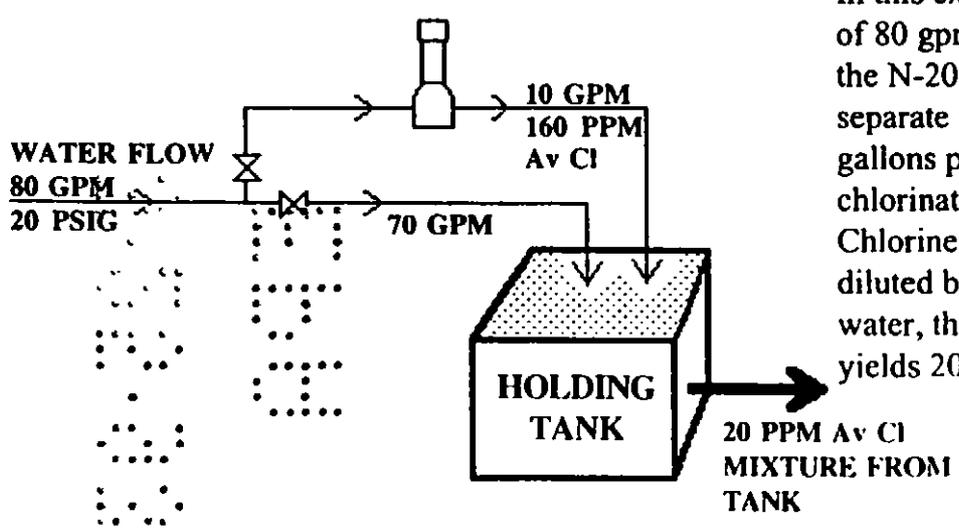


In this example, incoming water flow of 80 gpm @ 20 psig is split between the N-200 chlorinator (10 gpm) and a separate feed line (70 gpm). The 10 gallons per minute coming out of the chlorinator contain 160 ppm Available Chlorine. When this volume of water is diluted by the 70 gpm unchlorinated water, the mixture in the holding tank yields 20 ppm Available Chlorine.

Fully Automated Installation

Example:

40 gpm at 50 psi in a food processing plant needs 10 ppm Available Chlorine. This calculates to 0.2 lbs/hr of chlorine delivery or 7.5 lbs. of tablet usage per day. By reviewing the Tablet Delivery graph, a flow of 4 gpm through the PPG N-200 chlorinator provides water with 100 ppm Available Chlorine at the chlorinator discharge for blending with main water flow to achieve the 10 ppm Av Cl required.

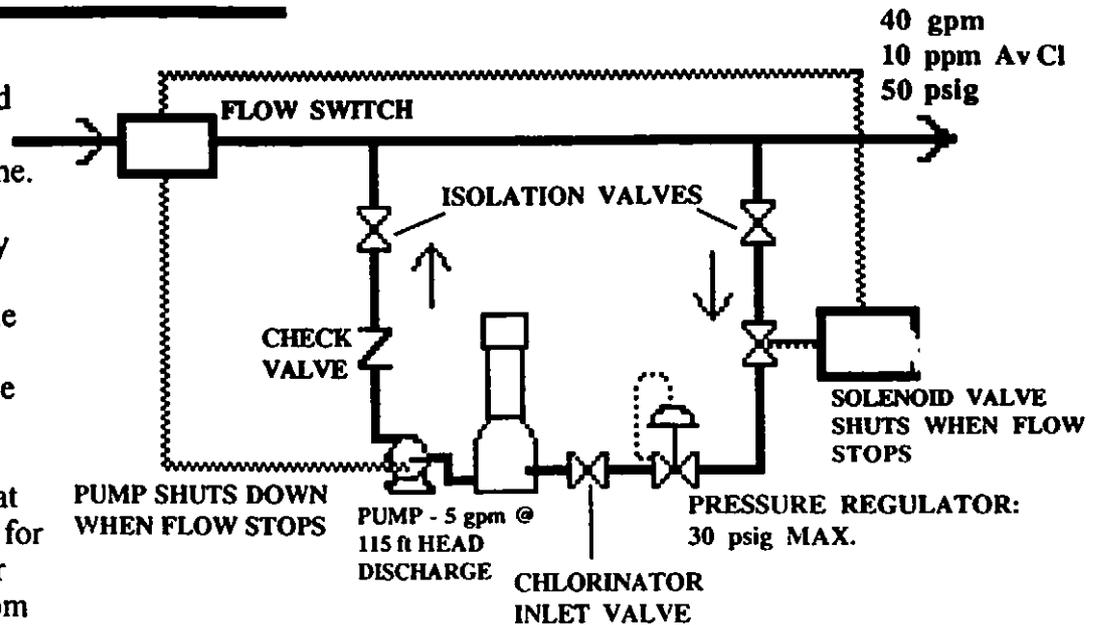

Pressure regulator valve is used to limit inlet pressure to a maximum of 30 psig.

Check valve is used to prevent a surge or backflow from damaging either the pump or chlorinator.

Flow switch is needed to react to an interruption of water flow -- shutting down the pump when flow stops, thereby protecting the pump from running dry. In such a case, the flow switch would also activate the solenoid valve which would then isolate the chlorinator.


Flow meter (not shown on this diagram) regulating chlorinator inlet flow is recommended for precise control.

Multiple Chlorinator Installations

Multiple PPG Chlorinators (N-101 or N-200) can be installed in parallel configurations where greater amounts of chlorine delivery are needed. The diagram at right depicts a representative configuration of a multiple chlorinator installation.

Whenever two or more chlorinators are installed, an oversize supply header must be used to distribute adequate flow to the chlorinators. The pipe lengths from the supply header to each of the chlorinators must be equal, providing even distribution of water flow.

This arrangement provides an even delivery of Available Chlorine from each chlorinator.

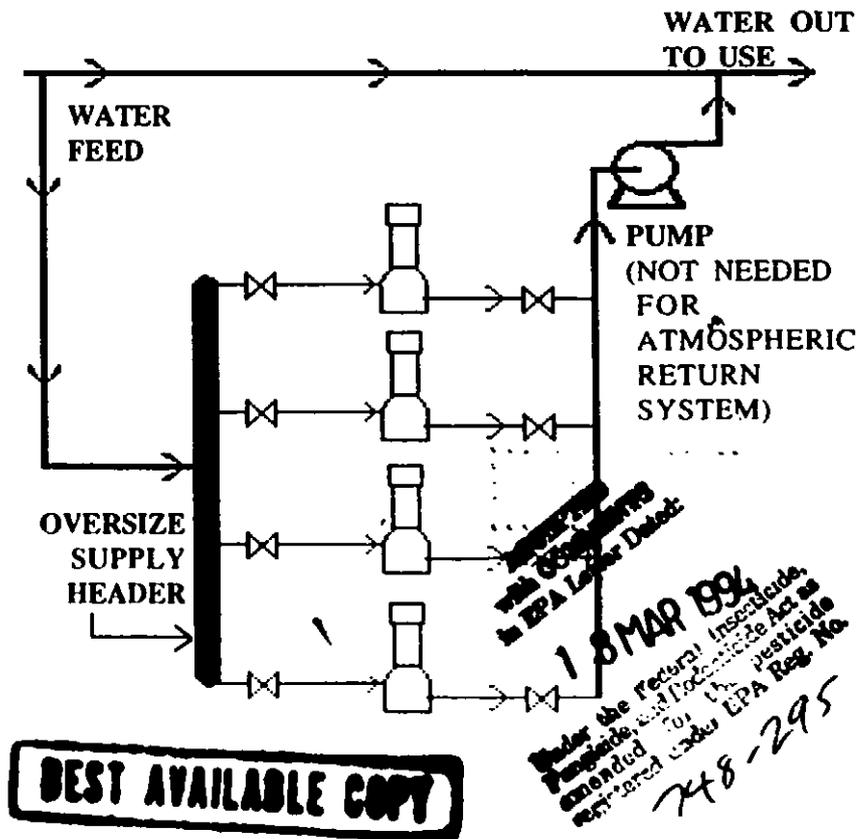

Physical Description	PPG N-101	PPG N-200
Base	11" x 11"	11" x 11"
Height	25"	25"
Weight (Empty)	10 lbs.	10 lbs.
Construction Material	Polyethylene	Polyethylene
Inlet Connection	1-1/2" FPT	1/2" PVC rigid pipe
Outlet Connection	1-1/2" FPT	1-1/2" FPT
Internals	Flexible PVC tubing	Rigid PVC piping
Capacity	12 Tablets (8 lbs.)	12 Tablets (8 lbs.)

ACCEPTED
 with COMMENTS
 in EPA Letter Date
 1 8 MAR 1994
 Under the Federal Insecticide,
 Fungicide, and Rodenticide Act as
 amended, the pesticide
 registered under EPA Reg. No.
 748-295

PPG supplies 3-inch N-101 & N-200 BLUE cal hypo tablets and Chlorinators for NSF-Listed use in pool or spa applications. PPG 3-inch WHITE calcium hypochlorite tablets are designed for industrial uses and are not suited for swimming pool applications. Contact your service representative or PPG for more information.

Installation Recommendations

PPG recommends the use of rigid PVC piping with solvent weld fittings. Flexible PVC hose can be used where rigid piping is not practical. In any installation, be sure to check for leaks in all connections and purge any air from the system prior to running at full operating flow.

The PPG chlorinators are designed to be installed with hardware such as pipes, tees and other fittings which are commonly available at most plumbing supply companies.

In-line mixers can be used to blend the chlorination side stream with the main water flow.

PPG also recommends the use of a flow meter

for precise control of inlet water flow. To locate the nearest distributor of compatible flow meters, contact:

Blue White Industries
 14931 Chestnut Street
 Westminster, CA 92683
 (714) 893-8529 or fax: (714) 894-9492.

Parts Availability

PPG chlorinators' spare parts are available from:

Burch's Landing
 354 Portage Lakes Dr.
 Akron, OH 44319
 (216) 644-0234

OR

Optimus Products
 2762 Getwell Rd.
 Memphis, TN 38118
 (800) 238-0207
 Fax: (901) 794-3884



PPG Industries
 One PPG Place
 Pittsburgh, PA 15272

Statements and methods are based on the best available information and practices known to PPG at present, but are not representations or warranties of performance, result or comprehensiveness, nor do they imply any recommendations to infringe any patent or an offer of license under any patent.

The products mentioned herein can be hazardous if not used properly. Any health hazard and safety information contained herein should be passed on to your customers or employees, as the case may be. PPG Industries also recommends that, before use, anyone using or handling these products thoroughly read and understand the information and precautions on the label, as well as in other product safety publications such as the Material Safety Data Sheet (MSDS).

Like all potentially hazardous material, these products must be kept out of reach of children.

BACTERICIDE • ALGAEICIDE •
BLEACH • SANITIZER •
WATER TREATING AGENT
FOR SWIMMING POOLS
AND INDUSTRIAL APPLICATIONS

A MULTIPURPOSE CHEMICAL FOR DISINFECTION AND SANITIZING

AND POTABLE WATER APPLICATIONS

AGRICULTURE

AQUACULTURE

BEVERAGE PLANTS

FOOD PROCESSING
PLANTS

INSTITUTIONAL,
COMMERCIAL
AND HOME USES

FOR WATER SANITIZATION
AND SEWAGE TREATMENT

PREPARING CALCIUM
HYPOCHLORITE SOLUTIONS

ACCEPTED
with COMMENTS
in EPA Letter Dated
18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the Pesticide
registered under EPA Reg. No.
748-295

~~UNRECORDED~~

BEST AVAILABLE COPY

19 of 48

CALCIUM HYPOCHLORITE

ACCEPTED
with COMMENTS
to EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

Calcium Hypochlorite is Effective

PPG calcium hypochlorite is a dry, white, free-flowing, granular material. In solution with water, it is used as a general disinfectant to destroy bacteria, algae, fungi, and other microorganisms through the process of chlorination. Chlorination is recognized and widely accepted as the standard method of disinfecting drinking water and as a sanitizer in a variety of food processing, commercial, institutional, and domestic applications.

Calcium Hypochlorite is Efficient

PPG calcium hypochlorite is efficient, easy to use and handle. Solutions can be prepared quickly for on the spot use from the economical drums and convenient pails and jugs provided by PPG. PPG markets granular calcium hypochlorite under the names Pittclor® and Inductor™ and tableted calcium hypochlorite as Pittabs® and Inductor Tablets. All are high quality calcium hypochlorite products containing a minimum of 65% available chlorine.

Any of these products may be used for the applications described in this brochure provided directions are followed and this brochure is in the possession of the user at the time of application.

Calcium Hypochlorite Is Economical

PPG calcium hypochlorite does the job without waste and without the need for elaborate equipment. Stored in clean, dry sealed containers, in a cool dry place it remains chemically stable and retains a high available chlorine content for a long period. And, leading distributors sell PPG calcium hypochlorite in quantities and at prices which make it economical for both small and large users.

For additional product information, refer to PPG's calcium hypochlorite MSDSs, available upon request.

Note: Calcium Hypochlorite refers to the following products:
Pittclor® EPA Reg. No. 748-217
Inductor™ EPA Reg. No. 748-238
Pittabs® EPA Reg. No. 748-138
Inductor™ - EPA Reg. No. 748-217
Inductor™ Tablets EPA Reg. No. 748-138

PPG Calcium Hypochlorite
Tablets, EPA Reg. No. 748-295

BEST AVAILABLE COPY

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

PRECAUTIONS AND SAFETY MEASURES

Calcium hypochlorite is a stable chemical when properly stored and handled. However, it is highly corrosive and a strong oxidizing agent. Calcium hypochlorite is not flammable, but in the presence of contaminants or other chemicals, it can cause fire or explosion.

Everyone who handles calcium hypochlorite must be completely familiar with proper handling, storage, and use procedures as well as first aid emergency procedures in case of accident.

Note: The U.S. Department of Transportation regulates transportation of calcium hypochlorite as "hazardous material". As serious penalties can be imposed for violation of DOT regulations, everyone who transports these products should be informed of these regulations and follow them.

HANDLING AND STORAGE

Before using calcium hypochlorite, read all label directions on the container. All handling and storage directions on the container must be followed to ensure accident-free use of the chemical.

Do not slide or drop calcium hypochlorite containers. Store the chemical in its original container in a cool, dry place. Be sure the calcium hypochlorite container is tightly closed when not in use. Keep calcium hypochlorite away from heat sources, sparks, open flames, and lighted tobacco products.

In case of fire, drench with water. Since calcium hypochlorite supplies oxygen, attempts to smother the fire with a wet blanket, carbon dioxide or dry chemical extinguisher are ineffective.

ENVIRONMENTAL HAZARDS: This pesticide is toxic to fish and aquatic organisms. Do not discharge effluent containing this product into lakes, streams, ponds, estuaries, oceans or public waters unless this product is specifically identified and addressed in an NPDES permit. Do not discharge effluent containing this product to sewer systems without previously notifying the sewage treatment plant authority. For guidance contact your State Water Board or Regional Office of the EPA.

Do not get in eyes, on skin or on clothing. Calcium hypochlorite may produce severe chemical burns. Wear eye protection, gloves and protective clothing when using this product. Do not breathe dust or fumes.

Be sure to wash your hands after handling calcium hypochlorite.

Use only a clean, dry scoop made of metal or plastic each time calcium hypochlorite is taken from the container. Add calcium hypochlorite only to water. A fire or explosion may result if calcium hypochlorite is mixed with other chemicals, contaminated with acids, or brought into contact with any other easily combustible materials such as oil, kerosene, gasoline, paint products and any other organic materials.

In Case of Spill or Leak

Use extreme caution. Contamination may cause fire or violent reaction. If fire or reaction occurs in area of spill, douse with plenty of water. Otherwise, sweep up spilled material, using a clean, dry shovel and broom and dissolve spilled material in water. Use the solution immediately as directed.

Do not reuse empty calcium hypochlorite containers. They should be rinsed with water, then disposed of.

Environmental Hazard
Calcium hypochlorite may produce chemical burns in animals and is toxic to fish. Do not introduce calcium hypochlorite into lakes, streams, ponds, or public waters unless in accordance with NPDES permit.

BEST AVAILABLE COPY

FIRST AID

Eye or Skin Contact: Flush with plenty of water for at least 15 minutes while removing clothing if it is contaminated. For eye contact, or if skin irritation occurs, get immediate medical attention.

Inhalation: Remove person(s) affected to fresh air. If signs of irritation or discomfort occur, take the person to a hospital or physician immediately.

If Swallowed: ^{drink} ~~If the person is swallowed~~ conscious, give large quantities of water, ~~to drink followed by any common vegetable cooking oil, if available.~~ Do not induce vomiting. If vomiting occurs, administer additional water. Take the person immediately to a hospital or physician. If the person is unconscious, or in convulsions, do not attempt to induce vomiting or give anything by mouth. Get medical attention immediately.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

BEST AVAILABLE COPY

TABLE OF CONTENTS

22048

Calcium Hypochlorite Applications

Agricultural Uses:

Farm Buildings and Enclosures
Poultry Plants
Harvested Potatoes
Harvested Sweet Potatoes
Mushrooms
Bee Cells and Boards
Harvested Fruits
Harvested Vegetables
Seeds

Page 6

Aquacultural Uses:

Fish Ponds
Fish Pond Equipment
Maine Lobster Ponds
Conditioning Live Oysters
Control of Scavenger Fish in Hatchery Ponds
Boat Hulls

8

Beverage Plants:

Breweries
Carbonated Beverage Plants
Cider Plants
Wineries
Grape Juice Plants

9

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

Food Processing Plants:

Egg Breaking Operations
Fish Processing Plants
Pecan Cracking and Bleaching

12

~~Sugar Refineries~~

Canneries
Meat Processing Plants
Dairy Industries

16

Institutional, Commercial, and Home Uses:

Sanitizing Nonporous Food Contact Surfaces
Sanitizing Porous Food Contact Surfaces
Sanitizing Nonporous Non-Food Contact Surfaces
Sanitizing Porous Non-Food Contact Surfaces
Disinfecting Nonporous Non-Food Contact Surfaces
General Disinfection
Controlling Mold or Mildew
Bathrooms
Sanitizing Dialysis Machines
Asphalt or Wood Roofs and Sidings

Water Sanitation And Sewage Treatment

20

Water Systems, General
Reservoirs
Water Mains
Wells
Private Storage Tanks
Treatment Plants
Emergency Disinfection
Sewage Treatment
Swimming Pools

BEST AVAILABLE COPY

(5)

Preparing Calcium Hypochlorite Solutions

30

23048

AGRICULTURAL USES:

Farm Buildings and Enclosures

Regularly clear all livestock, poultry, and other animals, as well as their feed from premises, enclosures, vehicles, etc. Clean all litter and manure from floors, walls and surfaces of facilities occupied or traversed by animals or poultry. Empty all troughs and other feeding and watering devices. Thoroughly clean all surfaces with soap or detergent and rinse with water. Disinfect by saturating all surfaces with a solution of at least 1000 ppm available chlorine (see Preparing Calcium Hypochlorite Solutions) for a period of 10 minutes. Also, immerse all halters, ropes, cages, and other equipment used in handling and restraining animals or poultry, the cleaned forks, shovels and scrapers used for removing litter and manure in this solution. Ventilate the buildings, vehicles and closed spaces. Do not rehouse livestock or poultry or reemploy equipment until chlorine has been dissipated. Disinfected feed racks, automatic feeders, fountains and waterers must be rinsed with potable water before reuse.

Poultry Plants

Calcium hypochlorite solutions will control odors and bacterial growth in poultry feeding and dressing plants. Poultry feeding areas, dropping boards, feeding troughs and watering fountains should receive regular treatment with solutions containing 5000 ppm available chlorine.

Spray or flush dropping boards and feeding troughs thoroughly with the solution.

Watering fountains should be rinsed with this solution. In float control fountains, treat poultry drinking water with 1 oz. of calcium hypochlorite by using a gravity feeder. In refillable fountains, treat poultry drinking water by adding 1 oz. of calcium hypochlorite for every 1000 to 5000 gallons of poultry drinking water.

Clean poultry dressing areas for a period of 10 minutes regularly before treatment. Immediately after, disinfect by spraying the walls, tables, floors and ceilings with a solution containing 5000 ppm available chlorine.

Clean equipment and utensils should be ~~disinfected~~ ^{sanitized} by rinsing with a 200 ppm available chlorine solution. ~~After immersing for 2 minutes, rinse all surfaces with potable water.~~ ^{for a period of 2 minutes.}

Harvested Potatoes

To help control and reduce the spread of organisms which cause soft rot, sanitize potatoes after cleaning and prior to storage by spraying with a solution containing 500 ppm available chlorine at a dosage of 1 gallon of sanitizing solution per ton of potatoes. Spray the solution over the potatoes as they enter storage on a conveyor line. Provide tumbling action during this treatment.

Harvested Sweet Potatoes

To control and reduce the speed of soft rot-causing organisms in water and on sweet potatoes (*Ipomoea batatas*), spray potatoes with a 150 to 500 ppm solution for 2 to 5 minutes.

If a dip is used, monitor the solution hourly and add enough calcium hypochlorite to the solution to maintain the 150 to 500 ppm level. Or, change the solution hourly (or as frequently as necessary) to prevent the available chlorine level from dropping too low.

Mushrooms

To control bacterial blotch (*Pseudomonas tolosii*), apply a 100 to 200 ppm solution prior to watering mushroom production surfaces. The first application should begin when pins form, and thereafter between breaks on a need basis depending on the occurrence of bacterial blotch. Calcium hypochlorite may be applied directly to pins to control small infection foci. Apply 1.5 to 2.0 oz. per square foot of growing space.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No. 748-295

BEST AVAILABLE COPY

24 of 48

Description: RPG Calcium Hypochlorite
DNR: C-3426
File: "PPG-1"
Type: CAP
Date: October 14, 1994 . . .

Customer Correctional: 12-16-91

Bee Cells and Boards (Not Applicable in California)

Immerse leafcutting bee cells and bee boards in a solution containing 1 ppm available chlorine for 3 minutes to disinfect. Allow cells to drain for 2 minutes and dry for 4 to 5 hours, or until no chlorine odor can be detected. This solution is made by thoroughly mixing 1/4 tsp. of calcium hypochlorite in 200 gallons of water. Bee domiciles are disinfected by spraying with a 0.1 ppm solution until all surfaces are thoroughly covered. Allow the domicile to dry until chlorine odor has dissipated before placing in use.

Harvested Fruits

Calcium hypochlorite solutions containing 25 ppm available chlorine can reduce harmful bacteria and improve the keeping properties of fruit. First, clean all fruit in wash tank. Then, prepare a 25 ppm available chlorine solution. Soak the fruit for two minutes in the solution, then rinse with potable water.

in a second wash tank.

Harvested Vegetables

First, remove surface soils and debris from vegetables in a wash tank. After draining, disinfect by submerging vegetables in a second wash tank for two minutes while circulating a 25 ppm available chlorine solution. After this washing, spray rinse with fresh calcium hypochlorite solution, rinse with potable water and then package.

Seeds

Bacterial spot (*Xanthomonas vesicatoris*) on pimentos seeds may be controlled by initially removing moist seeds from ripe fruits. To control surface fungi and bacteria on tomato seeds, initially wash seeds, then immediately soak seeds in 39,000 ppm solution for 15 minutes with continuous agitation. After treatment, rinse seeds in potable water for 15 minutes. Dry seeds to normal moisture. Make this solution by mixing 8 oz. of this product with 1 gallon of water.

A
A
A

ACCEPTED
WITH COMMENTS
in EPA Letter Databk
18 MAR 1994
Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the Pesticide
registered under EPA Reg. No.
748-295

BEST AVAILABLE COPY

AQUACULTURAL USES:

Fish Ponds

Remove all fish from ponds prior to treatment. Thereafter, thoroughly mix 20 oz. of calcium hypochlorite for each 10,000 gallons of pond water. Repeat the treatment if the available chlorine level is below 1 ppm after 5 minutes. Return fish to the pond after the available chlorine level reaches zero.

Fish Pond Equipment

Clean all physical soil from equipment prior to treatment. Soak equipment in a solution of 200 ppm available chlorine. Porous equipment should soak for one hour.

Maine Lobster Ponds

Remove lobster, seaweed, etc. from ponds prior to treatment. Drain the pond and thoroughly mix 75 pounds of calcium hypochlorite to each 10,000 gallons of pond water. Apply evenly so that all barrows, gates, rocks, and dam are treated with the product. Permit high tide to fill the pond and then close gates. Allow water to stand 2 to 3 days until the available chlorine level reaches zero. Open the gates and allow 2 tidal cycles to flush the pond before returning lobsters to the pond.

Conditioning Live Oysters (Not Applicable in California)

Mix 1 oz. of this product completely with each 10,000 gallons of water at 50 to 70 degrees F. Expose the oysters to this solution for at least 15 minutes, monitoring the available chlorine level to be sure it does not fall below 0.05 ppm. Repeat the entire process if the available chlorine level drops below 0.05 ppm or the temperature falls below 50 degrees F.

Control of Scavenger Fish in Hatchery Ponds

Prepare a 200 ppm solution. Pour into drained pond potholes and repeat if necessary. Do not replace desirable fish into refilled ponds until chlorine residual has dropped to 0 ppm, as determined by a test kit.

Boat Hulls (Not Applicable in California)

To control slime on boat hulls, sling a plastic tarp under the boat, retaining enough water to cover the fouled bottom area. Do not allow additional water to enter enclosed area. This envelope should contain approximately 500 gallons of water for a 14 foot boat. Add 3.5 oz of calcium hypochlorite to the enclosed water to obtain a 35 ppm available chlorine concentration. Leave immersed for 8 to 12 hours. Repeat if necessary. Do not discharge the solution until the free chlorine level has dropped to 0 ppm, as determined by a swimming pool test kit.

ACCEPTED
with COMMENTS
in EPA Letter Dated

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

26 of 48

BEVERAGE PLANTS: Breweries

Calcium hypochlorite solutions enable breweries to prevent bacterial growth and assure the purity and fresh taste of their products on a continuing basis.

As a general sanitizer, calcium hypochlorite is doubly effective because of its dissolving action on beer stone, proteins, slime, yeast, and other matter commonly found in brewery lines, tanks, hoses, etc.

To prepare a stock cleaning and sanitizing solution, add 5 pounds of calcium hypochlorite to three gallons of warm water in a 20-gallon container. Introduce 2 pounds of soda ash and stir until dissolved. Dilute this mixture with cold water to make 15 gallons of solution, then add 5 pounds of PPG Pels® caustic soda beads. Stir to dissolve and allow to stand. When diluted 1-to-10 with water, this solution is an excellent cleaner/sanitizer for piping and equipment, steel, tile and concrete vats.

Filter Pulp:

Calcium hypochlorite solutions sanitize and remove colloidal deposits and coloring matter on wood pulp being used as a filtering agent, thereby restoring maximum efficiency.

Wash the wood pulp filter mass in the usual manner. Shut off washer water flow after washing. Add 0.4 oz. of calcium hypochlorite for each 10 gallons of water in the washer to remove colloidal deposits. Run the washer with solution for 60 minutes. If a washer is not used, soak the pulp in water containing 0.4 oz. of calcium hypochlorite per 10 gallons of water. Remove pulp after letting stand for 10-15 minutes at 150 degrees F.

Fermenting Tubs — Cyprus:

Clean and rinse the tub thoroughly to remove all traces of oil, then fill with a 200 ppm available chlorine solution to sanitize. Allow to stand 10-12 hours.

False Bottoms:

Sanitize false bottoms by covering them with warm water and broadcasting one pound of dry calcium hypochlorite for every 4 gallons of water used. Allow to stand 20 minutes.

Washing Equipment:

Sanitize the washing equipment by first thoroughly cleaning to remove physical soil, then flushing all surfaces with calcium hypochlorite solution containing 200 ppm available chlorine.

Malting Areas:

Floors and walls around malt tanks should be thoroughly washed once a week to prevent mold formation and odor. After cleansing, flush both floors and walls with a solution containing 0.25% available chlorine.

Aging Cellars:

Spray the concrete walls of aging cellars regularly with a calcium hypochlorite solution of 0.5% available chlorine to destroy existing mold and mildew and prevent odor.

Pasteurizers:

Slime and odors that develop in pocket-type pasteurizers can be controlled with regular use of a 1% available chlorine solution fed into the pasteurizer water supply by a hypochlorinator. A feed rate which provides a dosage of 0.5 to 1.0 ppm available chlorine at the overflow is required for optimum results. After draining and cleaning pasteurizers, the hypochlorinator should be used to provide fresh refill water with the proper chlorine residual.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

27 of 48

Grain Steep Tanks:

Calcium hypochlorite is a highly effective sanitizer in controlling mold growth in humid malt house conditions. Steep tanks should be ~~washed lightly with water~~ ^{cleaned} first, then sprayed with a 1.5 to 2.0% available chlorine solution. Allow to stand 30 minutes.

The walls of concrete germination compartments should also be ~~washed lightly~~ ^{cleaned} and treated as above.

The perforated metal floors of germination compartments should be sprayed with high pressure water and then covered at a rate of 0.15 oz. of dry calcium hypochlorite per square foot of wet floor. (A clean, dry, uncontaminated broadcaster or spreading device may be used effectively.) Allow the coating to stand for 30 minutes; ~~rinse thoroughly with potable water before putting equipment in service~~ ^{for thorough cleaning} } OK leave in

Water Supplies:

Calcium hypochlorite solutions containing 1% available chlorine will properly sanitize plant water used ~~to~~ ^{to} the production of beer.

The calcium hypochlorite solution should be introduced into the water supply by a hypochlorinator. An available chlorine residual of ~~0.1 to~~ ^{0.2} ppm must be maintained throughout the system at all times. Be sure to dechlorinate the water before it is used to process beer.

0.2 to 0.6

Carbonated Beverage Plants

Water Supplies:

Available plant water supplies used ~~in the production of~~ carbonated beverages may be properly sanitized by introducing a solution of 1% available chlorine. The solution should be introduced by a hypochlorinator and adjusted to supply an available chlorine residual of 0.2 to 0.6 ppm at all times.

Be sure to dechlorinate the water before it is used to process beverages.

0.2 to 0.6

Manufacturing Equipment:

The use of calcium hypochlorite is a reliable and economical way to sanitize equipment and control the quality and taste of carbonated beverages.

Before bottling operations start up, feed a 200 ppm available chlorine solution through all pumps, lines, and fillers to eliminate bacteria. After each bottling operation, thoroughly spray syrup tanks with a ~~200~~ ³⁰⁰ ppm available chlorine solution, let stand for 30 minutes.

Clean surfaces before treatment

ADD

Cider Plants

Even when stored under cold conditions, sweet cider is particularly susceptible to fungus growth, which causes spoilage. As a preventive, sanitize each cask with a 200 ppm available chlorine solution before use. Clean thoroughly first, then rinse each cask with the solution.

ADD

for a period of 2 minutes

Wineries

Plant Sanitization:

Calcium hypochlorite will sanitize and prevent contamination in wineries to insure product quality. Following each run, clean the entire plant area and its equipment. Immediately before the next run, ~~sanitize~~ ^{sanitize} with calcium hypochlorite as follows:

Rinse nonporous wall surfaces, floors and equipment with a calcium hypochlorite solution containing ~~500~~ ⁵⁰⁰ ppm available chlorine. Let stand 10 minutes.

500
200

Porous surfaces (wood, concrete, etc.) should be scrubbed or sprayed with a 1000 ppm available chlorine solution. Let stand 10 minutes.

Storage vessels, fermenting vats, casks, presses and grape crushers should be cleaned of physical soil thoroughly before treatment. Rinse or spray with a calcium hypochlorite solution containing 200 ppm available chlorine. Let stand 10 minutes.

Sanitize bottles and corks by immersing them for 5 minutes in a tank containing 200 ppm available chlorine.

ACCEPTED with COMMENTS in EPA Letter Dated 17 8 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

Mold Control:

Mold growth should be treated on discovery with calcium hypochlorite to prevent further spreading.

Spray the affected surfaces with a calcium hypochlorite solution providing 0.5% available chlorine. Heavy growth may require scrubbing and/or repeated applications.

Storage and Filling Tanks:

Disinfect storage and filling tanks with calcium hypochlorite to maintain a high level of product quality.


After a run and before refilling tanks, they should be thoroughly sanitized with calcium hypochlorite.

Wooden tanks should be filled with calcium hypochlorite solutions containing 500 ppm available chlorine. Solutions should stand for an hour and the tanks rinsed with potable water before refilling.

Nonporous tanks should be filled with calcium hypochlorite solutions containing 250 ppm available chlorine. Let stand 15 minutes, then flush.

Unused tanks and vats should be kept sanitized with calcium hypochlorite. Fill each with water and dry calcium hypochlorite to obtain a residual of approximately 15 ppm available chlorine. Test every week and repeat treatment if residual falls below 2 ppm.

disinfected

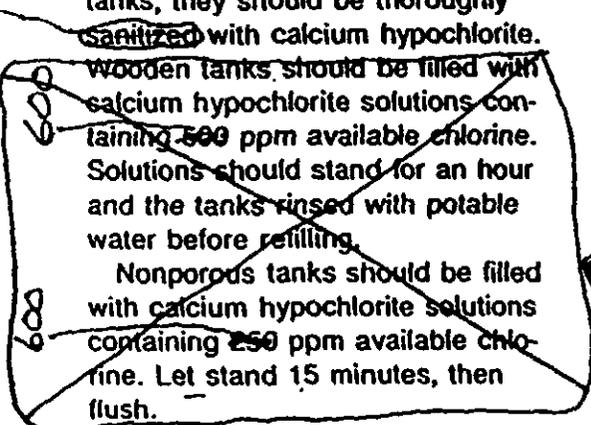

Press Cloths:

Press cloths contaminated with bacteria or organic matter must be treated with calcium hypochlorite solutions to neutralize microorganisms and prevent spreading.

After use, wash cloths thoroughly, then soak as follows: For every 100 pounds dry weight of the cloth, add 2 oz. dry calcium hypochlorite to 60 gallons of water. Soak for 15 minutes.

Grape Juice Plants

Sanitize equipment and problem areas of grape juice plants using the same treatment procedures recommended for wineries.

ACQUIRED with COMMENTS in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No. 748-295

For wooden or nonporous tanks, first preclean then fill with calcium hypochlorite solutions containing 600 ppm available chlorine. Solutions should stand for at least 10 minutes then rinse tanks with potable water for a period of 2 minutes immediately before refilling.

Job No.: 99856

Client: Geyer Printing

Description: PPG Calcium Hypochlorite

Dist: G-5426

File: "PPG-2"

Type: CAP

Date: OCTOBER 14, 1991

2748

BEST AVAILABLE COPY

FOOD PROCESSING PLANTS:

Egg Breaking Operations

Calcium hypochlorite solutions will control bacteria on contaminated eggs and sanitize equipment and areas used in egg breaking operations.

Food Egg Product Sanitization:

Thoroughly clean all eggs. Prepare a 200 ppm available chlorine solution using warm water. (Temperature should not exceed 130 degrees F.) Spray the warm sanitizer over eggs so that they are thoroughly wetted. Allow the eggs to dry before casing or breaking. Do not apply a potable water rinse. The solutions should not be reused to sanitize eggs.

Cups, breaking knives, trays and any other equipment that comes in contact with "off" eggs should be thoroughly cleaned and sanitized. Clean all equipment with washing powder and rinse with clear water. Immediately prior to placing back in use, spray with a calcium hypochlorite solution containing 50 to 200 ppm available chlorine.

Sanitize egg freezers and dryers, tanks, pipelines, pumps, etc. using a spray method treatment. This method is generally used to sanitize large, nonporous surfaces already free of physical soil.

Prepare a calcium hypochlorite solution containing 200 ppm available chlorine. If possible, use pressure spraying or fogging equipment designed for use with hypochlorite solutions (plastic, rubber coated, or stainless steel.) When using other types of spraying equipment, be sure to empty and rinse thoroughly with fresh water immediately after use.

ACCEPTED with COMMENTS in EPA Letter Dated:

18 MAR 1994 Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended for the pesticide registered under EPA Reg. No. 748-295

Spray or fog all surfaces eggs will touch thoroughly. Allow excess solution to drain off, then place in service.

Food Egg Product Disinfection:

In egg breaking rooms, all equipment and surfaces should be deodorized and disinfected with solutions of calcium hypochlorite. After cleaning, and just prior to using, spray, wipe, or rinse tables, stools, walls and floors with a calcium hypochlorite solution containing 1000 ppm available chlorine. Let stand 2 minutes. Rinse surfaces with potable water.

Fish Processing Plants

Calcium hypochlorite solutions will control the growth of bacteria and microorganisms which occur in fish processing plants.

Scrub all surfaces thoroughly with hot water and washing powder to remove all physical soil before treatment.

Hard or Nonporous Surfaces:

Calcium hypochlorite solutions containing 600 to 600 ppm available chlorine will disinfect smooth wood, hard wood, metal, or synthetic surfaces (new boxes or tabletops; conveyor belts or machines). Flood surfaces with calcium hypochlorite solution for 2 to 5 minutes. Let stand for 2 minutes. Rinse all surfaces with potable water.

Soft or Porous Surfaces:

Calcium hypochlorite solutions containing 1000 to 5000 ppm available chlorine will sanitize soft or porous surfaces (worn tables, old boxes, concrete floors and walls). Flood surfaces with calcium hypochlorite solution for 2 to 5 minutes. Let stand 2 minutes. Rinse all surfaces with potable water.

Rinse with 200 ppm available chlorine solution for a period of 2 minutes.

10

600

12

Sanitize

30048

Pecan Cracking and Bleaching

Calcium hypochlorite solutions can be used both to control bacteria in pecans and also to bleach the shells in preparation for dyeing. Calcium hypochlorite solutions containing 1000 ppm available chlorine reduce bacteria in pecans without affecting the taste. Prior to cracking and shelling, soak the pecans in the solutions for at least 10 minutes. Remove and let the pecans age for 24 hours to allow for softening of the meat. Following this, the pecans will crack more uniformly and the entire nut may be removed more easily.

Solutions containing 5000 ppm available chlorine effectively bleach pecan shells. Before bleaching, wash the pecans in a rotary cleaner. Rinse, drain, and soak the pecans in a 2% sulfuric acid bath at 27 degrees to 32 degrees C (80 to 90 degrees F) for one minute. Afterward, place them in the calcium hypochlorite solution for 4 to 8 minutes. When the pecans are bleached white, drain and wash in a 1% sulfuric acid bath at 27 to 32 degrees C. After drying, they are ready to be dyed.

Canneries

Hot, freshly-packed cans are often cooled by immersion in cold water. This creates a partial vacuum in the container which may allow the cooling water to enter through seams or pin holes. If bacteria are present in the water, contents may become contaminated and spoil.

Calcium hypochlorite solutions providing 1% available chlorine should be fed into cooling tanks or channels by an elevated tank to provide a concentration of 2 ppm available chlorine. The flow may be controlled with a noncorroding valve or a pinch-stop on a rubber hose.

Feed points should be located to provide uniform distribution of solution throughout the entire system. Long and narrow tanks may require the solution to be fed at two points to insure proper distribution.

Test the cooling water for available chlorine. If a residual of 2 ppm is present throughout the system, the water is properly sanitized.

Test for available chlorine every hour until dosage requirements are established. Thereafter, check every 2 or 3 hours to ascertain that an available chlorine residual of 2 ppm is maintained throughout the cooling system.

Water Supplies:

One percent chlorine solutions will effectively purify the water supply in canneries. Feed the solution into the water supply by a hypochlorinator on the intake side of the pump. An available chlorine residual of ~~0.1 to 0.2~~ ppm must be maintained throughout the water distribution system to assure adequate purification. Regular testing should be initiated to assure proper chlorine residuals are present at all times.

Wastes:

Solutions containing 1000 ppm available chlorine control odors from dry food waste disposed in dumps or collecting points. Accumulations of waste should be sprayed or soaked with calcium hypochlorite solution daily to eliminate odors.

Calcium hypochlorite solutions applied by continuous treatment to maintain a residual of 15 to 25 ppm will control odors in food waste being removed by water suspension.

0.2 to 0.6

ACCEPTED
with COMMENTS
in EPA Letter Dated

18 MAR 1994
Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

BEST AVAILABLE COPY

Meat Processing Plants

An effective general sanitizer or disinfectant, calcium hypochlorite solutions also provide odor control in meat processing plants.

Killing Rooms:

Disinfect the entire killing room with calcium hypochlorite solution to prevent the contamination of meat and the development of offensive odors.

Scrub all walls and floors completely. Spray thoroughly with a solution containing 5000 ppm available chlorine.

Drains and traps through which blood passes should be flushed thoroughly with water and flushed with solution containing 5000 ppm available chlorine. Allow this solution to stand overnight, then flush.

Inedible Rooms:

Solutions containing 1000 ppm available chlorine will properly disinfect inedible rooms, prevent odors, and improve the handling qualities of hides and other marketable items.

Thoroughly clean inedible rooms on a regular basis. After cleaning, spray tank house, the press rooms, and the hide rooms generously with the calcium hypochlorite solution.

Edible Rooms:

Calcium hypochlorite solutions containing 1000 ppm available chlorine will disinfect and control bacteria in refrigerating, curing, and processing areas to prevent taste and color problems in products.

Thoroughly clean all edible rooms on a regular basis. After cleaning, room surfaces and equipment should be sprayed well with solution. ~~After spraying, let stand 5 minutes, then rinse all equipment thoroughly with potable water.~~ *200 ppm for 10 minutes.*

Equipment and Utensils:

To prevent contamination, sanitize all equipment and utensils that come in contact with meat with a solution containing 200 ppm available chlorine. Clean equipment and utensils thoroughly, removing all fat and grease. Spray or rinse with solution. Let stand 2 minutes.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

Locker Rooms, Elevator Pits, and Toilets:

Disinfect and deodorize locker rooms, elevator pits, and toilets with a calcium hypochlorite solution containing 5000 ppm available chlorine.

Locker rooms, shower rooms, toilets, urinals, and drains should be cleaned, then sprayed or flushed with the solution on a regular basis. After treatment, let stand 10 minutes, then rinse exposed surfaces with potable water to prevent corrosion.

Add 1 level tablespoon of calcium hypochlorite to the residual water of toilet bowls and swab.

Dairy Industries

Creameries, Ice Cream Factories, Cheese Factories, and Milk Plants:

Calcium hypochlorite solutions provide an effective, economical, method of sanitizing processing equipment and problem areas in creameries, ice cream factories, cheese factories, and milk plants.

To prevent contamination of the product, apply calcium hypochlorite solutions to every surface it will touch.

Pressure Sanitizing Equipment:

Pressure is commonly used to sanitize closed systems, such as fluid milk cooling and handling equipment. The pressure method is also appropriate for sanitizing weigh tanks, coolers, short-time pasteurizers, pumps, homogenizers, fillers, sanitary piping and fittings, and bottle and can fillers.

Immediately after use, clean all equipment thoroughly, then place back in operating position.

Prepare a sufficient amount of a calcium hypochlorite solution, containing 200 ppm available chlorine to fill the equipment. (Allow a 10% excess for waste.)

Pump the calcium hypochlorite solution through the system until it is filled and air is excluded. Close final drain valves and hold the system under pressure for 2 minutes to insure proper contact with all surfaces. Drain the solution.

Rinse with 200 ppm available chlorine solution for a period of 2 minutes.

Spray Sanitizing Equipment:

A spray (or fog) method is generally used to sanitize large, non-porous surfaces which have been freed of physical soil. It is appropriate for batch pasteurizers, holding tanks, weigh tanks, tank trucks and cars, vats, tile walls, ceilings and floors.

and thoroughly cleaned.

Prepare a solution containing 200 ppm available chlorine. Use pressure spraying or fogging equipment designed to resist hypochlorite solutions (rubber-coated, plastic, or stainless steel). When using other types of spraying equipment, empty and rinse thoroughly with fresh water immediately following treatment.

Heavily spray or fog all surfaces the product will contact. All surfaces, corners and turns should be thoroughly coated. Allow excess solution to drain off, then place in service.

Water Supplies:

Calcium hypochlorite solutions containing 1% available chlorine will disinfect water supplies in ~~dairy~~ plants, to safeguard the quality of the product. The solution should be prepared using the following procedure:

used in the production of dairy products.

Mix 3 3/4 pounds of calcium hypochlorite into a 30-gallon plastic container 1/2 full of warm water. Add 3 pounds of light soda ash, stir thoroughly and dilute to 30 gallons. Add this solution to the water supply and let stand 20 minutes. The water supply has been sanitized when a 0.2 ppm of available chlorine is present.

General Sanitizing:

Sanitize plant floors, walls and ceilings, and control odors in refrigerated areas and on drain platforms with a 1000 ppm calcium hypochlorite solution.

Flush or swab surfaces generously with solution. Allow to stand 2 minutes.

Controlling Mold and Mildew:

Destroy mold and nonresidual mildew that often grows in cheese-aging rooms, storage rooms, and other areas with a calcium hypochlorite solution of 5000 ppm available chlorine.

pre-cleaned

Brush or spray all walls, floors, ceilings, and shelves with the solution. Then, rinse all metal surfaces immediately to prevent corrosion.

Wastes:

Calcium hypochlorite solutions containing 15 to 25 ppm available chlorine provide disinfection and odor control of dairy plant waste.

An overflow-type retention basin, flume or outfall of sufficient length is necessary to provide required contact time and mixing. For continuous treatment, calcium hypochlorite is introduced by a hypochlorinator capable of feeding the solution in proportion to waste flow. The hypochlorinator should be located near the point where waste leaves the plant building, followed by baffles for agitation.

Batch waste should be impounded and treated with calcium hypochlorite solution which provides a residual of 15 to 25 ppm available chlorine.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

33-448

INSTITUTIONAL, COMMERCIAL, AND HOME USES:

Sanitizing Nonporous Food Contact Surfaces

Rinse Method:

A calcium hypochlorite solution of 100 ppm available chlorine may be used in the sanitizing solution if a chlorine test kit is available. Solutions containing an initial concentration of 100 ppm available chlorine must be tested and adjusted periodically to insure that the available chlorine does not fall below 50 ppm. If a test kit is not available, prepare a sanitizing solution to provide approximately 200 ppm available chlorine by weight.

Thoroughly scrub all surfaces with an approved cleaner, followed by a potable water rinse before sanitization. Prior to use, rinse surfaces thoroughly with the sanitizing solution, maintaining contact with the sanitizer for at least 2 minutes. If solution contains less than 50 ppm available chlorine, as determined by a suitable test kit, either discard or add sufficient dry calcium hypochlorite to reestablish a 200 ppm residual. Do not rinse equipment with water after treatment and do not soak equipment overnight. Sanitizers used in automated systems may be used for general cleaning but may not be reused for sanitizing purposes.

Immersion Method:

A calcium hypochlorite solution of 100 ppm available chlorine may be used in the sanitizing solution if a chlorine test kit is available. Solutions containing an initial concentration of 100 ppm available chlorine must be tested and adjusted periodically to insure that the available chlorine does not fall below 50 ppm. If no test kit is available, prepare a sanitizing solution to provide approximately 200 ppm available chlorine by weight.

Thoroughly scrub all surfaces with an approved cleaner, followed by a potable water rinse before sanitization. Prior to use, immerse equipment in the sanitizing solution for at least 2 minutes and allow the sanitizer to drain. If solution contains less than 50 ppm available chlorine, as determined by a suitable test kit, either discard or add sufficient dry calcium hypochlorite to re-establish a 200 ppm residual. Do not rinse equipment with water after treatment.

Sanitizers used in automated systems may be used for general cleaning but may not be reused for sanitizing purposes.

Flow/Pressure Method:

Disassemble equipment and thoroughly clean after use. Assemble equipment in operating position prior to use. Prepare a volume of a 200 ppm available chlorine sanitizing solution equal to 110% of volume capacity of the equipment. Pump solution through the system until a full flow is obtained in all extremities and the system is completely filled with the sanitizer. Close drain valves and hold under pressure for at least 2 minutes to insure contact with all internal surfaces. Remove some solution from drain valve and test with a chlorine test kit. If effluent contains less than 50 ppm available chlorine, repeat the process.

Clean-In-Place Method:

Thoroughly clean the equipment after use. Prepare a volume of a 200 ppm available chlorine sanitizing solution equal to 110% of volume capacity of the equipment. Pump the solution through the system until full flow is obtained at all extremities and the system is completely empty of air and filled with the sanitizer. Close drain valves and hold under pressure for at least 10 minutes to insure contact with all internal surfaces. Remove some solution from drain valve and test with a chlorine test kit. If effluent contains less than 50 ppm available chlorine, repeat the process.

ADMITTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1996

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

31 of 48

Spray/Fog Method:

Preclean all surfaces after use. Use a 200 ppm available chlorine solution to control bacteria, mold or fungi and a 600 ppm solution to control bacteriophage. Prepare a 200 ppm sanitizing solution of sufficient size by thoroughly mixing the product in a ratio of 1 oz. product with 20 gallons of water. Prepare a 600 ppm solution by thoroughly mixing the product in a ratio of 3 oz. product with 20 gallons of water. Use spray or fogging equipment which can resist hypochlorite solutions. Always empty and rinse spray/fog equipment with potable water after use. Thoroughly spray or fog all surfaces until wet, allowing excess sanitizer to drain. Vacate area for at least 2 hours. Prior to using equipment, rinse all surfaces treated with a 600 ppm solution with a 200 ppm solution.

Sanitizing Porous Food Contact Surfaces

Rinse Method:

Prepare a solution of approximately 600 ppm available chlorine by weight. Preclean surfaces in the normal manner and immediately rinse all surfaces thoroughly with the sanitizing solution, maintaining contact with the sanitizer for at least two minutes. Prior to using the equipment, rinse all surfaces with 200 ppm available chlorine solution. Do not rinse and do not soak equipment overnight.

Immersion Method:

Prepare a sanitizing solution of approximately 600 ppm available chlorine by weight. Clean the equipment in a normal manner. Prior to using, immerse equipment in a 200 ppm sanitizing solution for at least two minutes and allow the sanitizer to drain. Do not rinse and do not soak equipment overnight.

ADOPTED
with COMMENTS
in EPA Letter Dated

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

Spray/Fog Method:

Preclean all surfaces after use. Prepare a 600 ppm available chlorine sanitizing solution. Use spray or fogging equipment which resists hypochlorite solutions. Thoroughly spray or fog all surfaces until wet, allowing excess sanitizer to drain. Vacate the area for at least 2 hours. Prior to using the equipment, rinse all surfaces with a 200 ppm available chlorine solution.

Sanitizing Nonporous Non-Food Contact Surfaces Rinse Method:

Clean equipment surfaces in the normal manner. Immediately rinse all surfaces thoroughly with a 200 ppm available chlorine solution, maintaining contact for at least 2 minutes. Do not rinse after treatment and do not soak equipment overnight.

Immersion Method:

Clean the equipment in normal manner. Immediately immerse in a 200 ppm available chlorine solution for at least 2 minutes and allow the sanitizer to drain. Do not rinse after treatment.

Spray/Fog Method:

Preclean all surfaces after use. Prepare a 200 ppm available chlorine solution. Use spray or fogging equipment which can resist hypochlorite solutions. Immediately spray or fog all surfaces thoroughly, then allow excess solution to drain. Vacate area for at least 2 hours.

Sanitizing Porous Non-Food Contact Surfaces

Rinse Method:

Prepare a sanitizing solution of approximately 600 ppm available chlorine by weight. Clean the surfaces in a normal manner. Prior to use, rinse all surfaces thoroughly with the sanitizing solution, maintaining contact with the sanitizer for at least 2 minutes. Do not rinse equipment after treatment. Do not soak equipment overnight.

BEST AVAILABLE COPY

Prepare a sanitizing solution of approximately 600 ppm available chlorine by weight. Clean the equipment in a normal manner. Prior to use, immerse the equipment in the sanitizing solution for at least 2 minutes and allow the sanitizer to drain. Do not rinse equipment after treatment.

Spray/Fog Method:

After cleaning, sanitize non-food contact surfaces with a solution containing 600 ppm available chlorine. Use spray or fogging equipment which resist hypochlorite solutions. Prior to using the equipment, thoroughly spray or fog all surfaces until wet, allowing the excess sanitizer solution to drain. Vacate area for at least 2 hours.

Disinfecting Nonporous Non-Food Contact Surfaces

Rinse Method:

Prepare a disinfecting solution of approximately 600 ppm available chlorine by weight. Clean equipment surfaces in a normal manner. Immediately, prior to use, rinse all surfaces thoroughly with the disinfecting solution, maintaining contact with the solution for at least 10 minutes. Do not rinse after treatment. Do not soak equipment overnight.

Immersion Method:

Prepare a disinfecting solution of approximately 600 ppm available chlorine by weight. Clean the equipment in a normal manner. Immediately, prior to use, immerse the equipment in the disinfecting solution for at least 10 minutes and allow the sanitizer solution to drain. Do not rinse the equipment after treatment.

**Sanitization
General Disinfection**

Calcium hypochlorite solutions of 1000 ppm available chlorine will sanitize floors, walls, and ceilings, and control odors in refrigerated areas and on drain platforms.

Flush or swab surfaces thoroughly with the solution. Let stand 2 minutes, hose or rinse all metal surfaces with potable water.

ACCEPTED
with COMMENTS
in EPA Letter Dated:
18 MAR 1994
Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.
748-295

Controlling Mold or Mildew

Calcium hypochlorite solutions containing 5000 ppm available chlorine will destroy mold and non-residual mildew that grow in storage rooms and other areas. all precleaned

Brush or spray walls, floors, ceilings, and shelves with the solution. Rinse all metal surfaces immediately to prevent corrosion.

Bathrooms

Calcium hypochlorite solutions containing 5000 ppm available chlorine will sanitize and deodorize toilets, shower rooms, urinals, drains, and other bathroom facilities.

Toilets, shower rooms, urinals, and drains should be cleaned and sprayed or flushed with the calcium hypochlorite solution on a regular basis. After treatment, let stand 10 minutes and rinse exposed metal surfaces with potable water to prevent corrosion.

For toilet bowls, add 1 tablespoon of dry calcium hypochlorite to the residual water and swab.

Sanitizing Dialysis Machines

Flush dialysis equipment thoroughly with water prior to sanitizing. Thoroughly dissolve 7 oz. of this product in 60 gallons of water to obtain at least a 600 ppm available chlorine solution. Use this solution in the hemodialysate system immediately allowing a minimum contact time of 15 minutes at 20 degrees C. Thereafter, drain the system of the sanitizing solution and thoroughly rinse with potable water. Discard and do not reuse the spent sanitizer. Rinsate must be monitored with a suitable test kit to insure that no available chlorine remains in the system.

Clean surfaces before treatment.



365

Calcium hypochlorite solutions are recommended for decontaminating single and multipatient hemodialysate systems. Calcium hypochlorite has been shown to be an effective disinfectant (virucide, fungicide, bactericide, pseudomonicide) when tested by AOAC and EPA test methods. Calcium hypochlorite may not totally eliminate all vegetative microorganisms in hemodialysate delivery systems due to their construction and/or assembly, but can be relied upon to reduce the number of microorganisms to acceptable levels when used as directed. This product should be used in a disinfectant program which includes bacteriological monitoring of the hemodialysate delivery system. Calcium hypochlorite is not recommended for use in hemodialysate or reverse osmosis (RO) membranes.

Consult the guidelines for hemodialysate systems which are available from the Hepatitis Laboratories, CDC, Phoenix, AZ 85021.

Asphalt or Wood Roofs and Sidings

To control fungus and mildew, first remove all physical soil by brushing and hosing with clean water. Then apply a 5000 ppm available chlorine solution. Mix 1 oz. of this product per gallon of water and brush or spray roof or siding. After 30 minutes standing time, rinse by hosing with clean water.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No. 748-295

BEST AVAILABLE COPY

Job No. 89850
Client: Geyer Printing
Description: PPG-Calcium Hypochlorite
Dck: C-5426
File: "PPG-5"
Type: CAR
Date: October 14, 1991

WATER SANITATION AND SEWAGE TREATMENT:

WATER SYSTEMS, General

Chlorination is the recognized and accepted method of treating water supplies throughout the world. Whether chlorination is achieved by a continuous feeding of gaseous chlorine into water or by the regular addition of granular calcium hypochlorite, the chlorinating, sanitizing action is the same. When added to water, both gaseous chlorine and granular calcium hypochlorite form hypochlorous acid. Hypochlorous acid thoroughly destroys microorganisms by penetrating their cell walls and attacking the exposed internal structure.

The concentration of hypochlorous acid in water — expressed as "percent available chlorine" — determines its germicidal strength.

"Chlorine demand" is the amount of chlorine required to destroy bacteria and other organic matter presently existing in water. The available chlorine remaining after "chlorine demand" is satisfied is referred to as "Free Residual Chlorine". Free residual chlorine provides protection against new contamination. The amount of free residual chlorine present in a quantity of water is usually expressed in "parts per million (ppm)" of free, available chlorine.

Regular and accurate testing of water supplies to determine the amount of free residual chlorine is extremely important. It should be carried out on a continuing, systematic basis as this is the only way to accurately determine the free residual chlorine and, therefore, the purity and acceptability of the water.

Although calcium hypochlorite serves municipalities and commercial users in many ways, its most important function is in water sanitation. In large cities with proportionately large water consumption requirements, chlorination is most often achieved through a continuous-feed gaseous chlorine system. In smaller communities where water consumption requirements do not justify the need for gaseous chlorine equipment, granular calcium hypochlorite is most often used —

To treat surface water supplies
Such as reservoirs, to destroy bacteria and algae, and to correct algae problems associated with water works equipment and filters.

To sanitize wells
Calcium hypochlorite may be used to sanitize wells initially and provide continuous treatment.

To sanitize new mains and equipment
All new water mains as well as new processing and distribution equipment for drinking water should be thoroughly sanitized with intensive treatments of calcium hypochlorite before use.

As emergency water supply treatment
Calcium hypochlorite is always ready to supply quick, effective chlorination of new or supplementary water supplies when fire, flood, drought or other emergencies disrupt or contaminate regular sources.

To treat sewage effluent
The use of calcium hypochlorite in conjunction with other environmentally sound practices to maintain clean rivers and streams has grown with our ecological awareness. Today, it is widely used to reduce Biological Oxygen Demand, control odors, treat effluent and aid in sewage coagulation.

Approved
with COC
in EPA Letter
1 8 MAR 1994
Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended and registered under Reg. No.
748-295

BEST AVAILABLE COPY

38 of 48

All water intended for human consumption should be chlorinated. Although calcium hypochlorite can be used at any stage in the water purification process, turbid water should be clarified first.

Large water systems using continuously fed gaseous chlorine, as well as smaller systems which use granular calcium hypochlorite as their primary treatment, often also stock calcium hypochlorite for special purposes, such as destroying sudden algae growth, treatment of mains, conditioning of filters and for emergency chlorination.

It is important to remember that any water supply, large or small, can be contaminated by seepage or carelessness and treatment must take place immediately upon its discovery.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No. 748-295

RESERVOIRS

Bacteria control

Contamination of reservoirs is an ever-present possibility. Most frequently, it is caused by careless persons or seepage from ground contamination. In order to keep reservoir water bacteriologically acceptable, it is necessary to test regularly and chlorinate sufficiently to maintain a residual of 0.2 ppm free available chlorine. This is equivalent to 1.2 ounce of calcium hypochlorite per 30,000 gallons of water after chlorine demand has been satisfied.

Where contamination is caused by overflowing streams, establish hypochlorinating stations upstream of the reservoir. Chlorinate the inlet water until the entire reservoir attains a 0.2 ppm available chlorine residual as determined by a chlorine test kit. Where contamination is from surface drainage, apply sufficient calcium hypochlorite directly to the reservoir to attain a 0.2 ppm available chlorine residual in all parts of the reservoir.

Daily testing should be accomplished away from the water inlet. If samples must be taken near the inlet, allow them to stand at least 20 minutes before testing. Also, remember that chlorine demand will be higher during periods of heavy rainfall and extreme dryness or heat.

Continuous feeding of calcium hypochlorite at the input source is usually the most effective means of maintaining an adequate chlorine residual.

When applying granular calcium hypochlorite to surface water, take care to reach all parts of the reservoir with equal amounts of the product so that distribution is complete and equal throughout.

Algae control

Rapid algae growth in reservoirs is an indication of increased chlorine demand. When algae become a problem, special action is necessary. There are several methods of treatment. One of these is to hypochlorinate streams feeding the reservoir. Suitable feeding points should be selected on each stream at least 50 yards upstream from the point of entry into the reservoir.

Continuous chlorination is usually effective in destroying algae where a sufficient amount of sanitizer is fed to produce a chlorine residual of 0.2 to 0.5 ppm free available chlorine. Where continuous feeding is not possible, scheduled, intermittent feeding should be practiced. In doing so, broadcast calcium hypochlorite over the surface of the reservoir evenly, taking special care to treat shallows and edges. As it descends, the product dissolves, distributing a chlorinating action to all depths.

Introduce a sufficient amount of calcium hypochlorite to provide a residual of from 0.2 to 1.5 ppm for up to 24 hours.

BEST AVAILABLE COPY

39 of 48

WATER MAINS

New and Newly Cleaned Reservoirs

New or recently cleaned reservoirs must be completely disinfected with calcium hypochlorite before use. Spray all parts and surfaces with a 0.5% — 5000 ppm solution. (1 ounce calcium hypochlorite to 1 gallon of water.) When the reservoir is filled, chlorinate as described above. Note: As a safety precaution, do not store calcium hypochlorite solution. When mixed, use immediately.

Newly installed water mains or those which have been repaired must be disinfected before being put into service as they are contaminated by construction conditions. Completely flush the section to be sanitized. Allow a water flow of 2.5 feet or more per second to continue under pressure while introducing a 1% available chlorine solution with a hypochlorinator. Continue injecting this solution until a 50 ppm free available chlorine reading is obtained at the distant end of the new section after a 24-hour retention period. Afterward, flush the heavily chlorinated water free of the system. (Refer to page 00 for preparation of the 1% solution.)

Forty-eight hours after the initial treatment, test the water supply again for bacteria and chemicals. If results are unsatisfactory, maintain a 0.4 ppm free chlorine residual in the main until test samples are acceptable for two successive days.

Note: Keep out trench water and other contaminants from new mains by capping the pipe ends before lowering them into place.

WELLS

Municipal authorities often help the residents of rural areas, particularly dairy farmers, safeguard their water supplies as any disease originating there could easily spread throughout the community.

Since the contamination of well water, even from deep wells, is always possible, it too should be chlorinated. The most effective method of doing so is to feed calcium hypochlorite into the intake line of the pump. This also helps keep the filter free of slime. Automatic hypochlorization equipment for this purpose is readily available and easy to use.

If it is not possible to locate a feed at the intake line, feed calcium hypochlorite anywhere in the pump discharge line. Feed sufficient calcium hypochlorite to produce a free chlorine residual of at least 0.2 ppm and no more than 0.6 ppm after a 20-minute contact period.

Regular testing is necessary and a record of test readings should be kept.

New wells must be treated.

ACCEPTED
with COMMENTS
in EPA Letter Docket

18 MAR 1994

(Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for pesticides
registered under EPA Reg. No.
748-295

BEST AVAILABLE COPY

22

Job No. 00850

Client: Geyer Printing

Description: PPG Calcium Hypochlorite

Disk: C-3426

File: "PPG-A"

Type: CAP

Date: October 14, 1991

Customer Corrections: 12-16-91

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1991

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

Public wells

Before using, flush the casing with a 50 ppm available chlorine solution (1 ounce of calcium hypochlorite for each 100 gallons of water). The solution should be pumped or fed by gravity into the well and thoroughly mixed and agitated. The well should stand overnight or for twelve hours under chlorination. It may then be pumped until bacterial examination of a representative raw water sample will indicate whether further treatment is necessary.

After the initial treatment, begin feeding a 1% available chlorine solution of this product with a hypochlorinator, as directed above, until a free available chlorine residual of at least 0.2 ppm and no more than 0.6 ppm is attained throughout the distribution system. Check the water frequently with a chlorine test kit. Bacteriological sampling must be conducted at a frequency no less than that prescribed by the National Interim Primary Drinking Water Regulations. Contact your local Health Department for further details.

Private Wells

Dug Wells — Upon completion of the casing (lining), wash the interior of the casing (lining) with a 100 ppm available chlorine solution using a stiff brush. This solution can be made by thoroughly mixing 1 ounce of this product into 50 gallons of water. After covering the well, pour the sanitizing solution into the well through both the pipe-sleeve opening and the pipeline. Also, wash the exterior of the pump cylinder with the sanitizing solution. Start the pump and pump water until a strong odor of chlorine in the water is noted. At this point, stop the pump and allow it to stand at least 24 hours. After 24 hours, flush well until all traces of chlorine have been removed from the water. Contact your local Health Department for further details.

Drilled, Driven, and Bored Wells — Run the pump until the water is as free from turbidity as possible. Pour a 100 ppm available chlorine sanitizing solution into the well. This solution can be made by thoroughly mixing 1 ounce of this product into 50 gallons of water. Add 5 to 10 gallons of clean, chlorinated water to the well to force the sanitizer into the rock formation. Wash the exterior of the pump cylinder with the sanitizer. Drop the pipeline into the well, start the pump and pump water until a strong odor of chlorine in the water is noted. At this point, stop the pump and wait at least 24 hours. After 24 hours, flush well until all traces of chlorine have been removed from the water. Deep wells with high water levels may necessitate the use of special methods for introduction of the sanitizer into the well. Consult your local Health Department for further details.

BEST AVAILABLE COPY

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

PRIVATE STORAGE TANKS

After the initial treatment feed calcium hypochlorite into the intake line of the well pump. This also helps keep any filters free of slime. Automatic hypochlorization equipment for this purpose is readily available and easy to use.

If it is not possible to locate a feed at the intake line, feed calcium hypochlorite anywhere in the well pump discharge line. Feed sufficient calcium hypochlorite to produce a free chlorine residual of at least 0.2 ppm and no more than 0.6 ppm after a 20-minute contact period.

Regular testing is necessary and a record of test readings should be kept.

Flowing Artesian Wells — Artesian wells generally do not require disinfection. If analyses indicate persistent contamination, the well should be disinfected. Consult your local Health Department for further details.

After the initial treatment, follow the practice of maintaining a free chlorine residual of 0.2 ppm to 0.6 ppm in the water outlets after a minimum 20 minute contact period as directed previously.

Bacteria control

Contamination of tanks is an ever-present possibility. In order to keep potable tank water bacteriologically acceptable, it is necessary to test regularly and chlorinate sufficiently to maintain a residual of 0.2 ppm free available chlorine. This is equivalent to 0.2 ounce of calcium hypochlorite per 5,000 gallons of water after chlorine demand has been satisfied.

Where contamination is caused by water supply sources, establish hypochlorinating stations upstream of the tank. Chlorinate the inlet water until the entire tank attains a 0.2 ppm available chlorine residual as determined by a chlorine test kit.

Daily testing should be accomplished away from the water inlet. If samples must be taken near the inlet, allow them to stand at least 20 minutes before testing. Also, remember that chlorine demand may be higher during periods of heavy rainfall and extreme dryness or heat.

Continuous feeding of calcium hypochlorite at the input source is usually the most effective means of maintaining an adequate chlorine residual.

When applying granular calcium hypochlorite to the water surface in the tank, take care to reach all parts of the reservoir with equal amounts of the product so that distribution is complete and equal throughout.

BEST AVAILABLE COPY

TREATMENT PLANTS

Granular calcium hypochlorite may be used as a sanitizer in water treatment plants when the system is too small to require gas chlorination equipment or to supplement well or reservoir chlorination.

Treatment plants also rely on granular calcium hypochlorite to aid in algae control. As algae may be the source of many objectionable odors, cause mud balls and slime in filters, pipes and pumps, as well as reduce pipeline capacity, its control through chlorination is an important factor.

The presence of algae is often indicated by a slimy, gelatinous film on the inside of pumps, lines, and mixers, etc. It may be eliminated by adding a sufficient quantity of calcium hypochlorite to the forebay or pump well to obtain a 5.0 to 10.0 ppm residual chlorine reading after 20 minutes contact time.

The dosage necessary to provide this reading will vary with conditions, i.e.-hot weather will increase the need for treatment. It should be controlled by actual test.

New tanks, basins, etc.

Remove all physical soil from the surfaces. Introduce 4 ounces of calcium hypochlorite for each 5 cubic feet of working capacity (500 ppm available chlorine). Fill to working capacity and allow the solution to stand for at least 4 hours. Drain and flush with potable water and return to service.

New filter sand

Apply 16 ounces of calcium hypochlorite for each 150 to 200 cubic feet of sand. The action of the product dissolving as the water passes through the bed will aid in sanitizing the new sand.

Existing equipment

Remove the equipment from service and thoroughly clean all physical soil from surfaces. Sanitize by introducing 4 ounces of this product for each 5 cubic feet of capacity (approximately 500 ppm available chlorine). Fill to working capacity and let the solution stand at least 4 hours. Drain and place in service. If the previous treatment is not practical, surfaces may be sprayed with a solution containing 1 ounce of this product for each 5 gallons of water (approximately 1000 ppm available chlorine). After drying, flush with water and return to service.

Cooling tower and heat exchange surface

A clogged or fouled system should be mechanically cleaned to remove all physical soil prior to beginning treatment. Initially, treat by adding enough calcium hypochlorite to provide 10 ppm available chlorine (2 ounces per 1000 gallons) as a shock dosage and circulate it thoroughly through the system.

Then, for continuous preventive control of algae and slime growth, regularly add enough calcium hypochlorite to the recirculation system to maintain a 1.0 ppm free chlorine residual.

Other water condition factors, such as pH, should be controlled as recommended by the equipment manufacturer.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

25

BEST AVAILABLE COPY

EMERGENCY DISINFECTION

Emergency Uses

Acts of nature or the failure of man-made equipment may jeopardize a community's water supply at any time. Flood waters may contaminate reservoirs and wells; drought may dry up water supplies; fire or power failures may interrupt the operation of pumping or purification facilities; mains may break; and unknown sources can pollute water. All of these emergencies demand prompt action by responsible authorities. Many communities keep standby supplies of calcium hypochlorite ready to meet such problems. It can be stored in closed containers for reasonably long periods without appreciable loss of its effectiveness. When needed, calcium hypochlorite solutions can be quickly prepared to meet many requirements and may be applied to water with feeders or added manually.

During emergencies, calcium hypochlorite may be used to chlorinate water supplies which have been contaminated, or to purify new sources of water quickly and dependably.

Wells

Thoroughly flush the contaminated casing with a 500 ppm available chlorine solution. (Mix 1 ounce of the product with 10 gallons of water.) Backwash the well to increase yield and reduce turbidity, adding sufficient chlorinating solution to the backwash to produce a 10 ppm available chlorine residual, as determined by a chlorine test kit. After the turbidity has been reduced and the casing has been treated, add sufficient chlorinating solution to produce a 50 ppm available chlorine residual. Agitate the well water for several hours and take a representative water sample. Re-treat the well if water samples are biologically unacceptable.

Basins, tanks, flumes, etc.

Thoroughly clean all equipment, then apply 4 ounces of calcium hypochlorite per 5 cubic feet of water to obtain 500 ppm available chlorine, as determined by a suitable test kit. After 24 hours, drain, flush, and return to service. If the previous method is not suitable, spray or flush the equipment with a solution containing 1 ounce of this product for each 5 gallons of water (1000 ppm available chlorine). Allow to stand 2 to 4 hours, flush and return to service.

Filters

When sand filters need replacement, apply 16 ounces of calcium hypochlorite for each 150 to 200 cubic feet of sand. Where the filter is severely contaminated, additional calcium hypochlorite should be distributed over the surface at the rate of 16 ounces per 20 square feet. Water should stand at a depth of 1 foot above the surface of the filter bed for 4 to 24 hours. Where filter beds can be backwashed of mud and silt, apply 16 ounces of calcium hypochlorite per each 50 square feet, allowing the water to stand at a depth of 1 foot above the filter sand. After 30 minutes, drain the water to the level of the filter. After 4 to 6 hours, drain and proceed with normal backwashing.

Distribution System

Flush the repaired or replaced section with water. Establish a hypochlorinating station and apply sufficient product until a consistent available chlorine residual of at least 10 ppm remains after a 24-hour retention time. Use a chlorine test kit.

Cross connections or emergency connections

Hypochlorination or gravity feed equipment should be set up near the intake of the untreated water supply. Apply sufficient product to give a chlorine residual of at least 0.1 to 0.2 ppm at the point where the untreated supply enters the regular distribution system. Use a chlorine test kit.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act
amended for the pesticides
registered under EPA Reg. No.

748-295

26

43948

BEST AVAILABLE COPY

44-48

Supplementary water supplies

Gravity or mechanical hypochlorite feeders should be set up on a supplementary line to dose the water to a minimum chlorine residual of 0.2 ppm after a 20-minute contact time. Use a chlorine test kit.

Water shipped in by tanks, tank cars, trucks, etc.

Thoroughly clean all containers and equipment. Spray with a 500 ppm available chlorine solution and rinse with potable water after letting stand 5 minutes. This solution is made by mixing 1 ounce of calcium hypochlorite for each 5 gallons of water. During the filling of the containers, dose with sufficient amounts of this product to provide at least a 0.2 ppm chlorine residual. Use a chlorine test kit.

Individual Water Supplies

Where boiling of water for 1 minute is not practical, water can be made potable by using calcium hypochlorite. Prior to addition of the sanitizer, remove all suspended material by filtration or by allowing it to settle to the bottom. Decant the clarified, contaminated water to a clean container and add 1 grain of calcium hypochlorite to 1 gallon of water. One grain is approximately the size of the letter "O" in this sentence. Allow the treated water to stand for 30 minutes. Properly treated water should have a slight chlorine odor, if not, repeat dosage and allow the water to stand an additional 15 minutes. The treated water can then be made palatable by pouring it between clean containers several times.

ACCEPTED
with COMMENTS
in EPA Letter Docket

1 8 MAR 1994

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under FPA Reg. No.

748-245

SEWAGE TREATMENT

B.O.D. reduction

B.O.D., or Biochemical Oxygen Demand, is the quantity of oxygen required to oxidize the polluting substance to a biochemically inert material. As little as 1 part per million of chlorine may bring about a reduction of 2 to 3 ppm in B.O.D. Calcium hypochlorite for this purpose may be added at virtually any point in the system.

To achieve maximum results in terms of desirable aerobic action and retardation of anaerobic decomposition, hypochlorination should be complete. The treatment will still be of value, however, even if the amount of calcium hypochlorite applied is less than the total amount which could be utilized.

Odor control

The most offensive odor encountered in sewage treatment is due to hydrogen sulfide. It is caused by the sulphate-splitting bacteria normally present in sewage.

Hydrogen sulfide can be very effectively controlled by calcium hypochlorite hypochlorination of the fresh sewage, which destroys the sulfide-producing bacteria. If the treatment of fresh sewage is not practical, calcium hypochlorite may be added at any point where the odors become objectionable. The amount required will, however, be increased, as the available chlorine in calcium hypochlorite will react not only with hydrogen sulfide, but also with other bacteria and organic material.

For a sulfide reduction of 1 ppm, from 8 to 10 ppm of available chlorine probably will be required.

27

BEST AVAILABLE COPY

Job No. 99030

Client: Geyer Printing

Description: PPG Calcium Hypochlorite

Disk: G-5426

File: "PPG 2"

Type: OAP

Date: October 14, 1991

Customer Corrections: 12-16-91

45048

ASSIGNED
with COMMENTS
in EPA Letter Docket

18 MAR 1991

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended for the purpose of registering under F.F.D. No. 245

748-295

Disinfection of sewage and wastewater effluent

Although every effort is usually made to locate treatment plants where effluent will not be the cause of problems, safe practice dictates that it should be treated to destroy harmful bacteria. Calcium hypochlorite has proven to be an effective and dependable means of destroying harmful bacteria in effluent. The amount required depends on the type of sewage to be treated. Raw sewage may require as much as 30 ppm available chlorine, while secondary treated sewage may need as little as 3 ppm.

The disinfection of sewage effluent must be evaluated by determining the total number of coliform bacterial and/or fecal coliform bacteria, as determined by the Most Probable Number (MPN) procedure, of the chlorinated effluent. This must be reduced to or below the maximum permitted by the controlling regulatory jurisdiction.

On the average, satisfactory disinfection of secondary wastewater effluent can be obtained when the chlorine residual is 0.5 ppm after 15 minutes contact. Although chlorine residual is the critical factor in disinfection, the importance of correlating chlorine residual with bacterial kill must be emphasized. The MPN of the effluent, which is directly related to the water quality standards requirements, should be the final and primary standard and the chlorine residual should be considered an operating standard valid only to the extent verified by the coliform quality of the effluent.

28

Following are critical factors affecting wastewater disinfection:

1. **Mixing:** It is imperative that the product and the wastewater be instantaneously and completely flash mixed to assure reaction with every chemically active soluble and particulate component of the wastewater.
2. **Contacting:** Upon flash mixing, the flow through the system must be maintained.
3. **Dosage/Residual Control:** Successful disinfection is extremely dependent upon response to fluctuating chlorine demand to maintain a predetermined, desirable chlorine level. Secondary effluent should contain 0.2 to 1.0 ppm chlorine residual after a 15-to-20 minute contact time. A reasonable average of residual chlorine is 0.5 ppm after 15 minutes contact time.

Effluent slime control

Apply a 100 to 1000 ppm available chlorine solution at a location which will allow complete mixing. Prepare this solution by mixing 2 to 20 ounces of calcium hypochlorite with 100 gallons of water. Once control is evident, apply a 15 ppm available chlorine solution. Prepare this solution by mixing 0.3 ounce of the product with 100 gallons of water.

Filter beds — slime control

Remove the filter from service, drain it to a depth of 1 foot above the filter sand, and add 16 ounces of calcium hypochlorite per 20 square feet evenly over the surface. Wait 30 minutes before draining water to a level that is even with the top of the filter. Wait for 4 to 6 hours before completely draining and backwashing the filter.

BEST AVAILABLE COPY

Aid in coagulation

The value of calcium hypochlorite's available chlorine as an aid in coagulation is due primarily to its oxidizing power — a property which is of particular value in sewage treatment because there is almost no oxygen in sewage.

Hypochlorination with calcium hypochlorite is particularly helpful when iron salts are used as the primary coagulant. Ferric iron, in the absence of oxygen, tends to revert to ferrous iron, which is of little value as a precipitant. Calcium hypochlorite supplies sufficient oxygen to retard or prevent this change. It should be used just before the primary coagulant in a proportion of 3 to 5 ppm.

SWIMMING POOLS

Pool water chlorination

Calcium hypochlorite provides a simple, effective method of treatment for chlorinating swimming pool water. Its use is especially suited to indoor pools. For best results, it is introduced in controlled quantities into the recirculated water. Automatic feed equipment for this purpose is readily available.

Pool accessory equipment

The possibility for the spread of infectious diseases is heightened wherever bathers gather. To provide proper and effective preventive care, calcium hypochlorite should be used to inexpensively destroy harmful bacteria on swimming pool premises and equipment, including shower rooms, floors and walkways, restroom facilities, diving boards, ladders, etc.

Note: As this product is toxic to fish and other aquatic life, treated water should not be discharged where it will drain into streams, rivers, lakes, or public waters.

ADD



ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, for the pesticide
registered under EPA Reg. No.

748-295

BEST AVAILABLE COPY

PREPARING CALCIUM HYPOCHLORITE SOLUTIONS

47948

Each of the applications described in this brochure requires a specific concentration of solution measured in parts per million (ppm) or percent available chlorine. To prepare the proper strength solution, follow these simple directions:

1. Use a clean, non-metallic container free of grease, oil, or residue.
2. Add granular calcium hypochlorite to lukewarm water.
3. Stir for three to five minutes.
4. Use immediately.

NOTE: As a safety precaution, prepare only the amount of solution needed. Never store a calcium hypochlorite solution.

SERVICE

The technical service staff of PPG Industries is available for consultation on handling, storage, and the use of calcium hypochlorite and on swimming pool care in general.

The statements and methods presented about the products mentioned herein are based upon the best available information and practices known to PPG Industries at the present time, but are not representations of performance, results, or comprehensiveness of such data.

The products mentioned herein, if not used properly, can be hazardous. PPG Industries recommends that anyone using and/or handling the products mentioned herein thoroughly read and understand the directions and precautionary information appearing on the product label before using the product.

The products mentioned herein, as all potentially hazardous materials, must be kept out of the reach of children.

CALCIUM HYPOCHLORITE MEASUREMENT EQUIVALENTS

Dry Weight	Household Measurement*
1/6 ounce	1 level teaspoon
1/2 ounce	1 level tablespoon
1 ounce	2 level tablespoons
8 ounces	16 level tablespoons (1 cup)

*These household measurement equivalents are only approximate values given for the user's convenience.

The following table indicates the amount of calcium hypochlorite needed to make various quantities of solution containing from 5 to 10,000 ppm available chlorine.

Available Chlorine (ppm*)	Weight of Calcium Hypochlorite Required to Make Solution							
	1 gallon		10 gallons		50 gallons		100 gallons	
	lbs.	oz.	lbs.	oz.	lbs.	oz.	lbs.	oz.
5	0	0.001	0	0.01	0	0.05	0	0.10
10	0	0.002	0	0.02	0	0.10	0	0.21
25	0	0.005	0	0.05	0	0.26	0	0.51
50	0	0.01	0	0.10	0	0.51	0	1.03
100	0	0.02	0	0.21	0	1.03	0	2.05
150	0	0.03	0	0.31	0	1.54	0	3.06
200	0	0.04	0	0.41	0	2.05	0	4.11
300	0	0.06	0	0.62	0	3.08	0	6.16
500	0	0.11	0	1.03	0	5.13	0	10.27
600	0	0.12	0	1.23	0	6.16	0	12.32
1000	0	0.21	0	2.05	0	10.26	1	4.53
2500 (.25%)	0	0.51	0	5.13	1	9.66	3	3.32
5000 (.5%)	0	1.03	0	10.26	3	3.32	6	6.65
10,000 (1%)	0	2.05	1	4.53	6	6.65	12	13.29

*Parts available chlorine per million parts of water.

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1974

Under the Federal Insecticide, Fungicide, and Rodenticide Act as amended, for the pesticide registered under EPA Reg. No.

748-295

30

BEST AVAILABLE COPY

480448

~~Job No.: 89850~~
~~Client: Geyer Printing~~
~~Description: PPG Calcium Hypochlorite~~
~~Disk: C-5426~~
~~File: "PPG-4"~~
~~Type: CAP~~
~~Date: October 14, 1991~~

~~500~~

~~Customer Corrections: TZ-76-91~~

Area Sales Offices in the U.S.

Central

Chicago, Illinois
3030 Warrerville Road
Suite 615
Lisle, IL 60532
(708) 505-1250

Eastern

Philadelphia (Haddonfield, New Jersey)
The Centennial Building
76 Euclid Avenue
Haddonfield, NJ 08033
(609) 428-7800

(SIA) Southwestern

Houston, Texas
530 Wells Fargo Drive
Suite 212
Houston, TX 77090
(713) 440-3770

Western

San Francisco, California
1350 Bayshore Highway
Suite 810
Burlingame, CA 94010
(415) 343-1876

ACCEPTED
with COMMENTS
in EPA Letter Dated:

18 MAR 1994

Under the Federal Insecticide,
Fungicide, and Rodenticide Act as
amended, the pesticide
registered under Reg. No.

748-295

International Sales Offices

PPG Industries-Far East Ltd.
Toranomon Mori Bldg., No. 40
13-1, Toranomon 5-chome
Minato-ku
Tokyo, 105, Japan
Telex: 2427129 PPG PAC J
Telephone: 03 (434) 1146

San Juan, Puerto Rico 00920
PPG Industries, Inc.
Urb. Industrial Mario Julia
Caparra Heights
Telex: ITT-3450234
Telephone: (809) 782-8080

Sao Paulo, Brazil 01310
Edificio Grande Avenida
Paulista Avenue 1754
Suite 153
Telex: (011) 39104 PPGBBR
Telephone: 11-284-0433

PPG Chemical Toll Free:
1 + 800 + CHEMPPG
1 + 800 + 243-6774

BEST AVAILABLE COPY

Pittclor®, Pittabs®, Inductor™ are Trademarks of PPG