


SEE NOTE 2 BELOW

A

SEE NOTE 2 BELOW

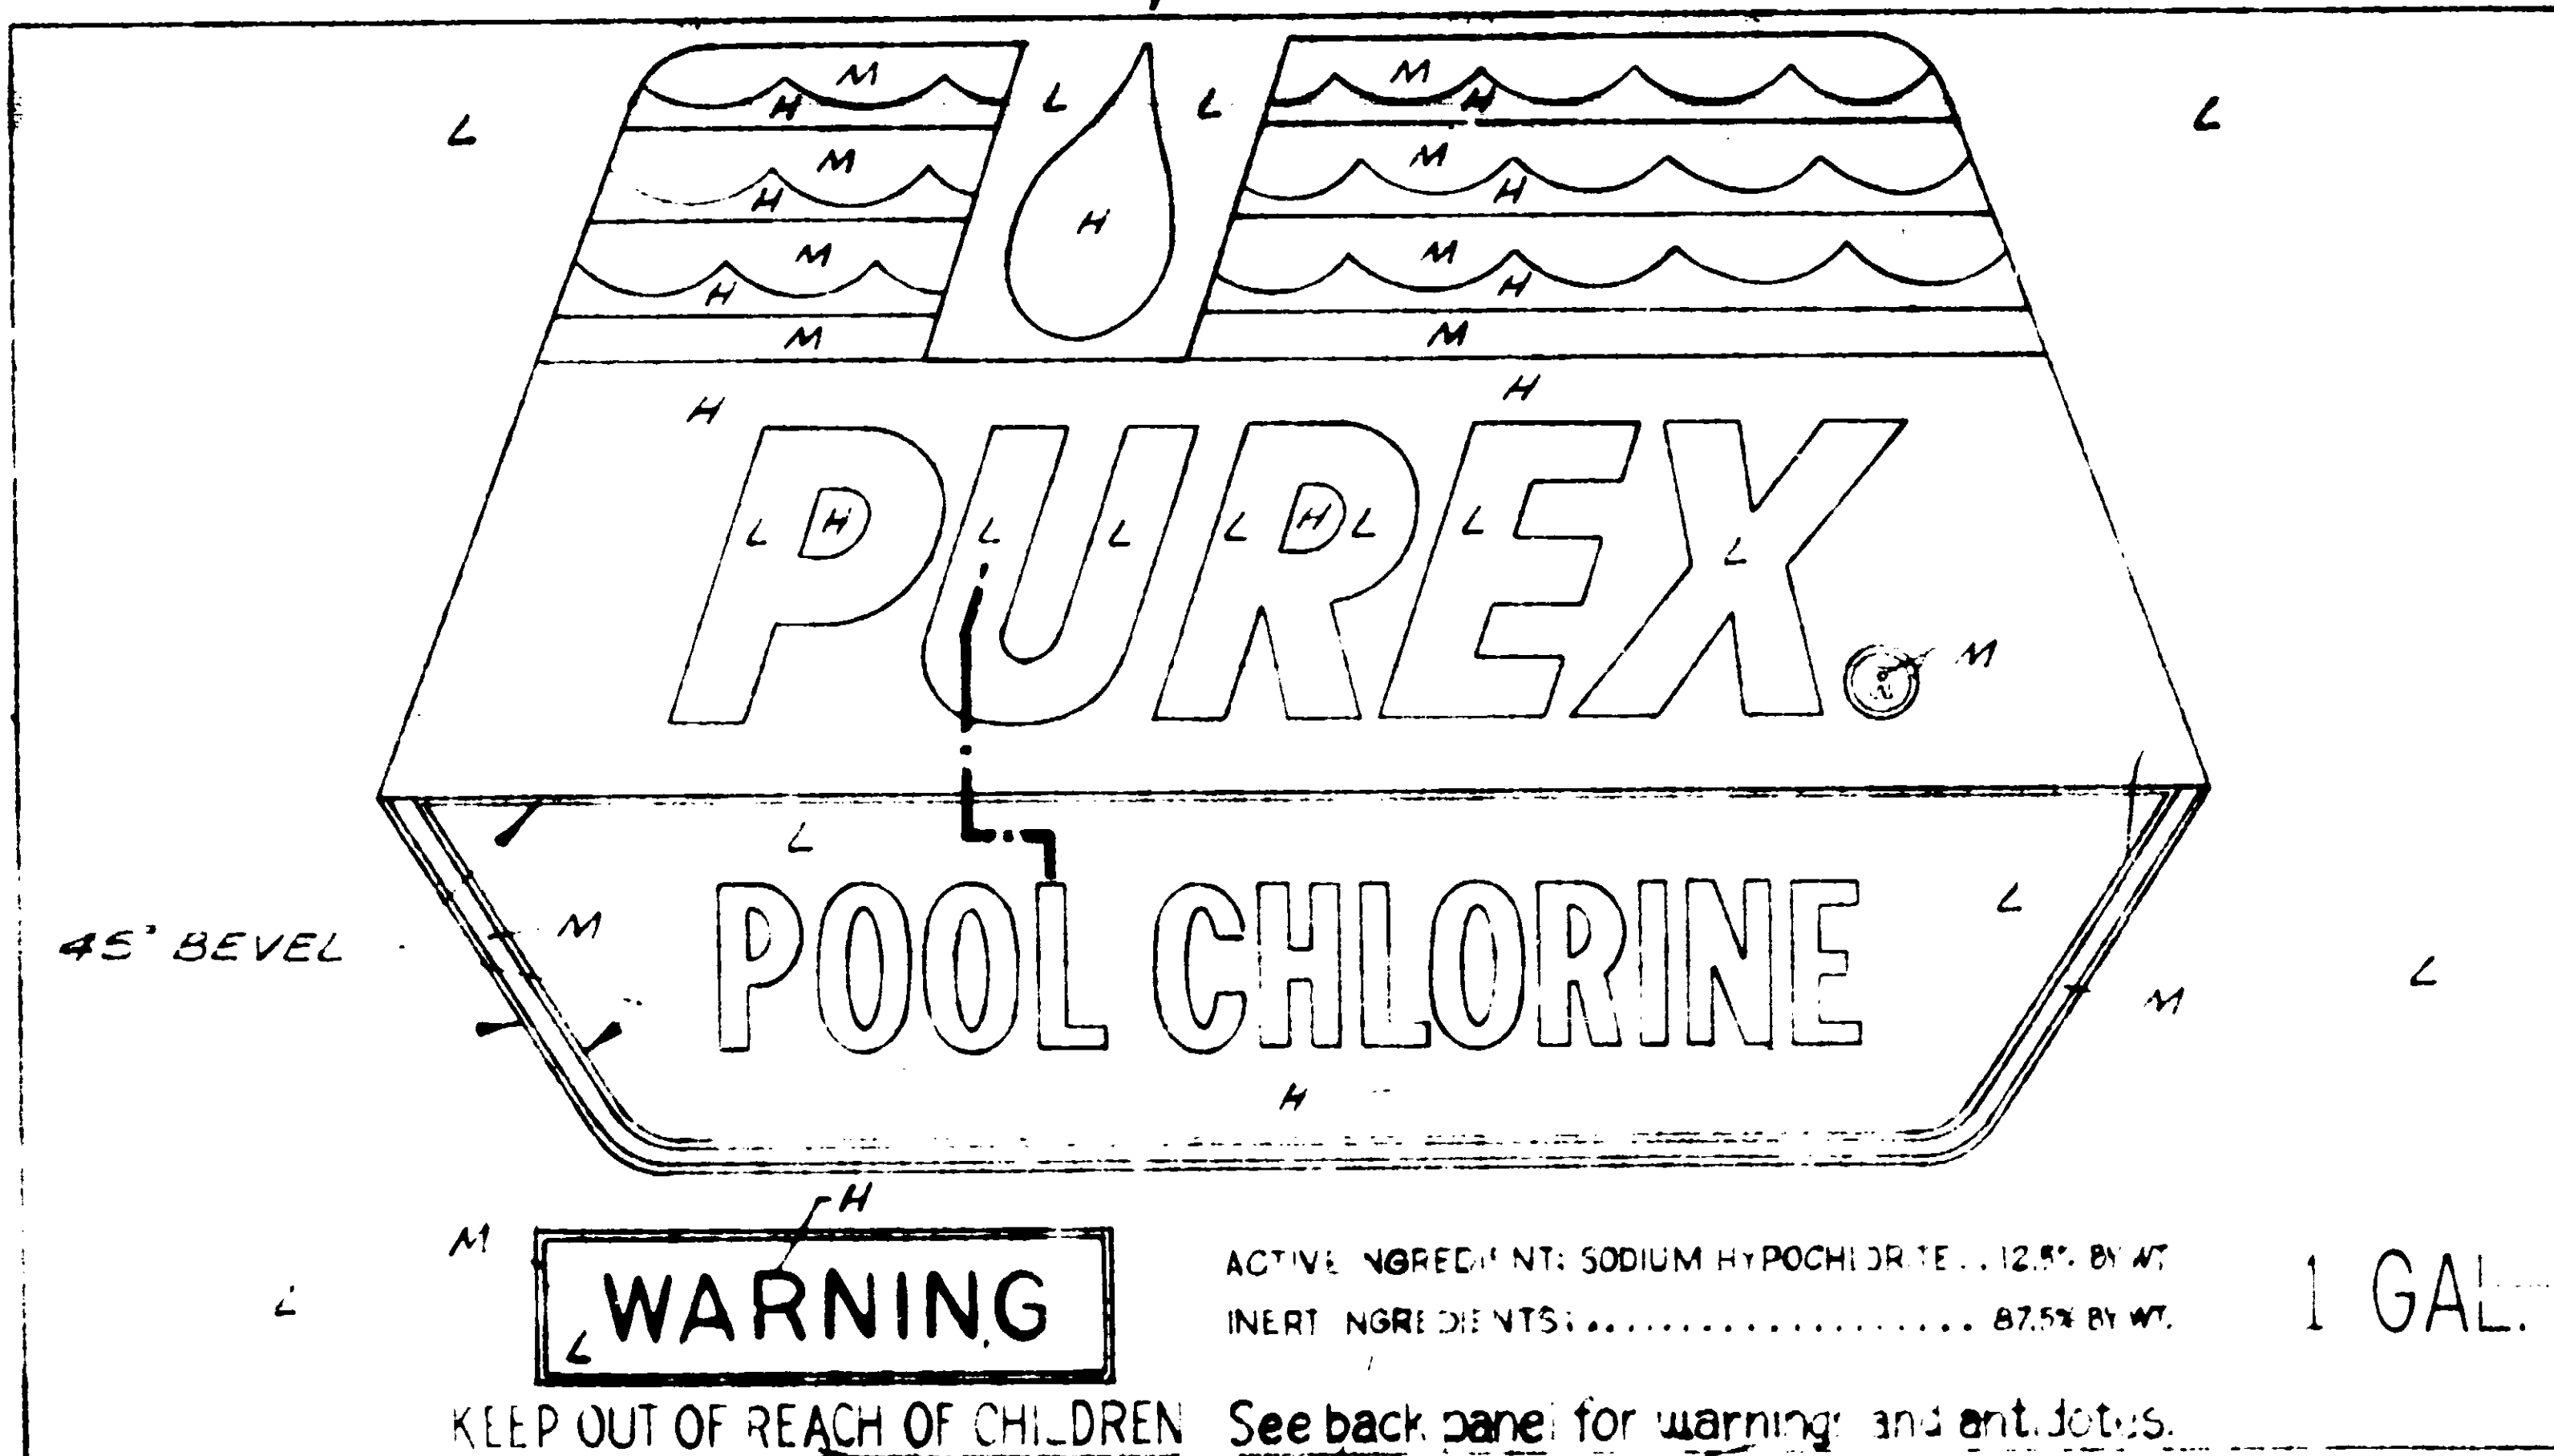

45° BEVEL

**WARNING**

KEEP OUT OF REACH OF CHILDREN


ACTIVE INGREDIENT: SODIUM HYPOCHLORITE... 12.5% BY WT.  
INERT INGREDIENTS: ..... 87.5% BY WT.

1 GAL.

See back panel for warnings and ant. dots.

SEE NOTE 2

45° BEVEL

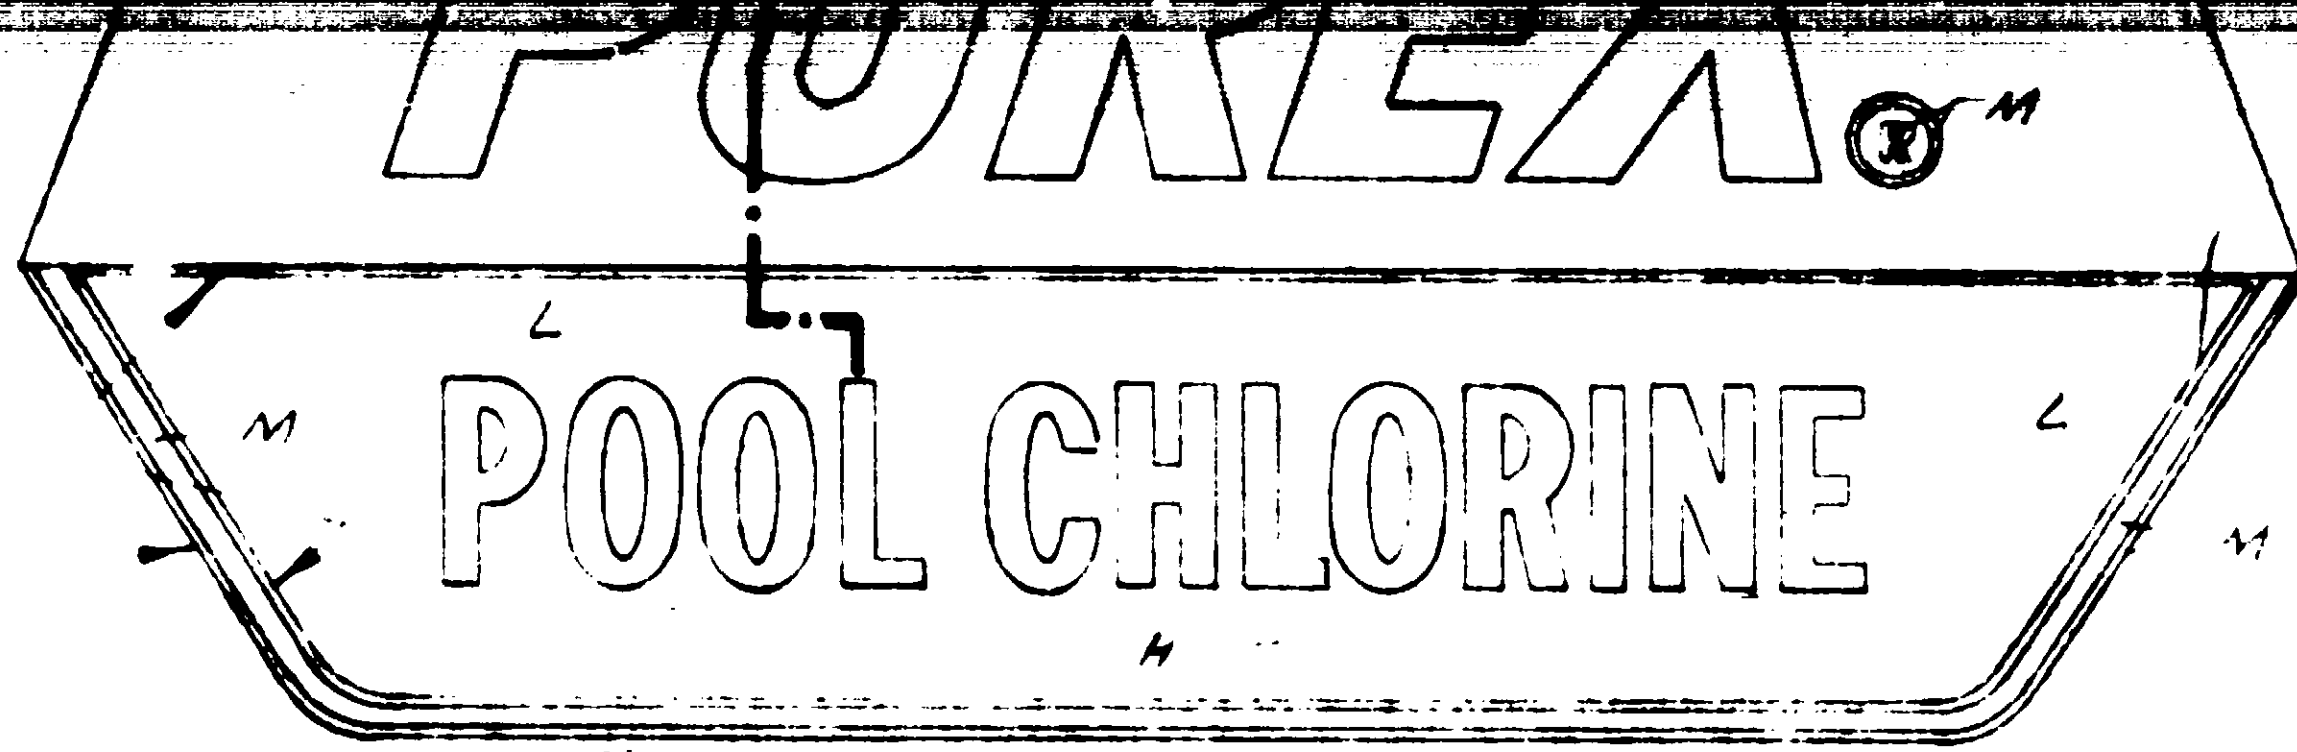

**WARNING**

ACTIVE INGREDIENT: SODIUM HYPOCHLORITE... 12.5% BY WT.  
INERT INGREDIENTS: ..... 87.5% BY WT.

1 GAL.

KEEP OUT OF REACH OF CHILDREN See back panel for warnings and antidotes.



1124-70  
**ACCEPTED**  
NOV 7 1973  
UNDER THE FEDERAL INSECTICIDE  
FUNGICIDE AND RODENTICIDE ACT  
FOR ECONOMIC POISON REGISTERED  
UNDER NO. 1124-70 SUBJECT  
TO ATTACHED COMMENTS.

NOTES:

- 1. - ENGRAVING TO BE REVERSED IN INSERT.
- 2. - REFER TO EXISTING MOLDS & INSERTS FOR LENGTH AND WIDTH FOR MAKING NEW INSERTS.

MATERIAL: MATCH EXISTING INSERTS.



REFERENCE DWG. 7-M045-3D (WAS SPM-939)


**PUREX** CORPORATION, LIMITED  
18400 E. MOHR AVENUE  
CITY OF INDUSTRY CALIF. 91749

UNLESS NOTED XX DE XXX D FRACT ANGLE

.265 THK.


REVISION LETTER	REVISION	DATE AND REVISED BY
C	REVISED & REDRAWN DWG NO. WAS 41-SPN 900	3-1-73 MENDOZA
D	REMOVED RECESSED AREA FOR POISON STICKER ADDED WARNING SIGNAL	J.A.T. 5-16-73

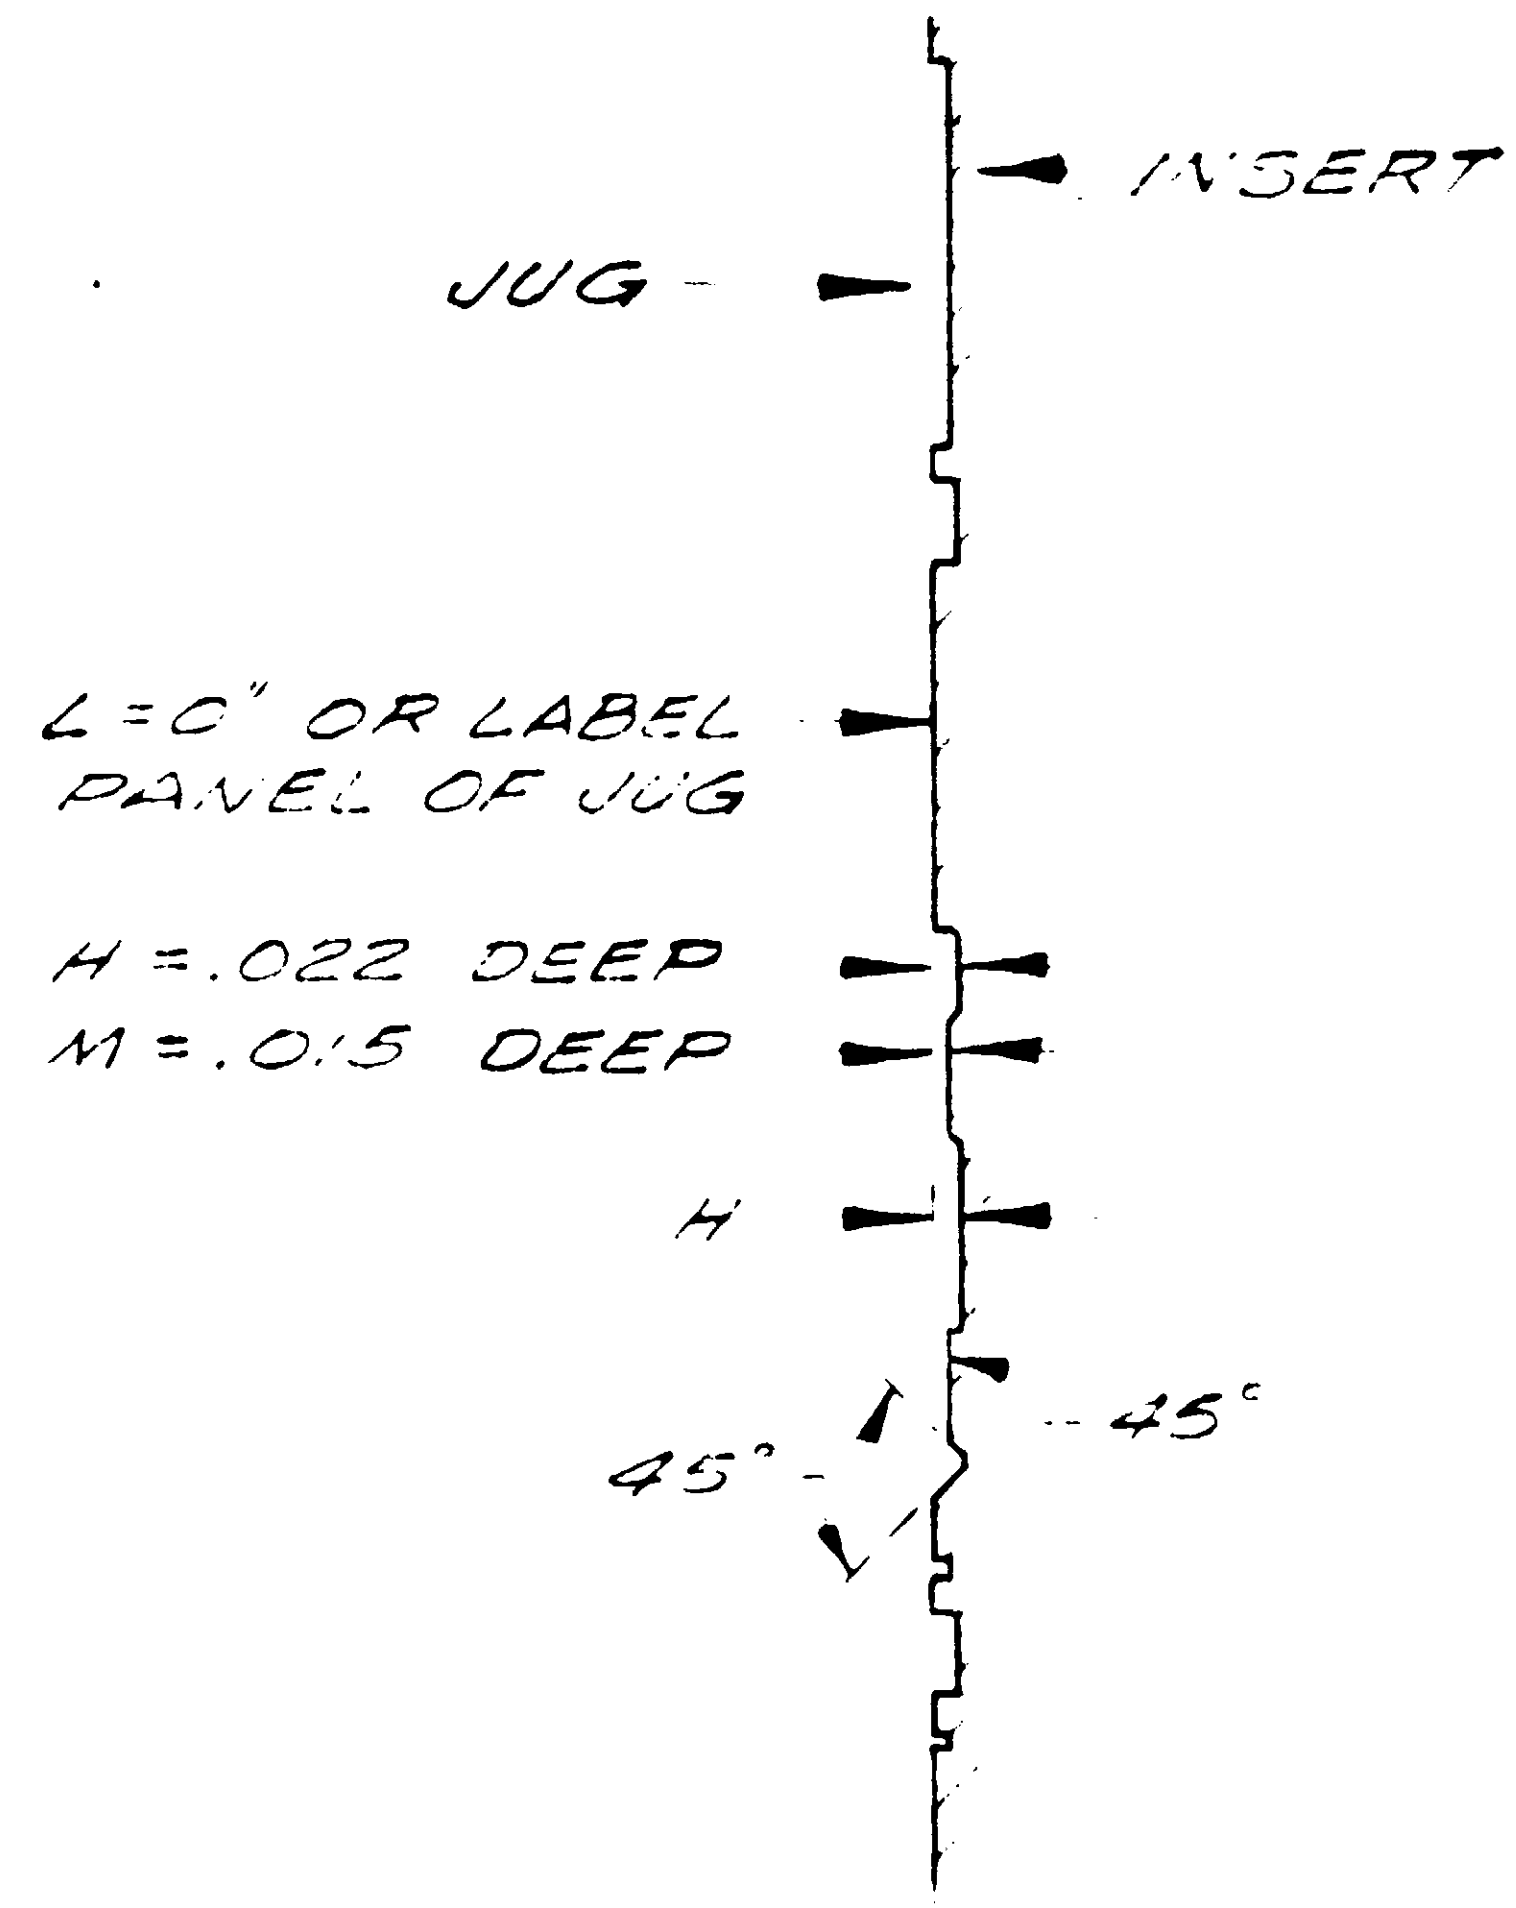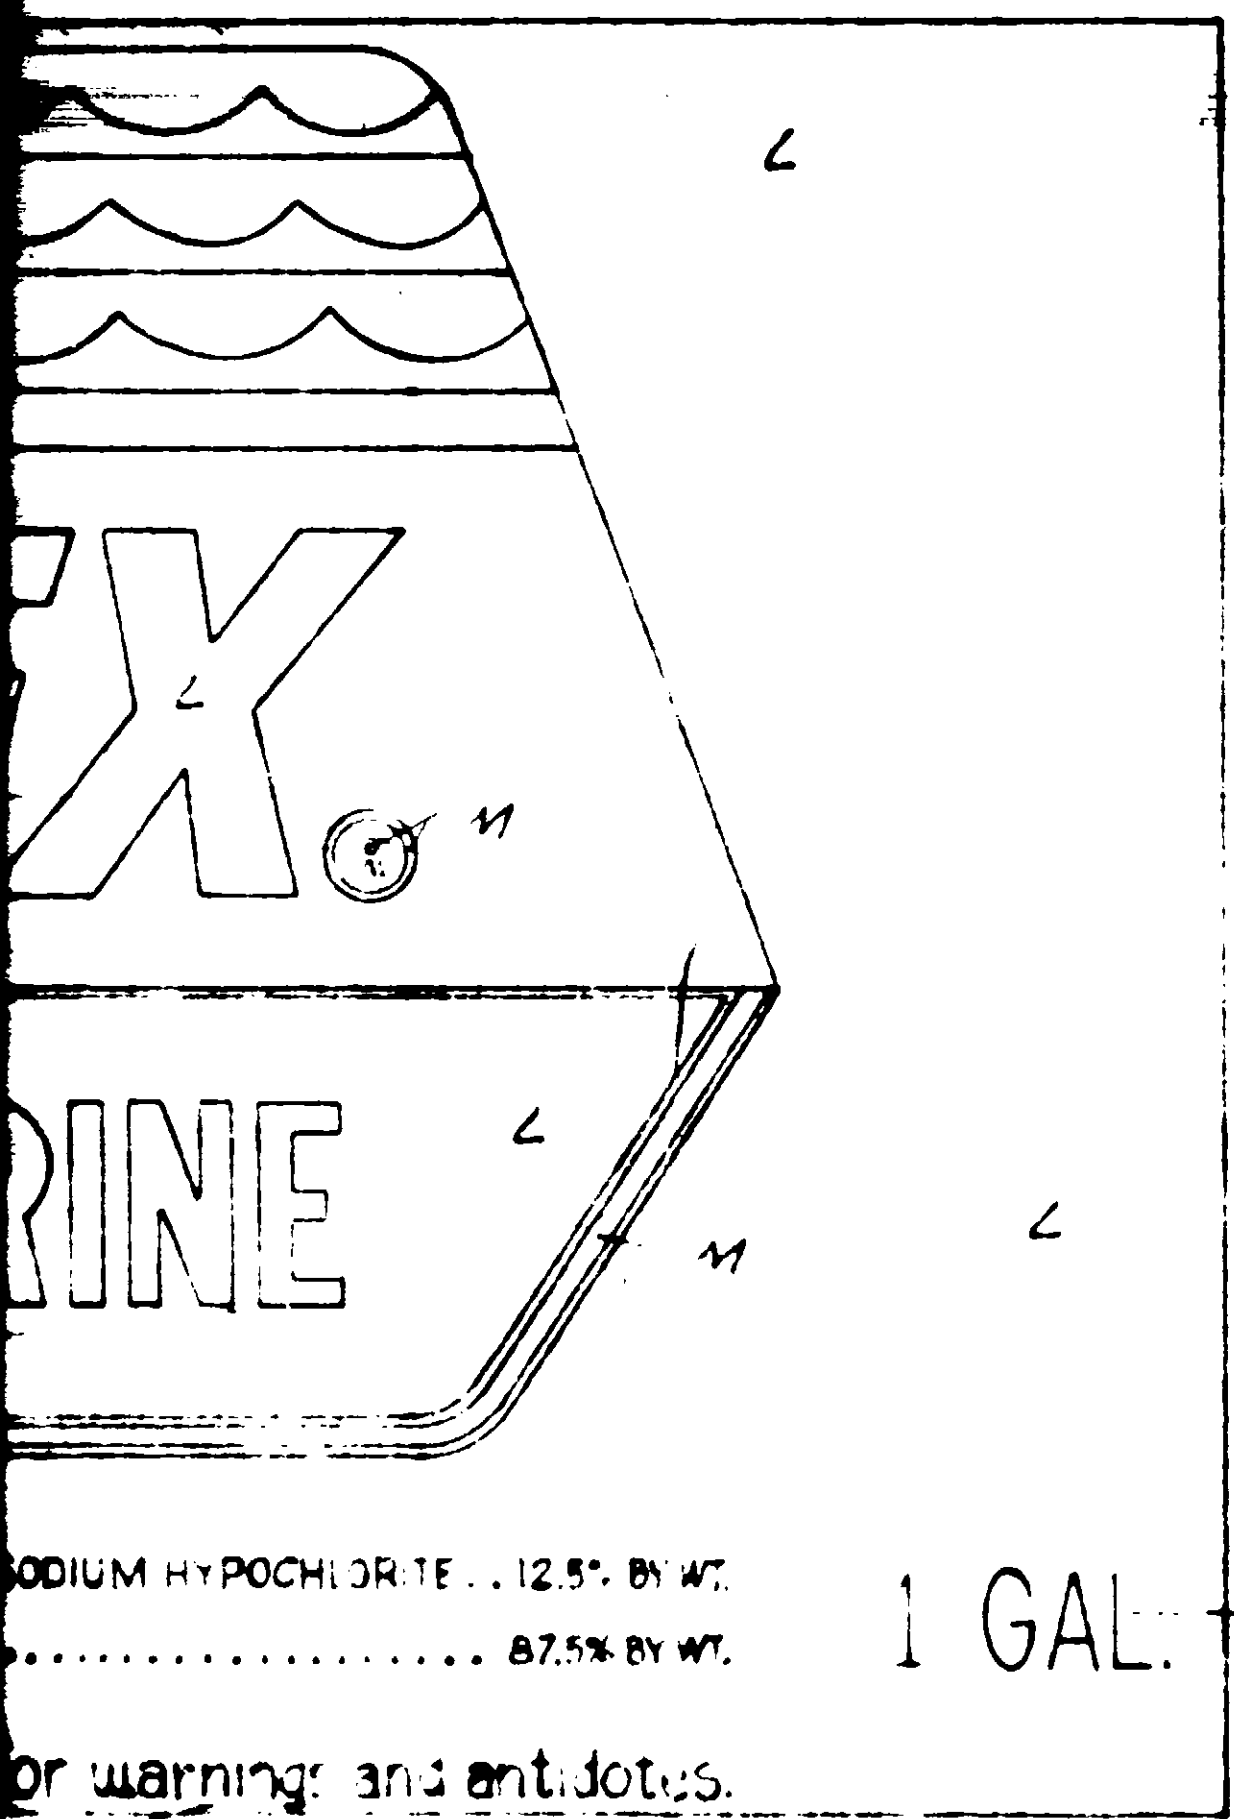

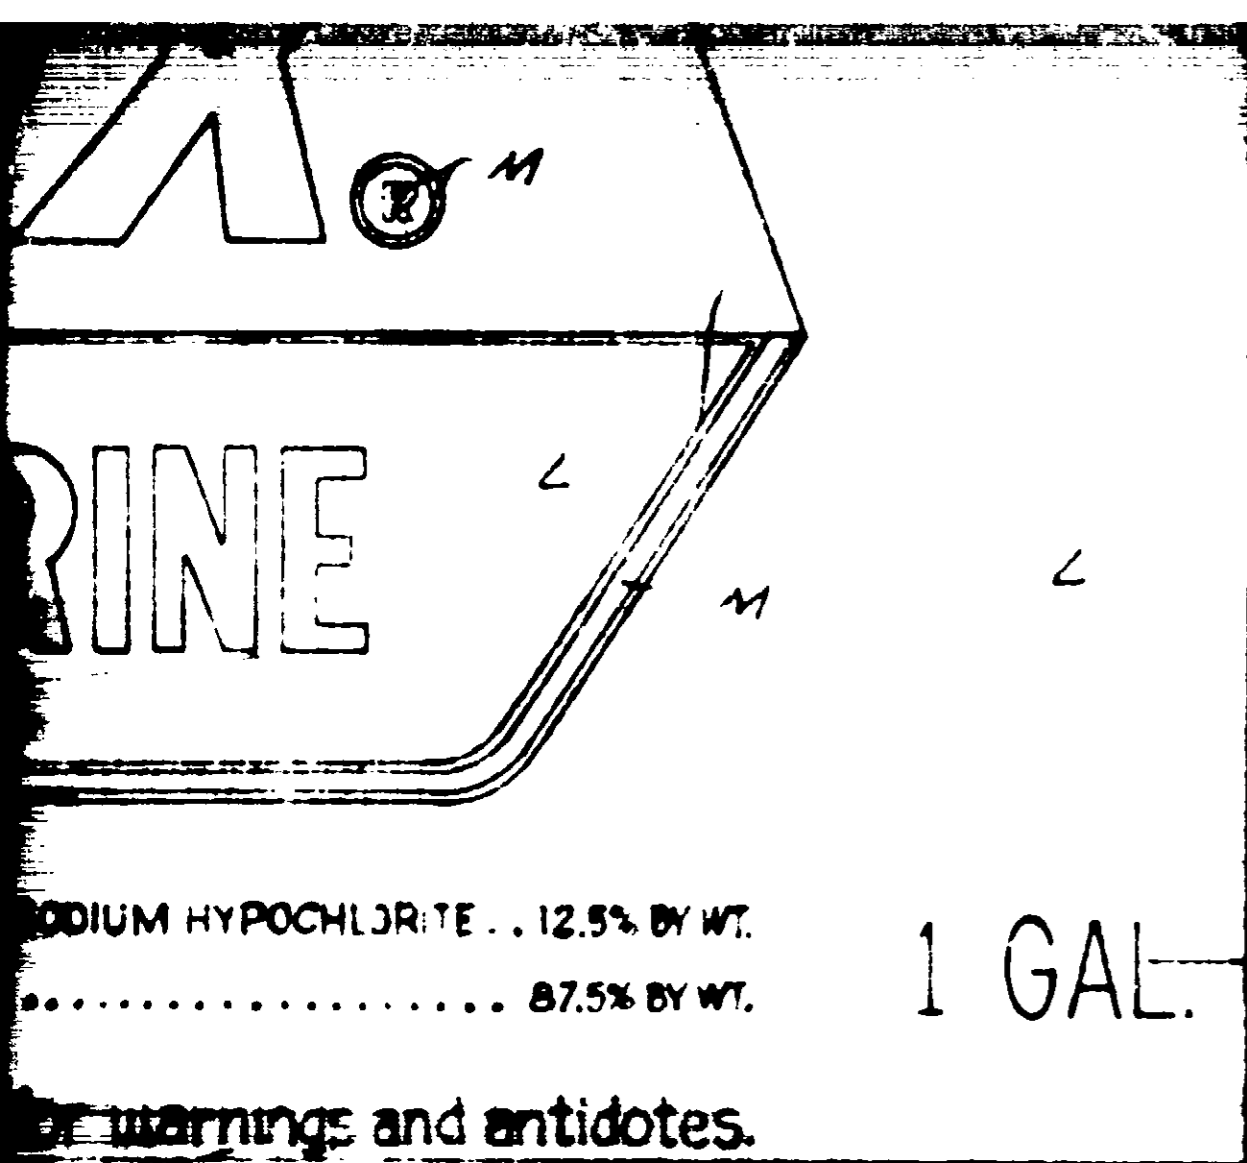

END OF LABEL  
 PANEL OF JUG

H = .022 DEEP  
 M = .015 DEEP

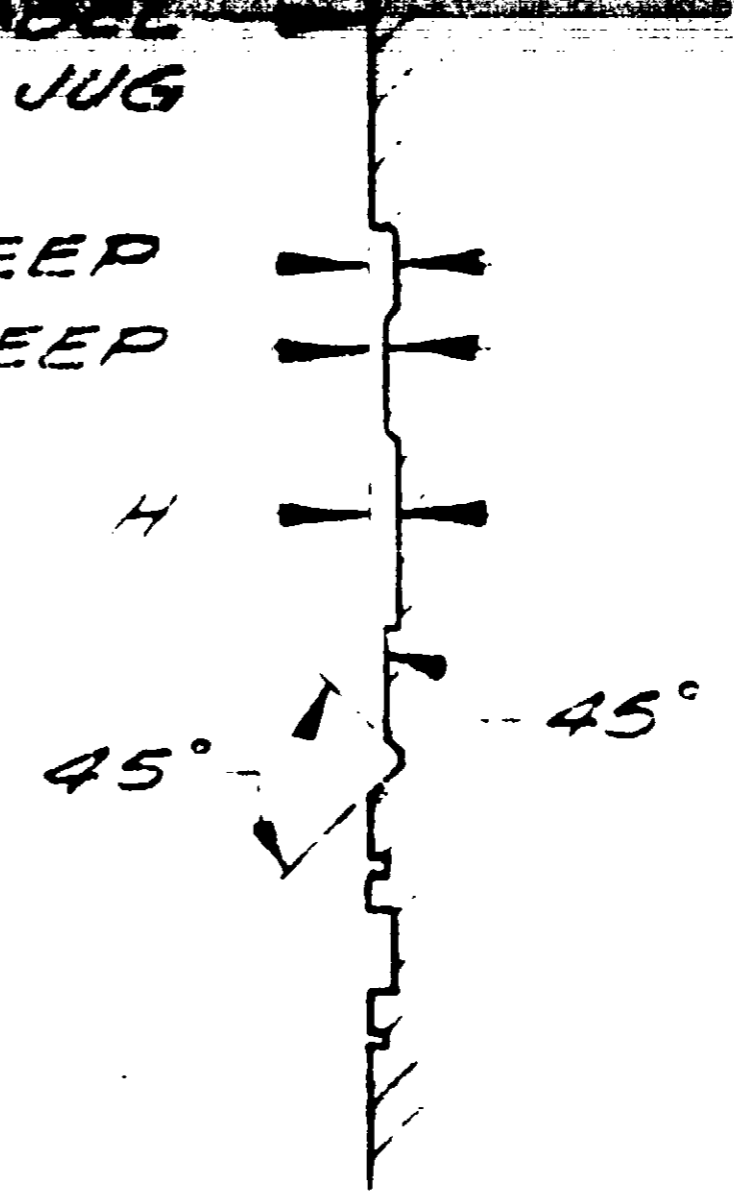

SECT. A-A



CORPORATION,  
 LIMITED

18400 E. MOHR AVENUE  
 CITY OF INDUSTRY, CALIF. 91749

UNLESS OTHERWISE  
 NOTED:  
 XX DECIMAL ±  
 .XXX DECIMAL ±  
 FRACTION ±  
 ANGLES ±

DRAWN BY:  
 MENDOSA  
 DATE  
 3-1-73  
 SCALE  
 FULL

EMBLEM & LETTERING  
 ON FRONT PANEL  
 POOL CHLORINE GALLON JUG  
 PART NUMBER  
 DRAWING NUMBER  
 7-M037-3B  
 REV  
 D

1020 DEEP

1020 DEEP

1020 DEEP

**DIRECTIONS:** AT THE START OF THE POOL SEASON OR IN NEWLY FILLED POOL, ADD 1 GALLON OF PUREX POOL CHLORINE PER 20,000 GALLONS OF POOL WATER. REPEAT DOSAGE UNTIL 1.0 TO 1.5 PPM CHLORINE RESIDUAL IS OBTAINED AS SHOWN BY TEST KIT. THEREAFTER 1/2 GALLON EVERY EVENING OR AS NEEDED TO MAINTAIN 1.0 TO 1.5 PPM CHLORINE RESIDUAL FOR POOL SANITATION AND ALGAE CONTROL. USE TEST KIT FREQUENTLY. 1 QUART POOL CHLORINE TO 35,000 GALLONS WATER PROVIDES 1.0 PPM AVAILABLE CHLORINE. KEEP pH AT 7.4 TO 7.6 AND TOTAL ALKALINITY AT 100 TO 150 PPM AS DETERMINED BY ADEQUATE TEST KIT. DEGRADES WITH AGE. USE TEST KIT AND INCREASE DOSAGE AS NECESSARY TO OBTAIN REQUIRED LEVEL OF RESIDUAL CHLORINE. STORE IN A COOL PLACE.

**WARNING:** HARMFUL IF SWALLOWED. STRONG OXIDANT. MAY PRODUCE CHEMICAL BURNS. DO NOT GET ON SKIN OR IN EYES.

PRODUCT IS TOXIC TO FISH. DO NOT DISCHARGE TREATED WATER INTO LAKES, STREAMS OR PONDS. RINSE EMPTY BOTTLE WITH WATER BEFORE RE-FILLING TO SUPPLY.

**ANTIDOTE:** SKIN AND EYE IRRITATION: RINSE WITH WATER FOR 15 MIN. IF IRRITATION PERSISTS GET MEDICAL ATTENTION. INGESTION: GIVE MILK OR EGGSALTS OR WATER FOLLOWED BY GIVE MILK OR EGGSALTS. CALL ALL PHYSICIANS.

PUREX CORP. 1000 W. 14TH AVE., CALIFORNIA, CALIF.

FDA REG. NO. 1124-70-6A

ACCEPTED

030 DEEP

PPM AS DETERMINED BY ADEQUATE TEST KIT. DEGRADES WITH AGE. USE TEST KIT AND INCREASE DOSAGE AS NECESSARY TO OBTAIN REQUIRED LEVEL OF RESIDUAL CHLORINE. STORE IN A COOL PLACE.

**WARNING:** HARMFUL IF SWALLOWED. STRONG OXIDANT. MAY PRODUCE BURNS. DO NOT GET ON SKIN OR IN EYES.

PRODUCT IS TOXIC TO FISH. DO NOT USE ON SWAMPY TREATED WATERS OR PONDS. RINSE EMPTY BOTTLE WITH WATER BEFORE REUSE AND TO SUPPLY

**ANTIDOTE:** SKIN AND EYE IRRITATION: RINSE WITH WATER IMMEDIATELY. IF PERSISTENT SKIN IRRITATION GET MEDICAL ATTENTION. INTERNAL IRRITATION: MILK OR WATER FOLLOWED BY GASTROLOGICAL OR LOCKING ALL LOCAL PHYSICIAN

PUREX CORPORATION, NORTH BATH, CALIF. 94006  
EPA REG. NO. 1124-70 AA

**ACCEPTED**  
NOV 7 1978  
IN THE FEDERAL REGISTER  
BY JAMES M. JOHNSON, REGISTERED  
AGENT NO. 1124-70 SUBJECT

NOTES:

1.000 LBS. OF PUREX... IN...  
2.000 LBS. OF PUREX... IN...  
3.000 LBS. OF PUREX... IN...  
4.000 LBS. OF PUREX... IN...  
5.000 LBS. OF PUREX... IN...

**PUREX**  
EPA REG. NO. 1124-70 AA

REVISIONS  
LETTERS

G

E POOL SEASON OR IN NEWLY FILLED POOLS  
E PER 20,000 GALLONS OF POOL WATER. RE-  
RINE RESIDUAL IS OBTAINED AS SHOWN BY TEST  
NING OR AS NEEDED TO MAINTAIN 1.0 TO 1.5 PPM  
N AND ALGAE CONTROL. USE TEST KIT FRE -  
5,000 GALLONS WATER PROVIDES 1.0 PPM  
O 7.6 AND TOTAL ALKALINITY AT 100 TO 120  
KIT. DEGRADES WITH AGE. USE TEST KIT  
O OBTAIN REQUIRED LEVEL OF RESIDUAL

D. STRONG OXIDANT. MAY PRODUCE CHEMICAL  
S.

CHARGE TREATS WATER INTO LAKES, STREAMS  
WATER BEFORE REPLENISHING TO SUPPLIER.

H WITH WATER IN MINUTE FOR PIPES OR  
CAL ATTENTION. INTERNAL USE MILK, FOR  
OR FOR LOOKING FOR CALL PHYSICIANS  
WITH DATE, CALL 9-220,  
NO. 1124-70 AA

KIT. DEGRADES WITH AGE. USE TEST KIT  
 TO OBTAIN REQUIRED LEVEL OF RESIDUAL  
 D. STRONG OILS. MAKE PRODUCE CHEMICAL  
 S.  
 WATER TREATED WATER INTO WATER STREAMS  
 WATER BEFORE REACHING TO SUPPLIER.  
 WITH WATER IN MIN. WATER PIPES AND  
 CAL ATTENTION. INTERNATIONAL MILK, FISH  
 OIL OR COOKING OIL. CALL PHYSICIANS  
 SOUTH BAY, CALIF. 91380  
 NO. 1124-70 AA

382

11/14/70  
 11/14/70  
 11/14/70  
 11/14/70



18401 MORRIS AVENUE  
 CALIFORNIA 91744

PUREX  
 PUREX  
 PUREX  
 PUREX  
 PUREX

PUREX  
 PUREX  
 PUREX  
 PUREX  
 PUREX

PUREX  
 PUREX  
 PUREX  
 PUREX  
 PUREX

PUREX  
 PUREX  
 PUREX  
 PUREX  
 PUREX

PUREX  
 PUREX  
 PUREX  
 PUREX  
 PUREX

11/14/70