

# KLEER TECH WATER TOWER ALGAECIDE

ACTIVE INGREDIENT 10%  
POLY(OXYETHYLENE(DIMETHYLIMINIO)  
ETHYLENE (DIMETHYLIMINIO) ETHYLENE  
DICHLORIDE)

INERT INGREDIENT 90%

**WARNING: KEEP OUT OF REACH OF CHILDREN**

Harmful if swallowed. Avoid contact with skin and eyes. In case of Contact flush with plenty of water for at least 15 minutes. If eye irritation persists get medical attention. Avoid Contamination of food.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds or public water. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse container. Destroy when empty.

**APPLICATION**

KLEER TECH WATER TOWER ALGAECIDE is used to control algae, bacteria, fungi in recirculating commercial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and debris. An initial slug addition of 6.13 to 15.32 fluid ounces of WATER TOWER ALGAECIDE PER 1000 gallons of water will provide a concentration of 48 to 120 parts per million of WATER TOWER ALGAECIDE., based on total volume of water in system is recommended.

Repeat initial dosage until control is evident. Subsequent additions of 1.52 to 15.32 fluid ounces of KLEER TECH WATER TOWER ALGAECIDE per 1000 gallons of water will provide a concentration of 48 to 120 parts per million of KLEER TECH WATER TOWER ALGAECIDE. It should be employed every 2 to 5 days or as needed. Frequency of addition depends upon the relative amount of algal growth and severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

**MFGD. BY  
OLIVER CHEMICAL COMPANY, INC.  
CINCINNATI, OHIO 45225**

EPA Reg. No. 1275-39

ACCEPTED  
Feb. 19, 1974  
U.S. DEPARTMENT OF AGRICULTURE  
NATIONAL ANIMAL HEALTH SERVICE  
FEDERAL BUREAU OF INVESTIGATION  
WASHINGTON, D.C. 20540

1275-39


# KLEER TECH WATER TOWER ALGAECIDE

## APPLICATION

KLEER TECH WATER TOWER ALGAECIDE is used to control algae, bacteria, fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and other deposits. An initial slug addition of 6.13 to 15.32 fluid ounces of KLEER TECH WATER TOWER ALGAECIDE PER 1000 gallons of water to provide a concentration of 48 to 120 parts per million of KLEER TECH WATER TOWER ALGAECIDE., based on total weight of water in system is recommended.

Repeat initial dosage until control is evident. Subsequent slug additions of 1.52 to 15.32 fluid ounces of KLEER TECH WATER TOWER ALGAECIDE per 1000 gallons of water (12 to 120 parts per million of KLEER TECH WATER TOWER ALGAECIDE) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

....net Gallons

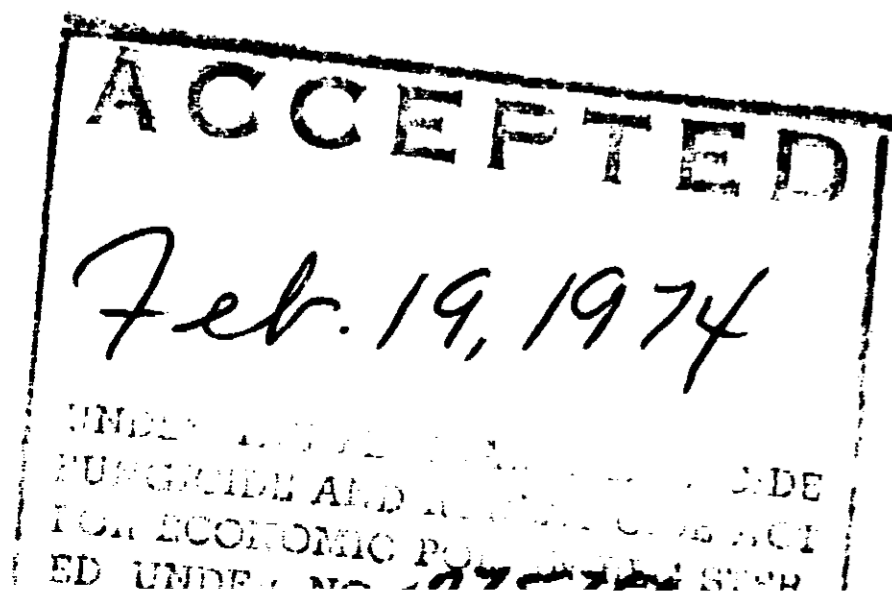

1275-39