


## ALPHA ALGAECIDE 71-43

E.P.A. Reg.#1325=6

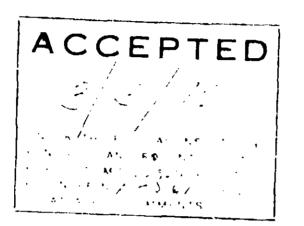

## **DIRECTIONS FOR USE**

Alpha Algaecide No. 71-43 is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological stime and other deposits. An initial slug addition of 6 to 15 fluid ounces of Alpha Algacide No. 71 - 43 per 1000 gallons of water, to provide a concentration of 48 to 120 parts per million of Alpha Algaecide No. 71 - 43 based on the total weight of water in the system is recommended. Subsequent slugadditions of 1.5 to 15 fluid ounces of Alpha Algaecide No. 71 - 43 per 1000 gallons of water (12 to 120 parts per million of Alpha Algaecide No. 71-43) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

## CAUTION: KEEP OUT OF REACH OF CHILDREN. HARMFUL IF SWALLOWED.

Harmful if swallowed, Avoid contact with skin and eyes, in case of contact flush with plenty of water for at least 15 minutes. If eye irritation persists get medical attention, Avoid contamination of food and feedstuffs.

This product is toxic to fish. Do not add treated effluent to lakes, streams or ponds. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse empty container. Destroy it by perforating or crushing. Bury or discard in a safe place. Do not reuse empty drum. Return to drum reconditions rou destroy by perforating or crushing and burying in a safe place.

NET CONTENTS ON CONTAINER

