## MANUAL TREATMENT

(CLANIN IP

Immo

ス

DANGER

有道

tial dose: 1 oz. of Aquachlor granules to 5000 gal. of ster in pool. Either apply directly by sprinkling into pool make solution - allow to stand 2 hours - remove excess ur clear liquid into pool. This will produce required and commended chlorine residual of 0.6 to 1.0.ppm availle chlorine. Repeat during periods of heavy bathing ad or concentrated sun.

intain an available chlorine residual of 0,6 1.0 ppm as determined by use of chlorine st kit.

## CHLORINATOR TREATMENT


Solution - Add 1/2 lb. of Aquachlor granules in 4 gals of luke-warm water. Stir well - allow to settle - pour the clear liquid into feeder storage tanks. Use 1/2 gal. 1% solution to each 5000 gallons of water in pool. ough chlorinator tube intake. Test regularly and add litional solution as required,


> maintain an available chlorine residual of 6 to 1.0 ppm as determined by use of lorine test kit.

## CHILDRENS POOLS

e teaspoonful of Aquachlor Granules to each 1000 gal. pool capacity. Apply as recommended under Manual atment schedule. Test regularly with a Camp Pool Test and add additional Aquachlor Granules as required to intain test any management entre

In available chlorine residual of 0.6 to . 0 ppm as determined by the use of a lorine test kit.

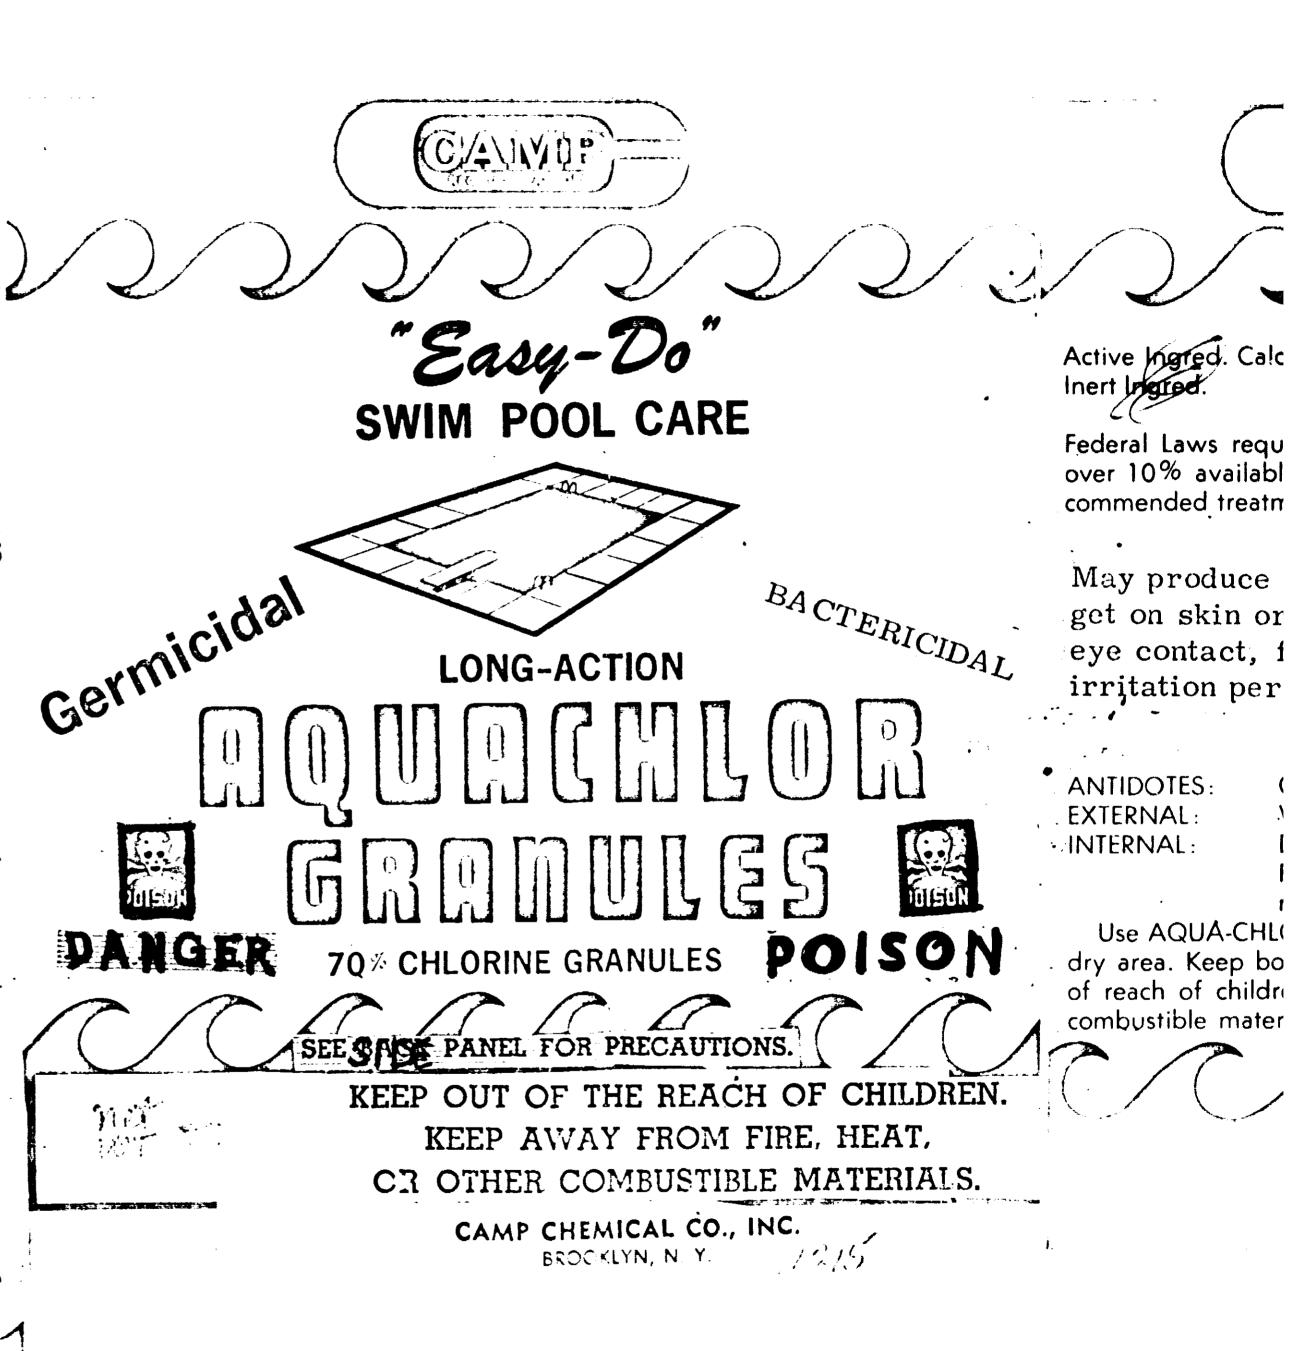

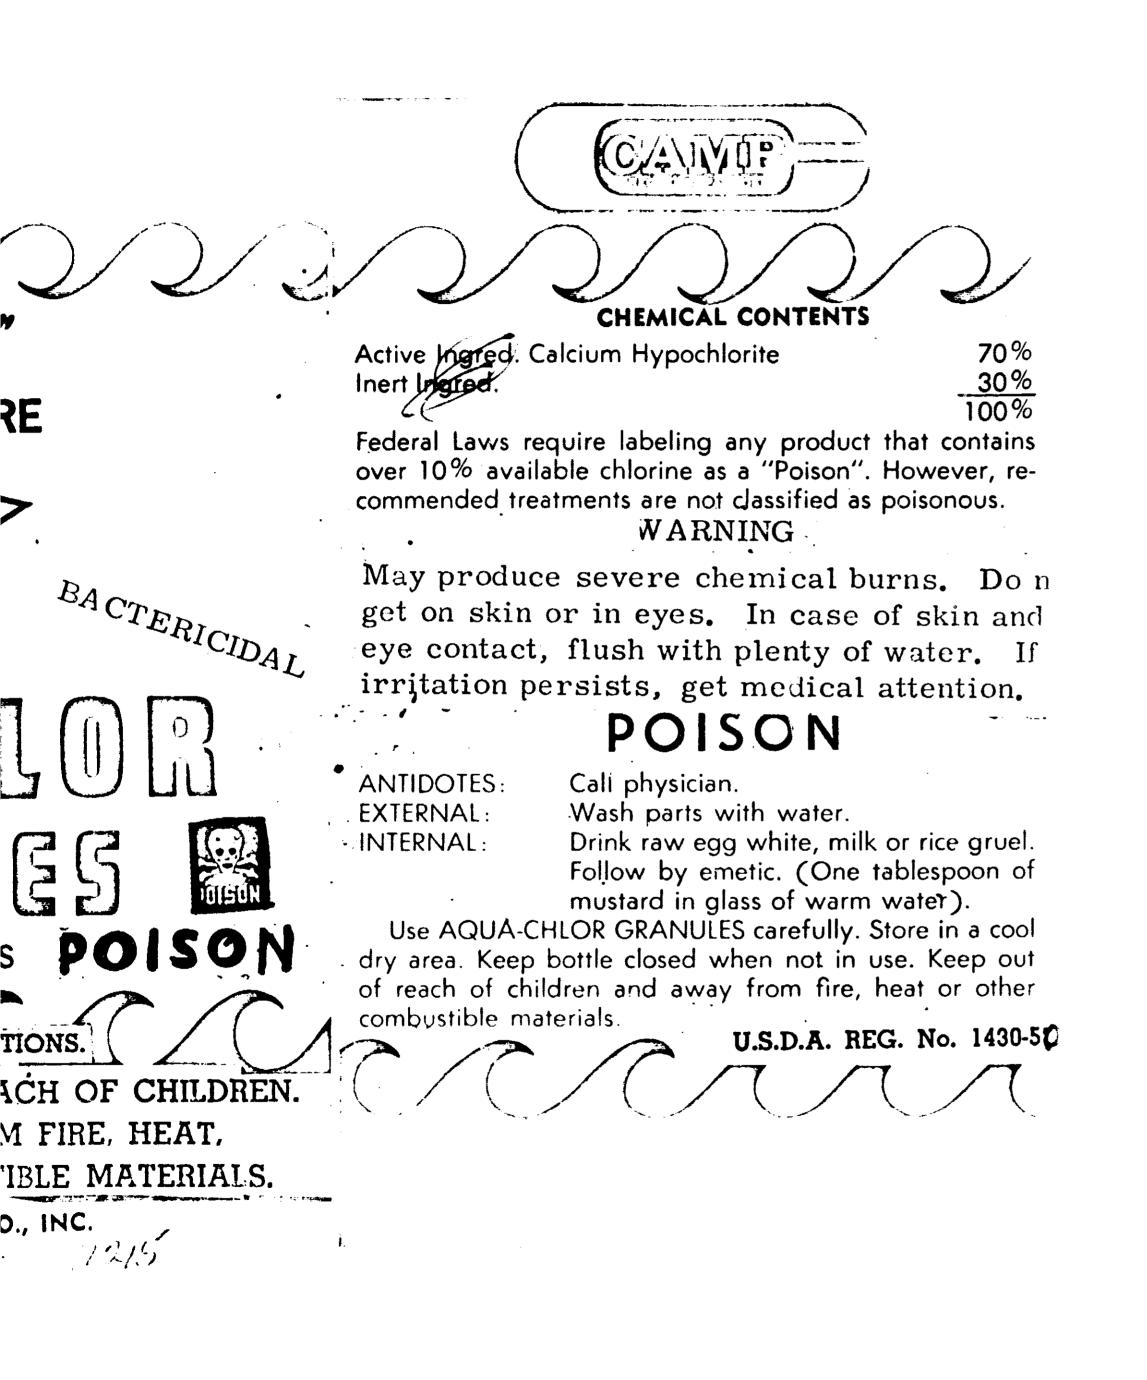

## ACCEPTED WITH COMMENTS