


ITEM 108

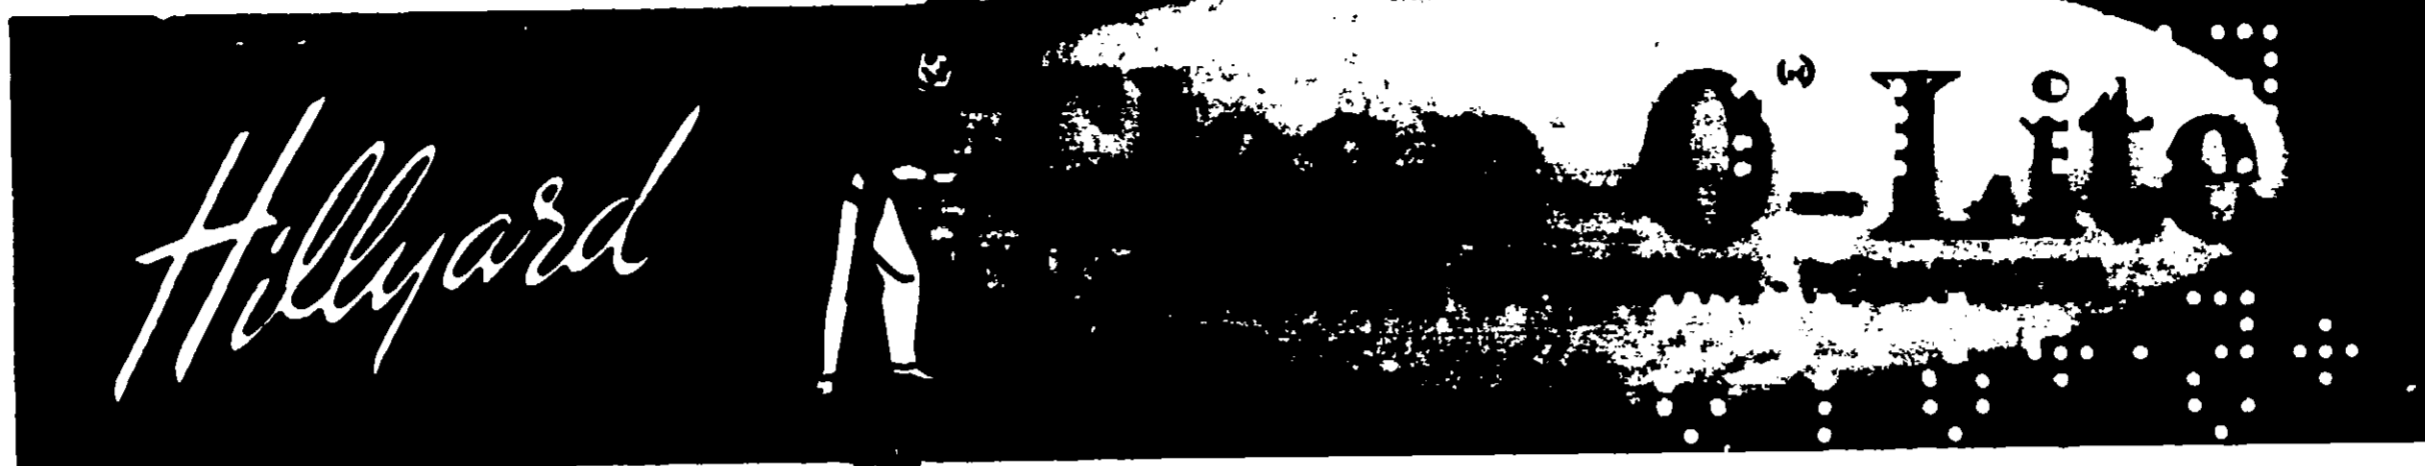

Classified by Underwriters' Laboratories, Inc. as to electrical conductivity when used on conductive floors and spontaneous heating only. Clean-O-Lite - for use with listed electrically conductive floorings of the vinyl and linoleum types. See UL index of classified products.

1658-14  
MAY-24-1973

1658-14

**ACTIVE INGREDIENTS: 4.25%**  
 Alkyl (50% C<sub>14</sub>, 40% C<sub>12</sub>, 10% C<sub>16</sub>) dimethyl benzyl ammonium chloride 3.25%  
 Triethanolamine 1.00%

**INERT INGREDIENTS: 95.75%**

**TOTAL 100.00%**

EPA Reg. No. 1658-14 1172

**STAPHYLOCIDAL PSEUDOMONACIDAL  
 FOR IN-USE CLEANING AND DISINFECTING  
 CONDUCTIVE FLOORING**

*ALSO ESPECIALLY SUITED FOR SURFACES SUCH AS  
 Flooring, Walls, Ceilings, Woodwork, Doors and Furniture*

**DIRECTIONS:** Diluted solutions can be applied in any convenient manner such as scrubbing, mopping, flooding, or wiping. In cases where excessive amounts of soil and contamination are present, clean before disinfecting for maximum effectiveness. The surface should be thoroughly wetted with the disinfecting solution and allowed to dry without rinsing.

**For General Cleaning And Disinfecting:** use 2 ounces of Clean-O-Lite per gallon of water.

**For Control Of Pseudomonas And For Cleaning And Disinfecting In Hospitals:** use 4 ounces of Clean-O-Lite per gallon of water.

**For Cleaning And Sanitizing Food Processing Equipment And Utensils:** avoid contact with foods and packaging materials. Use 2 ounces of Clean-O-Lite per gallon of water. Rinse thoroughly with potable water before using. **AVOID CONTAMINATION OF FOOD.** Do not mix with soaps or other detergents. Rinse empty container thoroughly with water and discard.

**CAUTION:**

**KEEP OUT OF REACH OF CHILDREN  
 CAUSES EYE IRRITATION  
 MAY CAUSE SKIN IRRITATION  
 HARMFUL IF SWALLOWED**

Avoid contact with skin or eyes. In case of contact, wash immediately with water. For eyes, get medical attention.

**HILLYARD CHEMICAL COMPANY**

64502