APPLICATION

This product is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and other deposits. An initial slug application of 6.13 to 15.32 fluid ounces of concentrate per 1000 gallons of water to provide a concentration of 48 to 120 parts per million of this product based on the total weight of water in the system is recommended. Repeat initial dosage until control is evident. Subsequent slug additions of 1.53 to 15.32 fluid ounces of con: centrate per 1000 gallons of water '12 to 120 parts per million of concentrate) should be employed every 2 to 5 days as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

TOWERCIDE 10

CAUTION:

KEEP OUT OF THE REACH OF CHILDREN

FOR INSTITUTIONAL OR INDUSTRIAL USE ONLY

SOLD BY:

OWERCIDE 10


																				Per	cent	by	weight
ingredi	ent Poly[oxy	 .athylon		math		min	io)e:	thv	den	ald	ima	thv	lim	inio)-e1	hvl	ene	e did	:hlc	orida	e }		10.0%
	nt																						90.0%
_	Weight p	er gallo	n.			•						•		•	•	8.	49	ibs.					
	Weight o	f active	ingre	dien	t pe	er ga	llon	١.								O .:	85	lb.					

CAUTION:

KEEP OUT OF THE REACH OF CHILDREN

FOR INSTITUTIONAL OR INDUSTRIAL VSEARCEPTED

SOLD BY:

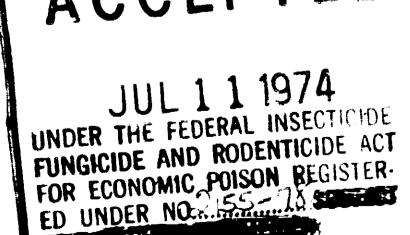

CAUTION:

OF CHILDREN.

Harmful if swallowed. Avoid contact with skin and eyes. In case of contact flush with plenty of water for at least 15 minutes. If eye irritation persists get medical attention. Avoid contamination of food.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse container. Destroy when empty.

CONTROL CONT.

NUMBER GAL.

E. P. A. Reg. No. 2155- 78