

ACCEPTED

11-11-74

UNDER THE FEDERAL INSECTICIDE
FUNGICIDE AND RODENTICIDE ACT
FOR ECONOMIC POISON REGISTRATION
UNDER NO. 3432-23

PUNCH HOLE FOR GALLONS INDICATED

LOW 5,000	NO 4- 20,000
NO 2-10,000	NO 5-
NO 3-15,000	NO 6- 25,000
HIGH-30,-35,000	NO 7-

OR WHICHEVER HOLE IS NEEDED TO MAINTAIN 1-2 PPM

CONTINUOUS CHLORINATOR

and REFILL CARTRIDGE



A DISPOSABLE UNIT WITH ITS OWN SUPPLY OF STABILIZED SLOW DISSOLVING TABLETS. WILL SANITIZE POOL WATER AND PROVIDE CHLORINE RESIDUAL 24 HRS. A DAY WHEN KEPT IN POOL; COMPLETELY SOLUBLE; NO MINERAL SCALE BUILDUP.

Net Weight - 4 lbs.

Active Ingredient: Trichloro-s-Triazinetrione-99%

Inert Ingredient: 1%

Approximately 90% Available Chlorine

EPA REG. 3432-23

EPA EST. NO. 3432-PA-1

THIS PRODUCT IS MEANT TO REDUCE AND CONTROL THE GROWTH OF BACTERIA AND ALGAE IN SWIMMING POOLS.

DANGER: KEEP OUT OF REACH OF CHILDREN!

See First Aid and Precautions

FIRST AID: If taken internally, do not induce vomiting. Feed gruel or cooked cereal followed by olive or cooking oil. Call a physician or take person to Hospital. Causes skin irritation and eye damage. Harmful or fatal if swallowed. Do not get in eyes, on skin or on clothing.

FOR EYES: Bathe with water for 15 minutes, call physician.

DANGER: May be fatal or harmful if swallowed. Keep away from heat and open flame. Heat or any foreign matter may cause fire and the liberation of hazardous gases. Do not breathe dust. Strong oxidizing agent.

Dissolve in water only or add directly to pool water. Do not mix with other pool chemicals.

Rinse and destroy this bottle when empty. Do not reuse.

DANGER: KEEP OUT OF REACH OF CHILDREN.

Float in pool, or place in skimmer or chlorinator only. Do not attempt to remove tablets or refill when empty. Rinse and destroy unit when empty.

TO CALCULATE POOL CAPACITY

Rectangular pools - Multiply length of pool by width of pool by average depth (all in feet by 7.5 = gallons.)

Round Pools - Multiply diameter of pool by diameter of pool by average depth (all in feet) by 5.9 = gallons.



DIRECTIONS FOR USE

1. Superchlorinate with granular maxi-clor or equivalent product at rate of 1 lb. per 10,000 gal. or until a free chlorine residual of 4 to 5 ppm is established as determined by a suitable test kit. Next day add chlorine booster (stabilizer) at a rate of 1 lb. per 4000 gal. of water (no re-need be done only once a season to either fresh water or previously untreated water).
2. Adjust and keep ph at 7.3-7.6.
3. Punch appropriate hole on side of bottle that corresponds to nearest size of pool. If this proves insufficient punch next higher hole.
4. Punch exit hole on opposite side of bottle.
5. Place in skimmer basket with narrow side down, or in chlorinator unit, or can be tied under ladder in pool.
6. Periodic checks of chlorinator should be made and replaced immediately when empty.
7. Pool should be tested at least once a day for chlorine and additional added if needed (as indicated by test kit) to maintain 1-2 chlorine residual.

IMPORTANT: Keep filter running as long as possible (24 hours a day is best) and keep skimmer basket free of debris.

NOTE: During heavy bathing loads, very hot weather, rain, etc. and at least once a week, chlorine residual should be raised to 4 to 5 ppm with granular chlorine (superchlorinated). It is preferable to do this after swimming day so that pool will have a chance to come back to the 1-2 ppm before swimmers go back in the next day. Swimmers should not go in until chlorine residual is below 2 ppm.

THIS PRODUCT IS TOXIC TO FISH. TREATED EFFLUENT SHOULD NOT BE DISCHARGED WHERE IT WILL DRAIN INTO LAKES, STREAMS PONDS, OR PUBLIC WATER. DO NOT CONTAMINATE WATER BY CLEANING OF EQUIPMENT. APPLY THIS PRODUCT ONLY AS SPECIFIED ON THIS LABEL.



N. JONAS & CO., INC. Phila., Pa.

PUNCH HOLE I
LOW 5,000

NO 2-10,000

NO 3-15,000


HIGH-30,-35,0

OR WHICHEVER HOLE



CONTINUOUS

and REFILL

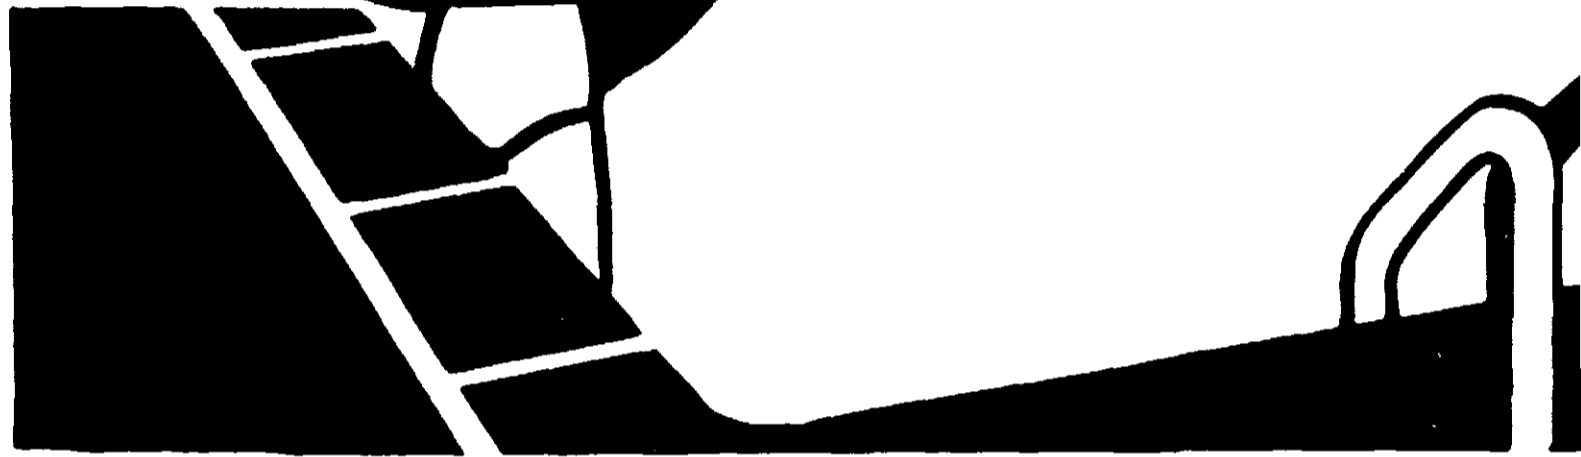

A DISPOSABLE UNIT WITH ITS OWN SUPPLY OF STABILIZER
WILL SANITIZE POOL WATER AND PROVIDE CHLORINE
KEPT IN POOL; COMPLETELY SOLUBLE; NO MINERAL

Net Weight - 4 lbs.

Active Ingredient: Trichloro-s-Triazinetrione

Inert Ingredient: _____

Approximately 90% Available Chlorine

THIS PRODUCT IS MEANT TO REDUCE AND
CONTROL THE GROWTH OF BACTERIA AND
ALGAE IN SWIMMING POOLS.

DANGER: KEEP OUT OF REACH OF CHILDREN!

See First Aid and Precautions

FIRST AID: If taken internally, do not induce vomit-
ing. Feed gruel or cooked cereal followed by olive or
cooking oil. Call a physician or take person to
Hospital. Causes skin irritation and eye damage. Harmful
or fatal if swallowed. Do not get in eyes, on skin or on
clothing.

FOR EYES: Bathe with water for 15 minutes, call
physician.

DIR
1. S
P
fr
c
c
4
a
v
2. A
3. F
r
i
4. F
5. F
i
E

Inert Ingredient: _____ 1%
Approximately 90% Available Chlorine

EPA EST. NO. 3432-PA-1

THIS PRODUCT IS MEANT TO REDUCE AND CONTROL THE GROWTH OF BACTERIA AND ALGAE IN SWIMMING POOLS.

DANGER: KEEP OUT OF REACH OF CHILDREN!

See First Aid and Precautions

FIRST AID: If taken internally, do not induce vomiting. Feed gruel or cooked cereal followed by olive or cooking oil. Call a physician or take person to Hospital. Causes skin irritation and eye damage. Harmful or fatal if swallowed. Do not get in eyes, on skin or on clothing.

FOR EYES: Bathe with water for 15 minutes, call physician.

DANGER: May be fatal or harmful if swallowed. Keep away from heat and open flame. Heat or any foreign matter may cause fire and the liberation of hazardous gases. Do not breathe dust. Strong oxidizing agent.

Dissolve in water only or add directly to pool water. Do not mix with other pool chemicals.

Rinse and destroy this bottle when empty. Do not reuse.

DANGER: KEEP OUT OF REACH OF CHILDREN.

Float in pool, or place in skimmer or chlorinator only. Do not attempt to remove tablets or refill when empty. Rinse and destroy unit when empty.

TO CALCULATE POOL CAPACITY

Rectangular pools – Multiply length of pool by width of pool by average depth (all in feet by 7.5 = gallons.)

Round Pools – Multiply diameter of pool by diameter of pool by average depth (all in feet) by 5.9 = gallons.



DIRECTIONS FOR USE

1. Superchlorinate with granular maxi-clor or equivalent product at rate of 1 lb. per 10,000 gal. or until a free chlorine residual of 4 to 5 ppm is established as determined by a suitable test kit. Next day add chlorine booster (stabilizer) at a rate of 1 lb. per 4000 gal. of water (note – need be done only once a season to either fresh water or previously untreated water).
2. Adjust and keep pH at 7.3–7.6.
3. Punch appropriate hole on side of bottle that corresponds to nearest size of pool. If this proves insufficient punch next higher hole.
4. Punch exit hole on opposite side of bottle.
5. Place in skimmer basket with narrow side down, or in chlorinator unit, or can be tied under ladder in pool.
6. Periodic checks of chlorinator should be made and replaced immediately when empty.
7. Pool should be tested at least once a day for chlorine and additional added if needed (as indicated by test kit) to maintain 1-2 chlorine residual. **IMPORTANT:** Keep filter running as long as possible (24 hours a day is best) and keep skimmer basket free of debris.

NOTE: During heavy bathing loads, very hot weather, rain, etc. and at least once a week, chlorine residual should be raised to 4 to 5 ppm with granular chlorine (superchlorinated). It is preferable to do this after swimming day so that pool will have a chance to come back to the 1-2 ppm before swimmers go back in the next day.

Swimmers should not go in until chlorine residual is below 2 ppm.

THIS PRODUCT IS TOXIC TO FISH. TREATED EFFLUENT SHOULD NOT BE DISCHARGED WHERE IT WILL DRAIN INTO LAKES, STREAMS PONDS, OR PUBLIC WATER. DO NOT CONTAMINATE WATER BY CLEANING OF EQUIPMENT. APPLY THIS PRODUCT ONLY AS SPECIFIED ON THIS LABEL.



N. JONAS & CO., INC. Phila., Pa.