#### **DIRECTIONS FOR USE:**

IT IS A VIOLATION OF FEDERAL LAW TO USE THIS PRODUCT IN ANY MANNER INCONSISTENT WITH ITS LABELING.

ONE OUNCE OF UTIKEM CHLORINATING GRANULES WILL PROVIDE 0.5 p.p.m. OF AVAILABLE CHLORINE IN 10,000 GALLONS OF WATER.

#### START UP:

- 1. Adjust pH of pool water to 7.2 7.6 range with UTIKEM pH Control Chemicals. Use a suitable UTIKEM Test Kit as a guide.
- To a clean pool which is free of visible algae, add 10 oz. of UTIKEM CHLORINATING GRANULES for every 10,000 gallons of water.
   Wait ½ hour and test vater for chlorine level using a UTIKEM Test
- Kit.
  4. If the chlorine level is below 0.6-1.0 p.p.m., add an additional ½ oz. of UTIKEM CHLORINATING GRANULES for every 10,000 gallons of


water for every 0.2 p.p.m. that chlorine level is to be raised.

#### **REGULAR CARE:**

- After start up add 6-8 oz. of UTIKEM CHLORINATING GRANULES for every 10,000 gallons of water daily, or as needed, as determined by your UTIKEM Test Kit.
- 2. Check pool water daily with your UTIKEM Test Kit and maintain a chlorine level of 0.6 1.0 p.p.m. and a pH of 7.2 7.6.
- During extremely hot weather and/or heavy bathing loads, additional treatment may be required.
- 4. For pool water previously treated with UTIKEM CHLORINE STABILIZER AND WATER CONDITIONER (Cyanuric Acid), maintain a chlorine level of 1.0 1.5 p.p.m. Use 3 oz. of UT!KEM CHLORINATING GRANULES for every 10,000 gallons of water every other day or as needed to maintain a chlorine level of 1.0-1.5 p.p.m.

ADD UTIKEM CHLORINATING GRANULES DIRECTLY TO POOL WATER!

NEVER MIX POOL CHEMICALS TOGETHER! ALWAYS ADD THEM SEPARATELY!

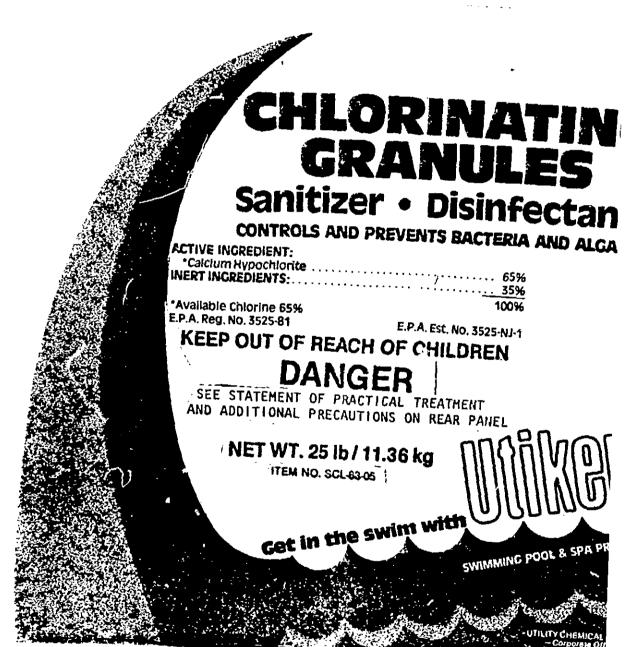



CONTROLS AND PREVENTS BACTERIA AND ALGAE

ACTIVE INGREDIENT: 

 Available Chlorine 65% E.P.A. Reg. No. 3525-81

E.P.A. Est. No. 3525-NJ-1

KEEP OUT OF REACH OF CHILDREN

DANGER

SEE STATEMENT OF PRACTICAL TREATMENT AND ADDITIONAL PRECAUTIONS ON REAR PANEL NET WT. 25 lb/ 11.36 kg TEM NO. SCL-83-05 | Get in the swim with SWIMMING POOL & SPA PRODUCTS

### SUPER CHLORIMATION:

If visible algae is present, use 1 ounce of UTIKEM CHLOR-INATING GRANULES for every 560 gallons of pool water. This treatment should be given at night or when the pool is not in use. Turn the filter to "off".
 After approximately 6-8 hours, start the filter and vacuum of scrub dead algae from pool bottom and walls.
 Do not use the pool until the chlorine level has dropped to a pool or less as determined by your UTIKEM Test Kit.

3.0 p.p.m. or less as determined by your UTIKEM Test Kit.
4. If visible growth of algae should occur again, repeat treat-

ment as indicated.

#### **USEFUL POOL FACTS: ESTIMATING POOL CAPACITY:**

RECTANGULAR & SQUARE POOLS: Multiply length in feet x width in feet x average depth in feet x 7.5. The result will be capacity of pool in

ROUND POOLS: Multiply diameter in feet x diameter in feet x average depth in feet x 5.9. The result will be capacity of pool in gallons. OVAL POOLS: Multiply longest diameter in feet x shortest diameter in feet x average depth in feet x 5.9. The result will be capacity of pool in

#### DO NOT REUSE EMPTY CONTAINER.

MADE IN U.S.A. ASK FOR THE OTHER WILLES POOL AND SPA PRODUCTS with COMMENTED in EPA Letter Dated:

DEC 8 1982 Under the Paris and a second Fungle'de, chilin .... es munded, f Registered and

3525-81

# PRECAUTIONARY STATEMENTS HAZARDS TO HUMANS AND DOMESTIC ANIMALS

**DANGER:** Highly corrosive. Causes skin and eye damage. May be fatal if swallowed. Do not get in eyes, on skin, or on clothing. Wear goggles or face shield and rubber gloves when handling. Avoid breathing dust. Remove and wash contaminated clothing and shoes before reuse.

PRACTICAL TREATMENT, (FIRST AID): Swallowing: if conscious, feed be ead soaked in milk followed by olive oil or cooking oil. DO NOT induce vomiting. Take immediately to a hospital or physician. If unconscious, or in convulsions, take immediately to a hospital or physician. Do not give anything by mouth to an unconscious person. Eye or skin contact: flush with plenty of water for at least 15 minutes, while removing contaminated clothing and shoes. For eye contact, get immediate medical attention. If skin irritation occurs, get medical attention. Inhilation: remove to fresh air. If signs of irritation or discomfort occur, take immediately to a hospital or physician.

#### PHYSICAL AND CHEMICAL HAZARDS:

STRONG OXIDIZING AGENT: Mix only with water. Use only a clean dry scoop made of metal or plastic each time UTIKEM CHLORINATING GRANULES are taken from the container. Do not add this product to any dispensing device containing remnants of any other product. Such use may cause violent reaction leading to fire or explosion. Contamination with moisture, acids, organin matter, other chemicals or easily combustible material such as petroleum or paint products may start a chemical reaction with generation of heat, liberation of hazardous gases and possible generation of a fire or explosion. In case of contamination or decomposition, do not reseal container. It possible, isolate container in open air or well-vantilated area. Flood with large volumes of water, if necessary.



CALCIUM HYPOCHLORITE, HYDR



CALCIUM HYPOCHLORITE, HYDRATED UN2880

ENVIRONMENTAL HAZARDS: This product is toxic to figh. Do not discharge into lakes, streams, ponds or public waters unless in accordance with NPDES Permit. For guidance, contact the regional office of the Environmental Protection Agency (RG 100 lbs/45.4 kg UN2880).

STORAGE AND DISPOSAL: Keep container closed when not in use. Keep in original container in a cool, dry place. Keep away from heat sources, sparks, open flames and lighted tobacco products. Use only a clean, dry scoop made of metal or plastic each time UTIKEM CHLORINATING GRANULES are taken from the container. In case of fire, drench with water. UTIKEM CHLORINATING GRANULES supply oxygen; therefore, attempts to smother fire with a wet blanket, carbon dioxide or a dry chemical extinguisher are ineffective. In case of spill or leak, use extreme caution. Contamination may cause fire or violent reaction. If fire or reaction occurs in area of spill, douse with plenty of water. Otherwise, sweep up spilled material, using a clean, dry shovel and broom and dissolve all spilled material before discarding. Do not reuse container. Residual material remaining in empty drum can react to cause fire. Thoroughly flush empty container with water and place in trash collection.

## DO NOT REUSE EMPTY CONTAINER.

ACCEPTED ' EMERGENCY TELEPHONE NUMBER with COMMENTS

800-424-9300

CHEMTREC WASHINGTON, D.C.

Under the Fi be betrechtigide. Funcierde, ar 1 . . ... as amended, for in 1: 15 registered under LPAR 18 No. 3525 - 8

in EPA Letter Dated:

DEC 8 1032

U.S. ENVIRONMENTAL PROTECTION AGENCY OFFICE OF PESTICIDES PROGRAMS REGISTRATION DIVISION (WH-567) TERM OF ISSUANCE WASHINGTON, D.C. 20460 NAME OF PESTICIDE PRODUCT NOTICE OF PESTICIDE: REGISTRATION REREGISTRATION (Under the Federal Insecticide, Fungicide, and Rodenticide Act, as amended) NAME AND ADDRESS OF REGISTRANT (Include ZIP code) William Chemical Company Sixth Ave. A Mait Street Paterson, 13 17524 NOTE: Changes in tabeling formula differing in substance from that accepted in connection with this registration must be submitted to and accepted by the Registration Division prior to use of the label in commerce. In any correspondence on this product always refer to the above U.S. EPA registration number. On the basis of information furnished by the registrant, the above named pesticide is hereby Registered/Reregistered under the Federal Insecticide, Fungicide, and Rodenticide Act. A copy of the labeling accepted in connection with this Registration/Reregistration is returned herewith. Registration is in no way to be construed as an indersement or approval of this product by this Agency. In order to protect health and the environment, the Administrator, on his motion, may at any time suspend or cancel the registration of a peaticide in accordance with the Act. The acceptance of any name in connection with the registration of a product under this Act is not to be construed as giving the registrant a right to exclusive use of the name or to its use if it has been covered by others. This product is conditionally registered in accordance with the provisions of Section 3(c)(7)(A) of the Act, since you have agreed that you will submit and/or cite all data required for registration/reregistration of your product under FIF'M Section 3(c)(5) when the Adency requires all registrants of similar products to submit such data. If those conditions are not complied with, the relistration will be subject to concellation in accordance with Section 6(e) of the Act. A A. E. Castillo Froduct Manager 23% Disinfectants Branch Registration Division (TS-767) T ATTACHMENT IS APPLICABLE SIGNATURE OF APPROVING OFFICIAL EPA Fem \$570-6 (Rev. 5-76) PREVIOUS EDITION MAY BE USED UNTIL SUPPLY IS EXHAUSTED.