


E. W. SMITH CHEMICAL CO.
CITY OF INDUSTRY, CALIF.

August 18, 1972

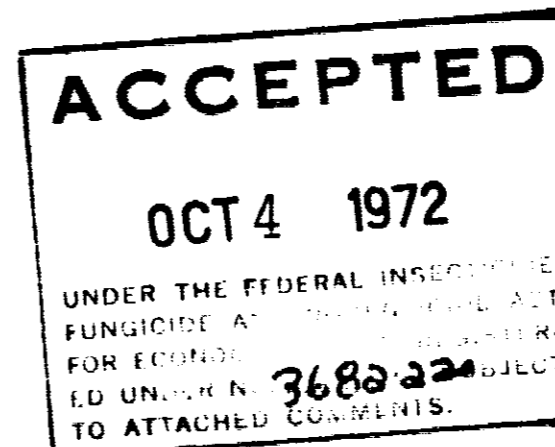

PROPOSED LABEL FOR:

Ems

COOLING TOWER & CONDENSER TREATMENT #308

For Corrosion, Scale and Algae Control

For control of algae in recirculating water cooling towers if microbial growth is present, use 1 pint of #308 per 100 gallons of water initially in the system. Repeat until control is evident. When control is apparent, use 1/2 pint of #308 per 100 gallons water in system, added to the sump periodically or as needed. This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water.

Do not reuse empty drum. Return to drum reconditioner or destroy by perforating or crushing and burying in a safe place.

ACTIVE INGREDIENTS:

Copper Sulfate, anhydrous 1.14%
(copper expressed as metallic 0.45%)

INERT INGREDIENTS: 98.86%

Warning; Keep out of Reach of Children. Harmful if swallowed

ANTIDOTE

EXTERNAL: Wash with rubbing alcohol and follow with soap and water.

INTERNAL: Give a tablespoonful of salt in a glass of warm water and repeat until vomit fluid is clear. Give milk or white of eggs beaten with water. Have patient lie down and keep warm. CALL A PHYSICIAN.

EPA Reg. No. 3682-22

E. W. SMITH CHEMICAL CO.
15020 E. Proctor Avenue
City of Industry, Calif. U.S.A. 91746
213-333-5205

NET CONTENTS _____