


For control of algae in industrial recirculating water cooling towers. Clean badly fouled systems before starting treatment. When algae are visible, add an initial dosage of 1 lb. of Algacide No. 322 per 1000 gallons of water in the system. Repeat if necessary until control is evident. When control is evident use a subsequent dose of ½ lb. of Algacide No. 322 per 1000 gallons of water in the system, weekly, or as needed to maintain control. All Algacide No. 322 to the sump of the cooling tower. For use in copper systems.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, or ponds.

Do not reuse empty container. Destroy it by perforating or crushing. Bury or discard in a safe place.

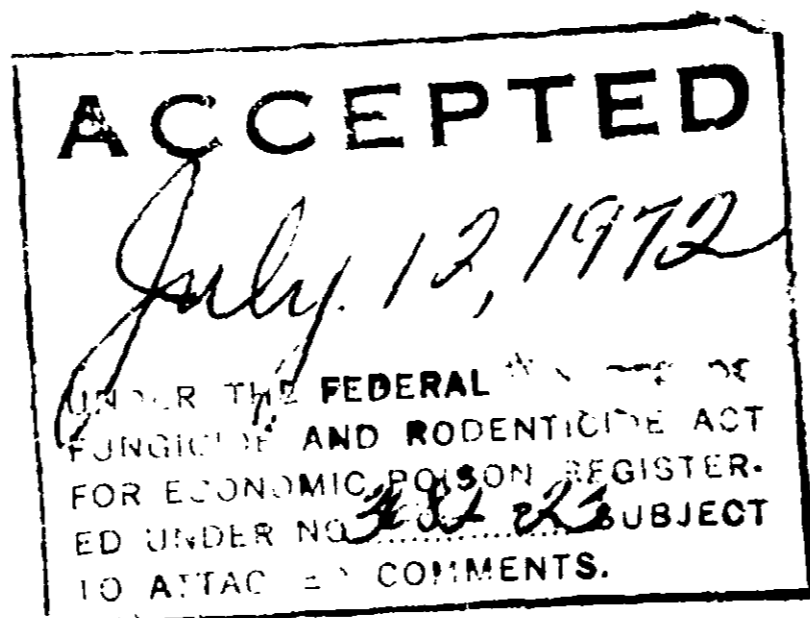

Ems

ALGAECIDE #322

E. W. SMITH CHEMICAL CO.

15020 EAST PROCTOR AVENUE—EDgewood 3-5205
INDUSTRY, CALIFORNIA, U.S.A. 91746

NET CONTENTS _____

ACCEPTED
July 12, 1972
UNDER THE FEDERAL
FUNGICIDE AND ROENTICIDE ACT
FOR ECONOMIC POISON REGISTER-
ED UNDER NO. *33223* SUBJECT
TO ATTACHED COMMENTS.

Ems

ALGAEICIDE #322

E. W. SMITH CHEMICAL CO.

15020 EAST PROCTOR AVENUE—Edgewood 3-5205
INDUSTRY, CALIFORNIA, U.S.A. 91746

NET CONTENTS _____

ACTIVE INGREDIENTS:
Cupric Sulfate Pentahydrate 24%
INERT INGREDIENTS 76%
100%

ANTIDOTE

EXTERNAL: Wash with rubbing alcohol and follow with soap and water.

INTERNAL: Give a tablespoonful of salt in a glass of warm water and repeat until vomit fluid is clear. Give milk or white of eggs beaten with water. Have patient lie down and keep warm.

CAUTION: Keep out of reach of children. Harmful if swallowed.

EPA Reg. No. 3682-23