apr 26,197

UNDER THE FEDERAL INSECTICIDA FUNCICIDE AND RODENTICIDE ACT FOR ECONOMIC POISON REGISTER. ED UNDER NO. 4266-24

Comment

DIRECTIONS

- 1. With the aid of a suitable test kit, adjust the pH of pool water to 7.2 to 7.6.
- 2. Broadcast SUPER-SHOCK over the surface of the water, IN THE DEEPEST PORTION OF THE POOL, using 1 lb. for each 7000 gallons of water. This will provide 10 p.p.m. available chlorine. Before entering the pool, check the chlorine residual with a test kit. Do not use pool until chlorine residual drops to 2.0 p.p.m.
- 3. Filter should be backwashed when necessary to maintain maximum filtration.
- 4. Repeat treatment on second day if problem has not been corrected within 24 hours. Get professional assistance if problem has not been solved by third day.
- 5. Revert to regular chlorine maintenance dosages when chlorine level is between 1.5 and 2.0 p.p.m.

IMPORTANT


It is possible, in smaller pools, for some undissolved granules to reach the bottom before completely dissolving. Brush this area, if this occurs, to avoid the possibility of bleaching painted surfaces or liners.

TO MEASURE POOL: To determine the number of gallons of water in your pool, use this formula in feet:

ROUND POOL: Multiply diameter by diameter by depth of wate: by 5.9.

RECTANGULAR POOL: Multiply length by width by depth of water by 7.5.

THE BARCOLENE COMPANY (Swimming Pool Division) HOLBROOK, MASSACHUSETTS 02343 EPA REG. NO. 4206-24

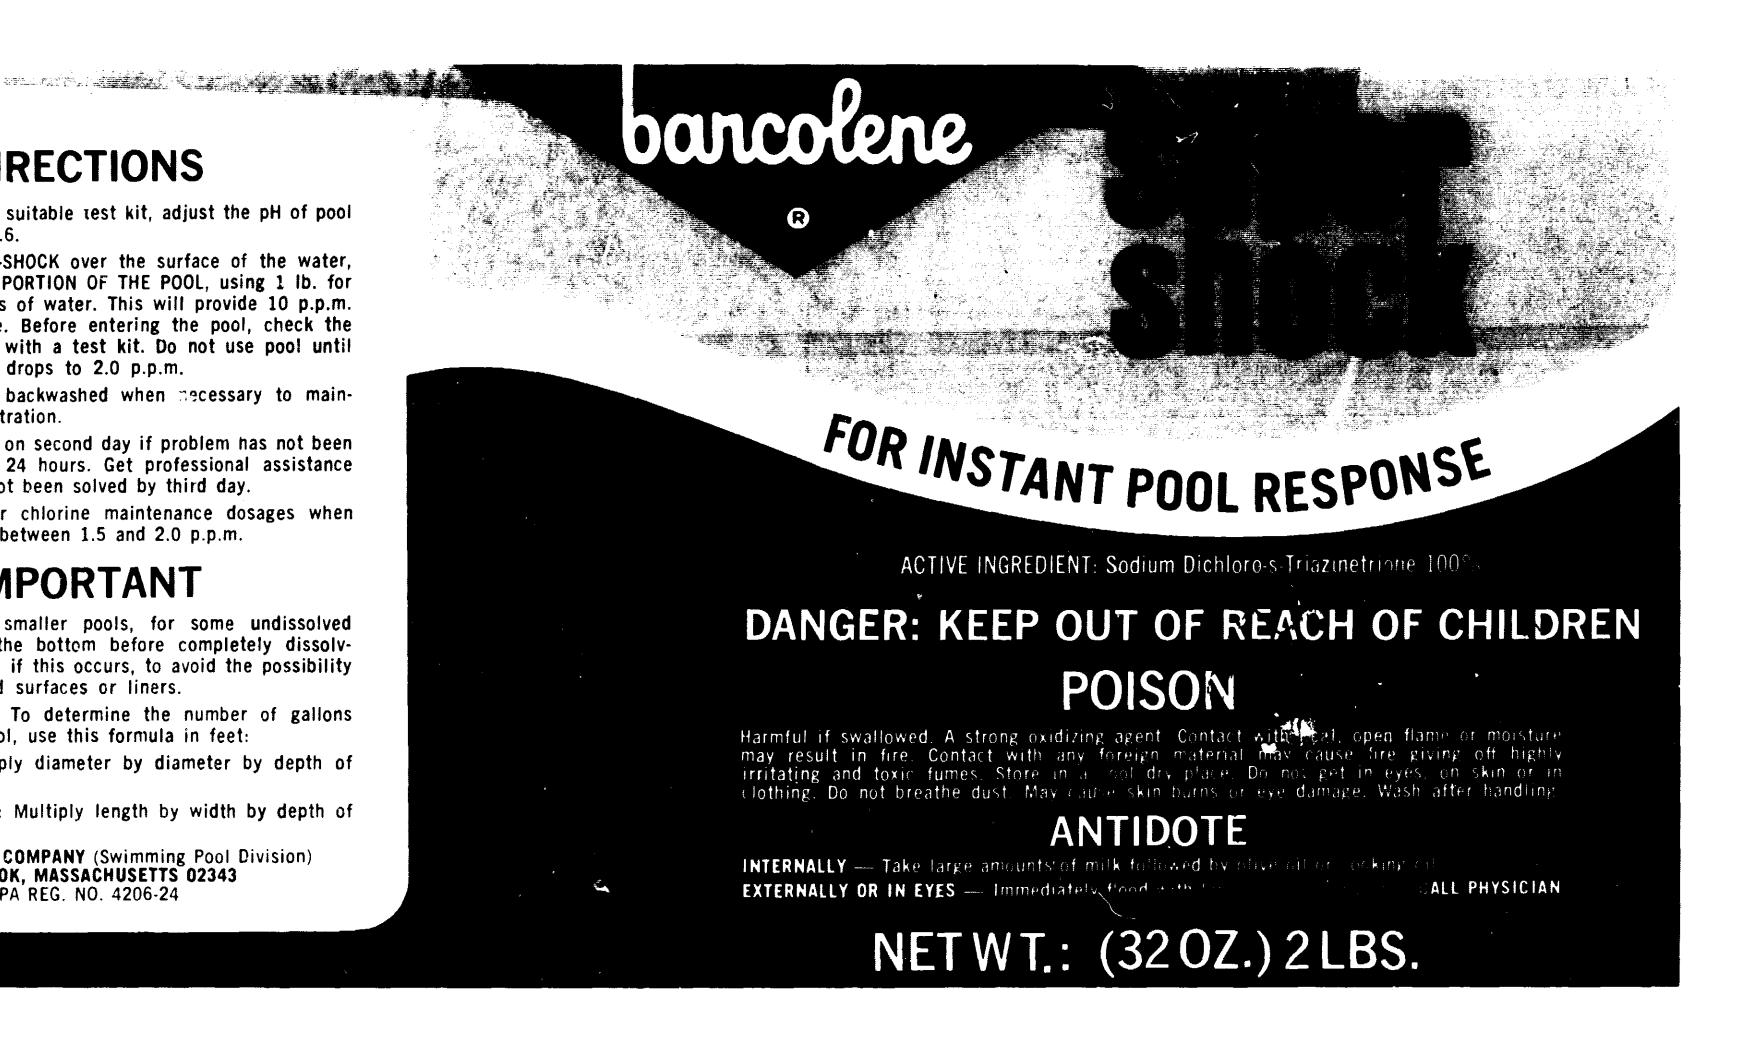

WITH COMMENTS ACCEPTED

ACT OF AC

DIRECTIONS

- 1 Aith the aid of a suitable test kit adjust the princip pool. Auter to 7.2 to 7.6.
- Proof ast SUPER-SHOCK over the surface of the water. IN THE DEEPEST PORTION OF THE POOL, using 1 lb. for each 7000 gailons of water. This will provide 10 p.p.m. available chlorine. Before entering the pool, check the blorine residual with a test kit. Do not use pool until blorine residual drops to 20 p.p.m.
- 3 filter should be backwashed when no essary to maintain maximum fotration.
- Repeat treatment on second day if problem has not been professional assistance if problem has not been solved by third day.
- So Revert to regular inciring maintenance dosages when thormalieset is between 1.5 and 2.0 p.p.s.

IMPORTANT

of the product of in smaller pools, for some undissolved cranules to reach the bottom before completely dissolven. Brush mis area if this conurs, to avoid the possibility of their hing pointed surfaces or liners.

TO MEASURE POOL: To determine the number of patient water in your pool use this formula in feet.

ROUND POOL: Multiply diameter by diameter by depth or water by 5.5

RECTANGULAR POOL: We tip's sength by width by depth of materia, 7.6

oancolene

SUPER SIOCK

FOR INSTANT POOL RESPONSE

ACTIVE INGREDIENT: Sodium Dichloro-s-Triazinetrione 100%

DANGER: KEEP OUT OF REACH OF CHILDREN POISON


Harmful if swallowed. A strong oxidizing agent. Contact with heat, open flame or moisture may result in fire. Contact with any foreign material may cause fire giving off highly irritating and toxic fumes. Store in a cool dry place. Do not get in eyes, on skin or in clothing. Do not breathe dust. May cause skin burns or eye damage. Wash after handling.

ANTIDOTE

INTERNALLY — Take large amounts of milk followed by olive oil or cooking oil.

EXTERNALLY OR IN EYES — Immediately flood with large amounts of water. CALL PHYSICIAN

NETWT.: (32 OZ.) 2 LBS.



DIRECTIONS

- With the aid of a suitable test kit, adjust the pH of pool water to 7.2 to 7.6.
- water to 7.2 to 7.0.

 2. Broadcast SUPER-SHOCK over the surface of the water. IN THE DEEPEST PORTION OF THE POOL, using 1 tb. for each 7000 gallons of water. This will provide 10 p.p.m. available chlorine. Before entering the pool, check the chlorine residual with a test kit. Do not use pool until chlorine residual drops to 2.0 p.p.m.
- 3. Fifter should be backwashed when necessary to maintain maximum filtration.
- 4. Repeat treatment on second day if problem has not been corrected within 24 hours. Get professional assistance if problem has not been solved by third day.
- 5. Revert to regular chlorine maintenance dosages when chlorine level is between 1.5 and 2.0 p.p.m.

IMPORTANT

It is possible, in smaller pools, for some undissolved granules to reach the bottom before completely dissolving. Brush this area, if this occurs, to avoid the possibility of bleaching painted surfaces or liners.

TO MEASURE POOL: To determine the number of gallons of water in your pool, use this formula in feet: ROUND POOL: Multiply diameter by diameter by depth of water by 5 9.

RECTANGULAR POOL: Multiply length by width by depth of water by 7.5.

THE BARCOLENE COMPANY (Swimming Pool Division)
HOLBROOK, MASSACHUSETTS 02343
EPA REG. NO. 4206-24



FOR INSTANT POOL RESPONSE

DANGER: KEEP OUT OF REACH OF CHILDREN

ANTIDOTE

NET WT.: (32 DZ.) 2 LBS.

ACTIVE INGREDIENT Sodium Dichloro's Triazinetrione 100° POISON INTERMALLY — Take large amounts of milk followed by place on an opking of externally OR IN EYES — immediately fond with large and in the Call Physician.