



RELIANCE-BROOKS.

Incorporated

CLEVELAND, OHIO


TORONTO ONTARIO

Applications

H-C Treatment No. 471 is used to inhibit the growth of algae bacteria and fungi in recirculating commercial and industrial cooling water systems. Before treatment with H-C Treatment No. 471 systems must be cleaned to remove algal growth, microbial slime and other deposits. The system should be treated with an initial slug of 5.1 to 10.2 fluid ounces of H-C Treatment No. 471 per 1000 gallons of water. Repeat the initial dosage until control is evident. Subsequent slug additions 1.7 to 10.2 fluid ounces of No. 471 per 1000 gallons of water should be made every 1 to 5 days or as required. Frequency of treatment depends upon relative bleedoff and microbial activity in the open system. Slug feed No. 471 to the sump of water cooling towers.

H-C TREATMENT NO. 471

Active ingredients	66 percent
Disodium cyanodithioimidocarbonate	4.8 percent
Potassium N-methyldithiocarbamate	6.76 percent
Inert Ingredients	88.34 percent
	100.00 percent

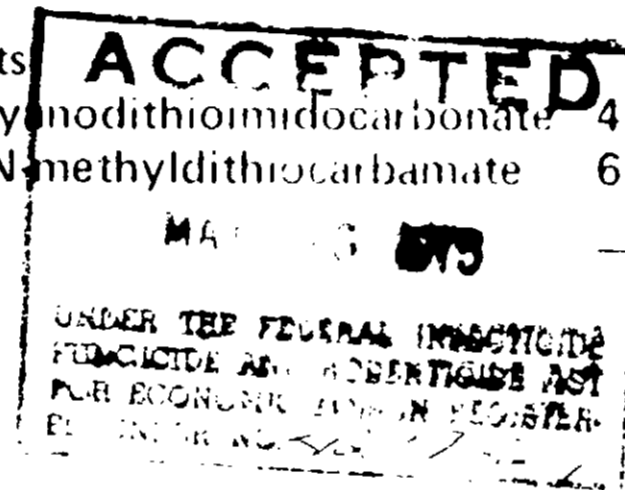

Net Volume _____ Gallons

EPA REGISTRATION NO. 4297-29

WARNING

KEEP OUT OF REACH OF CHILDREN
SEE RIGHT PANEL FOR ADDITIONAL
PRECAUTIONARY STATEMENTS

FIRST AID. If swallowed, give patient doses of powdered charcoal immediately or all he can swallow of raw egg white, milk, gruel or flour and water. Then induce vomiting with salt, soap or mustard in water. Call a physician immediately. Do not reuse empty drum. Return to drum reconditioner or destroy by perforating or crushing and burying in a safe place. Do not contaminate water by cleaning of equipment or disposal of wastes. This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply this product only as specified on this label.

FOR INDUSTRIAL USE ONLY



RELIANCE-BROOKS, Incorporated

CLEVELAND, OHIO


TORONTO, ONTARIO

Applications

H-C Treatment No. 471 is used to inhibit the growth of algae bacteria and fungi in recirculating commercial and industrial cooling water systems. Before treatment with H-C Treatment No. 471 systems must be cleaned to remove algal growth, microbial slime and other deposits. The system should be treated with an initial slug of 5.1 to 10.2 fluid ounces of H-C Treatment No. 471 per 1000 gallons of water. Repeat the initial dosage until control is evident. Subsequent slug additions 1.7 to 10.2 fluid ounces of No. 471 per 1000 gallons of water should be made every 1 to 5 days or as required. Frequency of treatment depends upon relative bleedoff and microbial activity in the open system. Slug feed No. 471 to the sump of water cooling towers.

H-C TREATMENT NO. 471

Active ingredients	ACCEPTED	11.66 percent
Disodium cy	nodithioimidocarbonate	4.90 percent
Potassium N	methyldithiocarbamate	6.76 percent
Inert Ingredients		88.34 percent
		100.00 percent

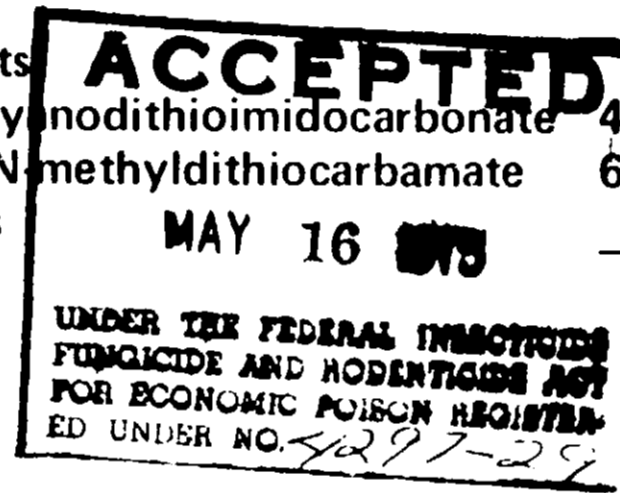

Net Volume _____ Gallons

EPA REGISTRATION NO. 4297-29

WARNING

KEEP OUT OF REACH OF CHILDREN
SEE RIGHT PANEL FOR ADDITIONAL
PRECAUTIONARY STATEMENTS

Precautions

Causes eye damage and skin irritation. Do not get in eyes, on skin or on clothing. Wear goggles or face shield and rubber gloves when handling. Harmful or fatal if swallowed. Avoid contamination of food.

FIRST AID: In case of contact immediately flush eyes or skin with large volumes of water for at least 15 minutes. For eyes, call a physician. Remove and wash contaminated clothing before reuse.

If swallowed, give patient doses of powdered charcoal immediately or all he can swallow of raw egg white, milk, gruel or flour and water. Then induce vomiting with salt, soap or mustard in water. Call a physician immediately. Do not reuse empty drum. Return to drum reconditioner or destroy by perforating or crushing and burying in a safe place. Do not contaminate water by cleaning of equipment or disposal of wastes. This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply this product only as specified on this label.

FOR INDUSTRIAL USE ONLY