

# FOR MILKING EQUIPMENT:

## CLEANING OPERATIONS:

- 1 Immediately after each milking, thoroughly flush all utensils and milking machines with cold or lukewarm water until ALL the milk is washed out. DO NOT use hot water.
- 2 Fill wash tank with lukewarm water (90 F) to which is added one (1) ounce of this product for each five (5) gallons of water. (Provides 25 ppm titratable iodine.)
- 3 Taking milking machines apart. Immerse air-hoses, inflations, and all parts except pulsator, in solution before brushing. Wash pails and strainers in same solution.

## GERMICIDAL OPERATIONS:


- 4 In the rinse tank, add one-half ounce of this product for each five (5) gallons of lukewarm water to assist in preventing recontamination of sanitized equipment by contaminated rinse water and by possible carry-over of organic matter from the wash tank. (Provides 12.5 ppm titratable iodine.)
- 5 Immerse washed utensils and milking machine parts in the rinse tank solution for at least two (2) minutes. Drain thoroughly and rinse.
- 6 Before each milking, assemble and flush machines with a solution containing one-half ounce of this product to five (5) gallons of cold water. (Provides 12.5 ppm titratable iodine.)

**NOTE:** Use freshly made solutions for each morning and night milking. Where Health Departments require dismantling twice a day, the same method would be used at night as in the morning.

Follow State and Local Health Department requirements covering cleaning and sanitizing.

**IMPORTANT:** This Product is its own indicator of germicidal activity. The amber or yellow color shows the presence of the active ingredient iodine. When the color fades, prepare a fresh solution. This product is not adversely affected by water hardness or cold water.

In any dilution, this product will not corrode stainless steel, rubber, or commonly used plastics.

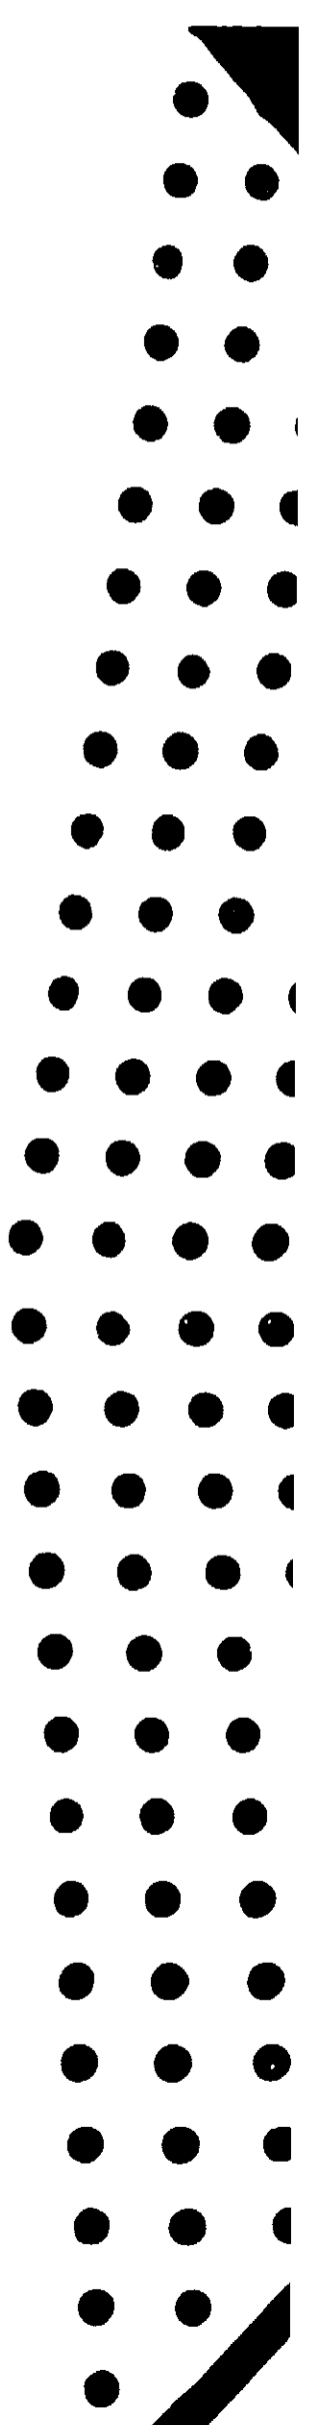

milking  
ed out.

one (1)  
ides 25

all parts  
iners in

(5) gal-  
of sani-  
y-over of  
iodine.)  
se tank

ion con-  
d water.

g. Where  
e method

sanitizing.  
amber or  
ent iodine  
uct is not

only used

# BEAVER



Cameraman's Note

Poor Copy

NET CONTENTS ONE GALLON

# IOCIDIDE

**CLEANER · SANITIZER · MILKSTONE PREVENTIVE · UDDER WASH**

**ACTIVE INGREDIENTS:**

1,3-Dichloro-5,5-Dimethylpiperidinium Hexahydroxyisocyanurate Complex 6.43

1,3-Dichloro-5,5-Dimethylpiperidinium Hexahydroxyisocyanurate Complex 12.62

Providing 15.4% Tetratable Iodine

Phosphoric Acid

16.00%

**INERT INGREDIENTS**

64.95

**CAUTION:** KEEP OUT OF REACH OF CHILDREN

See Side Panel for Additional Cautions

4462-9

4462-9

## FOR FARM BULK TANK:

### CLEANING OPERATIONS:

1. Flush with lukewarm water until ALL milk is washed out.
2. Wash with solution—one (1) ounce of this product to five (5) gallons cold water. (Provides 25 ppm titratable iodine.)
3. Brush thoroughly, drain, and rinse for 2 minutes.

### GERMICIDAL OPERATIONS:

(Where Code permits), brush or spray the tank with a solution of one-quarter ounce of this product to a 10-quart pail of cold water. (Provides 12.5 ppm titratable iodine.)

**FOR UDDERS:** Use a clean paper towel for each cow. Wet in a solution of one-half ounce this product to a 10-quart pail of lukewarm water (90 F). (Provides 25 ppm titratable iodine.)

**FOR MILK STONE REMOVAL:** Should yellow color show on equipment after the first use of this product, milk stone is indicated. Remove it, using a solution of equal parts of this product and lukewarm water. Spread over surfaces to be cleaned; wait 2 to 3 minutes; then brush and rinse. The daily use of this product will prevent the formation of milk stone.

**WARNING:** Avoid contamination of food. Use of this product may cause skin irritation or damage to eyes. Avoid contact with skin and eyes. May be harmful if swallowed. In case of contact, flush immediately with plenty of water. For eyes, get medical attention.

USDA Reg No 4462-9  
B-325

U.S. Patent Nos.: 2,931,777, 2,977,315, 3,028,299

06668

N12-182

MANUFACTURED BY  
**BEAVER CHEMICAL CO., INC.**  
STOCKTON, CALIFORNIA