

UOP®

K-70® ALGAECIDE

APPLICATION UOP K-70 Algaecide is used to control algae in recirculating commercial and industrial water cooling towers. Badly fouled systems must be cleaned before treatment is begun. An initial slug addition of 16.0 to 24.0 oz. AV. of this product per 1000 gallons of water (18-27 ppm of active ingredient) is recommended. Repeat until control is achieved. Subsequent slug additions of 6.0 to 10.0 oz. AV. of UOP K-70 per 1000 gallons of water (6.75-11.25 ppm of active ingredient) should be employed every 2 to 5 days or as needed. The frequency of addition depends on the relative amount of bleedoff and the severity of the microbiological problem. Additions should be made in an area of good circulation to assure proper mixing.

Begin treatment when the system is in jeopardy of becoming affected or after cleaning systems whose efficiency is already impaired. LPA Reg. No. 5135-17

Water Services Division

Universal Oil Products Company

700 South Milwaukee Avenue, Chicago, Illinois 60606

UOP

ACCEPTED

February 7, 1973

5135-17

ACTIVE INGREDIENT

Lithium hypochlorite.....

INERT INGREDIENTS.....

WARNING: KEEP OUT OF REACH

Harmful if swallowed. May produce severe irritation if it gets on skin or in eyes. In case of contact with eyes, flush with plenty of water. If irritation persists, get medical attention immediately.

ANTIDOTE: If swallowed, drink milk or rice gruel. Follow with 15-20 ml. of mustard in glass of warm water.

This product is toxic to fish. Do not discharge where it will pollute streams, ponds, or public water supplies as specified on this label.

Do not reuse container. Destroy

ALGAECIDE


Algaecide is used to control algae in commercial and industrial water cooling systems must be cleaned before initial slug addition of 16.0 to 32.0 (oz. of active ingredient) is recommended. Repeat treatments of 16.0 to 32.0 (oz. of active ingredient) should be made every 7 to 14 days or as needed. The frequency of treatment depends on the relative amount of bleedoff and the microbiological problem. Use in an area of good circulation.

If the system is in jeopardy of failure after cleaning systems whose circulation is impaired. EPA Reg. No. 5135-17

Division

Company

1 • Pleasanton, California 94566

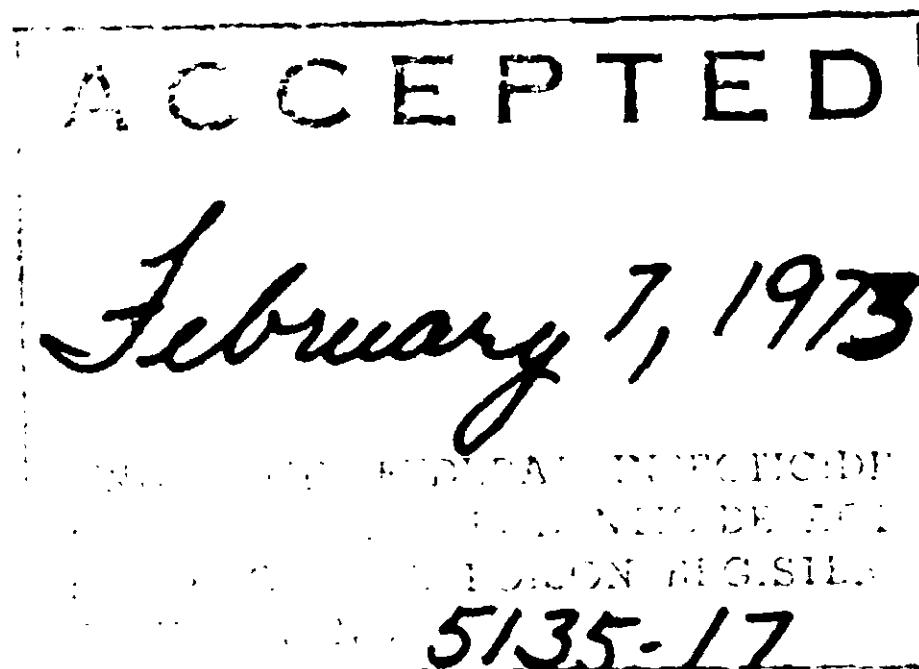

Water

UOP

ACTIVE INGREDIENT

Lithium hypochlorite.....15.0%

INERT INGREDIENTS.....85.0%

WARNING: KEEP OUT OF REACH OF CHILDREN.

Harmful if swallowed. May produce chemical burns. Do not get on skin or in eyes. In case of contact with skin and eyes, flush with plenty of water. If skin irritation persists, get medical attention. For eyes, get prompt medical attention.

ANTIDOTE: If swallowed, drink mucilage, raw egg whites, milk or rice gruel. Follow with emetic (tablespoon of mustard in glass of warm water). Call physician.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply this product only as specified on this label.

Do not reuse container. Destroy when empty.

NET WEIGHT: LBS.