


# bioMET\* 630

## Disinfectant

and for fogging applications

Tuberculocidal  
Bactericidal

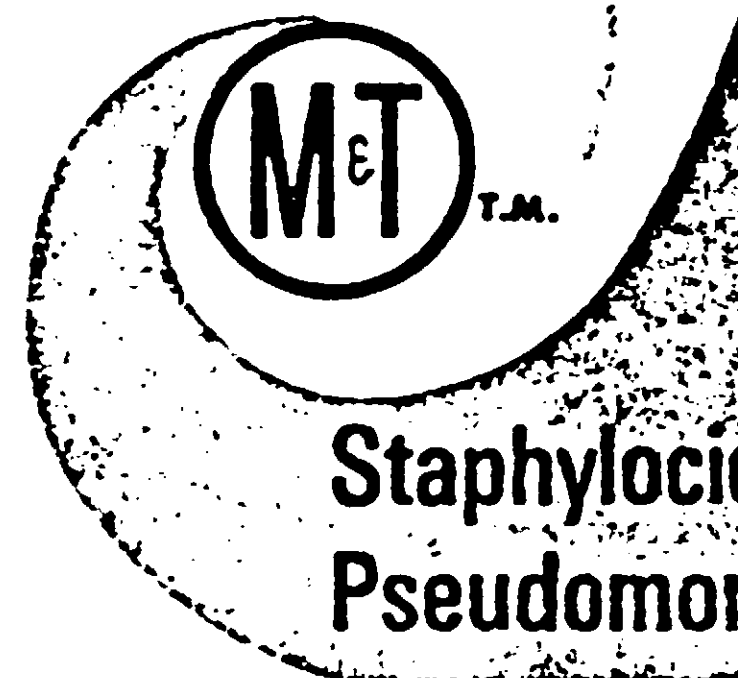

Staphylocidal  
Pseudomonacidal

ACCEPTED  
8-27-70  
UNDER THE FEDERAL INSECTICIDE  
FUNGICIDE AND RODENTICIDE ACT  
FOR ECONOMIC POISON REGISTER-  
ED UNDER NO. ~~5204-43~~

### ACTIVE INGREDIENTS


- Diisobutylphenoxyethoxyethyl  
dimethyl benzyl ammonium  
chloride monohydrate ..... 0.30%
- Isopropanol ..... 0.11%
- Tri-n-butyltin benzoate ..... 0.04%  
(equivalent to metallic  
tin 0.01%)
- INERT INGREDIENTS ..... 99.55%

*Comment*

CAUTION! KEEP OUT OF REACH OF CHILDREN

Read side panel for additional caution.

**M&T Chemicals Inc.**  
SUBSIDIARY OF AMERICAN CAN COMPANY  
General Offices: Rahway, N. J. 07065

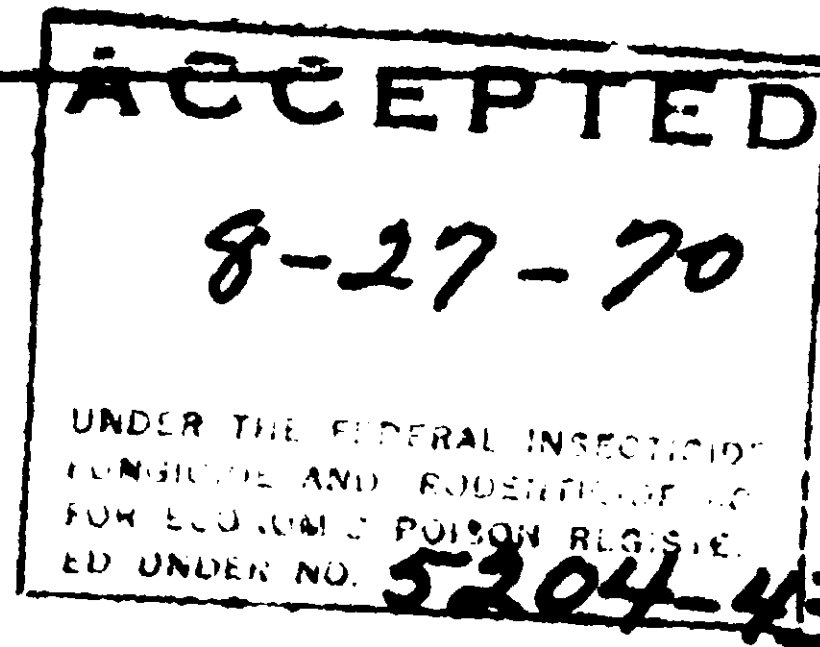

*Comment*

As dispensed through the bioMeT\* Fogger-Dryer, bioMeT\* 630 is a durable, fast-acting formulation designed for use in hospital rooms. It provides significantly improved efficiency in room sanitization when used as an adjunct to normal hospital surface cleaning and disinfecting routines. This product is recommended for use in conjunction with bioMeT\* 611 Disinfectant.

When used as directed for fogging, bioMeT 630 is efficiently deposited by the bioMeT Fogger-Dryer on the floor and every wall, corner, and surface in the hospital room. It reaches areas which may be inaccessible, inconvenient to - or even ignored by - a cleaning crew.

DIRECTIONS FOR USE

A. In Manual Cleaning and Disinfecting

Wearing rubber gloves, apply bioMeT\* 630 Disinfectant undiluted with a sponge or cloth, thoroughly wetting the surface to be disinfected. Maintain a wetted

which may be inaccessible, inconvenient to -  
or even ignored by - a cleaning crew.

### DIRECTIONS FOR USE

#### A. In Manual Cleaning and Disinfecting

Wearing rubber gloves, apply bioMeT\* 630 Disinfectant undiluted with a sponge or cloth, thoroughly wetting the surface to be disinfected. Maintain a wetted surface for at least 10 minutes to insure tuberculocidal action. Allow bioMeT 630 Disinfectant to air dry. bioMeT 630 Disinfectant is recommended for disinfecting a variety of hard surfaces in the hospital which includes walls, tables, dressers and nightstands.

#### B. In Fogging Applications - as an adjunct to manual cleaning and disinfecting.

1. Pour the contents of this container - undiluted - into the one gallon reservoir of the bioMeT Fogger-Dryer.
2. Follow the directions on the bioMeT Fogger-Dryer for the operation of the machine.

**ACCEPTED**  
8-27-70  
UNDER THE FEDERAL INSECTICIDE  
FUNGICIDE AND RODENTICIDE ACT  
FOR ECONOMIC POISON REGISTERED  
ED UNDER NO. 520443

**CAUTION! MAY CAUSE EYE AND SKIN IRRITATION**

Avoid contact with eyes, skin and clothing.  
Avoid inhalation of spray mist.  
Avoid contamination of food.  
In case of contact, flush eyes with water  
for 15 minutes; get medical attention.  
In case of contact, wash skin with soap  
and water.  
Vacate rooms occupied by patients, infants,  
or children before fogging.

**CONTENTS:**  
1 gallon liquid.

C

# bioMeT\*

## FOGGER - DRYER

### INSTRUCTIONS

1. Use only bioMeT\* 630 Disinfectant in this machine.
2. Remove the fogger head from the tank by releasing the two clamps. Then fill the tank using one gallon of bioMeT 630 Disinfectant. Replace the head and fasten clamps. Correct position of head is about 30° below horizontal - nozzle end down.
3. Be sure switch on side of fogger head is in OFF position.
4. Position the machine in the center or near center of room. Insert plug in 110-120 volt AC or DC outlet.
5. Open all dresser drawers, closets and bath. Close all windows; leave venetian blinds lowered with slats in "open" position. Close drapes.
6. Set fogger dial. Use 3 minute setting for average room. For small rooms, fog 2 minutes; larger rooms, fog 4 minutes or longer. There is a built-in 10 minute delay after fogging stops and drying starts.
7. Set dryer dial at 15 minutes.  
**WARNING:** Before turning on switch be sure nozzles are pointing away from operator and door to room.
8. Turn on switch located on side of fogger head. Spray starts immediately. Leave room; close door.
9. Avoid inhaling fog. Avoid re-entering room until drying cycle has been completed as indicated when light on machine turns off. If room is not dry reset dryer dial. Wash filters every 2 weeks replace filters every 6 months.

ACCEPTED WITH COMMENTS

Manufactured for M&T Chemicals Inc., by  
New Corporation, Staatsburgh, N. Y.



**M&T Chemicals Inc. 8-21**

General Offices, Rahway, N. J. 07065

\*Trademark of M&T Chemicals Inc.

