

ANTIDOTE

• Remove victim to tresh air immediately. • Keep victim lying down and wirm. • Cover curtificial respirator of breithing has stopped. • Call a physician immediately

TUNNOFR

Warning Pasonous liquid and vapor

• Vapors can be tatal at inhaled. • Contact with methyl brounder an cause burns. • Do not get in eyes, on dam, or or clothing. • In case of contact wash dan thoroughly with soap and water for at least 15 members. Remove contaminated clothes and shoes immediately and thoroughly agrate before reuse. • Get medical attention. • Brom O-Gas 177 is not to be stored in or around the home. • Brom O Cas 1.7 is not to be used in or around dwellings except by pest control operators.

NOTE: Soller workers that the product of them to to be modified uptomaridas reasonably. and the the propose that the term takes with a contract of a contract with the term and the term of and the control of the first of the control of the and providing the providing the second providing the contract of the contract of the contract of the contract of

BROM-O-GAS

CONTAINS 1% CHLOROPICRIN

ACTIVE INGREDIENTS

99% 100° _o Total



POISON


NOT CHARGE THORE . FOR AN OF THE CALLMINGS ON MOTEPANELS.

NET WEIGHT

LBS

EPA Reg. No



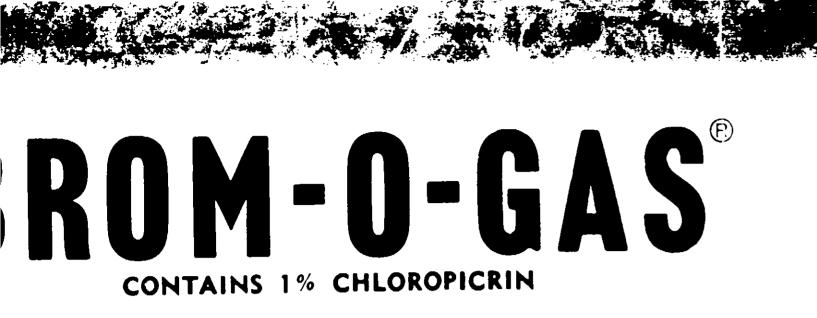

ACTIVE INGREDIENTS

 Methyl bromide
 99%

 Chloropicrin
 1%

 Total
 100%



DANGER




KEEP OUT OF REACH OF CHILDREN POISON

TOT INHALE VAPORS . SEE ANTIDOTE & WARNINGS ON SIDE PANELS.

LBS.

EPA Reg. No. 5785 7 AA

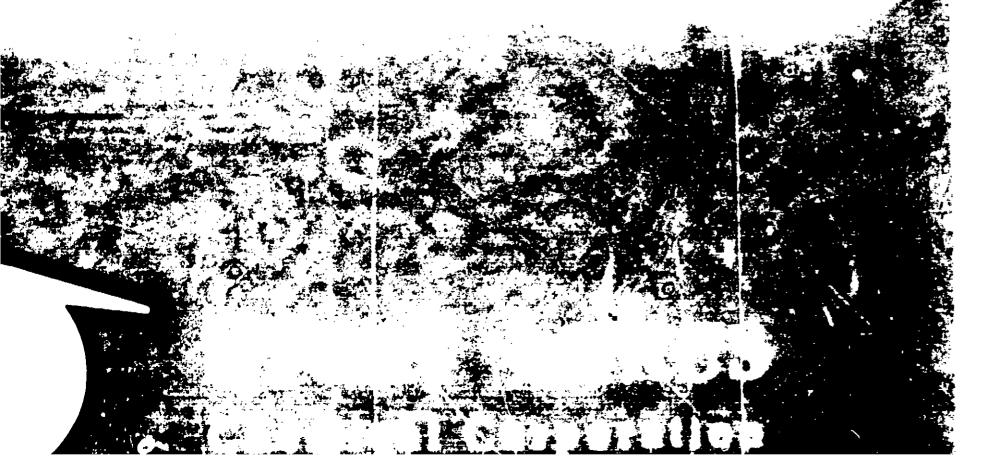

GENERAL FUMIGATION DIRECTIONS COMMODITY FUMIGATION

This fumigant may be used in box cars, warehouses, fumigation vaults, food and cereal mills, ships and bulk grain storages. Do not fumigate if grain moisture is high, or if grain temperature is low (below 60 F.) or if there is excessive dockage.

- INSECTS CONTROLLED: Granary weevil, grain beetle, rice weevil, cadelles, mites, bran bugs, grain borers, mealworms, Indian meal moth. Kills insects in all life stages.
- SPACE FUMIGATION: The dosage rate for each 1000 cu. ft. will range from 1 to 3 lbs., 12 to 24 hours exposure, depending on tightness of structure and kind and amount of commodity in storage.
- BULK GRAIN DOSAGE RATES: (General) above 65° F.

Shelled corn

Wheat (similar small grains)

Milo (grain sorghum)

2 lbs. each 1000 cu. ft.

3 lbs. each 1000 cu. ft.

4 lbs. each 1000 cu. ft.

Do not use dosages higher than recommended as this may in some cases result in residues in excess of those permitted. Do not fumigate food products other than those specified in directions.

Consult Bulletin GLK 128 (Rev.) for further use and safety information.

DWELLING FUMIGATION (Pest control operators only)

DIRECTIONS: Dwelling to be furnigated is made gas-tight using a tarpaulin which has been staked and/or earth mounds placed on the ends of the tarpaulin. Area to be furnigated is calculated and the Brom-O-Gas introduced. Dwelling is to be posted showing date of furnigation. Following furnigation, dwelling is to be ventilated for several hours or until testing with a halide leak detector indicates dwelling has been aerated. Subterranean termites in tunnels will not be controlled unless gas is introduced into those areas by a special procedure.

INSECTS CONTROLLED: Drywood ternites, wood borers, and any other insects (cockroaches, fleas, spiders) in gas-tight fumigated dwelling. Brom-O Gas will control all insects within the treated structure.

RATS AND MICE: Brom O Gas applied by this treatment will kill rats and mice that are exposed to the gas.

DOSAGE RATE: The dosage rate for each 1000 cu. ft. will range from 1 to 3 lbs., and 12 to 24 hours exposure.

 $\sim \chi_{\rm c} / \tau_{\rm c} \sim 1$ Extinguish all flames such as sulot lights and glowing heating units to avoid corrosion.

REMOVE: All pets, furs, horsehair articles, patent leather articles, rubber goods, synthetic detergents and photographic materials.

used with a full-faced gas mask when releasing gas in buildings and when opening up for aeration after fumigation. Protective masks and canisters should be types approved by the U.S. Bureau of Mines. Use halide leak detector to determine thoroughness of aeration.

CAUTION

- Be sure container is closed completely. Store in a cool, well ventilated place.
- Empty cylinders should be returned to opticoliect to Great Lakes Characa