JSE

in one operation, ctant to 5 gallons litty surfaces, use this dosage exceeds a potable water food handling sur-Food Additive

faces, use 1 ounce llons of water. At use before reuse is ble iodine limit is Federal Food Addi-.2547.

cator of germicidal ppears, a fresh is not adversely appearatures. Product unces to 5 gallons

mmended above in morgues, laboras, bedframes, walls i, rubber gloves, 10 minutes contact es with potable ing, instruments wring blood and

UTIONS, AND sunces of Fremont er for cleaning and , shower rooms, reunch rooms. Rinse able water before

ounce of Fremont iter is used on iter rinse is required rederal Food

FREMONT 9933 DISINFECTANT

Recommended for cleaning, disinfecting, and sanitizing in hospitals, institutions, food plants, and commercial buildings.

*ACTIVE INGREDIENTS:

Alpha-(p-Nonylphenyl)-omega-hydroxypoly (oxyethylene)-iodine complex . . . 18.05%

Phosphoric Acid 16.00%

*Provides 1.75% Titratable lodine.

EPA Establishment No. 7053-MN-1.

EPA Registration No. 7053-21.

U.S. PATENT NOS. 3,028,299 2,977,315 2,931,777

NET WEIGHT

NET VOLUME

FREMONT INDUSTRIES, INC. Box 67, Shakopee, Minnesota 55379

DANGER

KEEP OUT OF REACH OF CHILDREN. SEE RIGHT PANEL FOR ADDITIONAL PRECAUTIONARY STATEMENTS AND FIRST AID.

FOR INDUSTRIAL USE ONLY

DANGER

CORROSIVE. CAUSES EYE DAMAGE AND SKIN IRRITATION. Do not get in eyes, on skin or on clothing. Wear goggles or face shield and rubber gloves when handling. Harmful if swallowed. Avoid contamination of food.

FIRST AID

In case of contact, immediately flush eyes or skin with plenty of water for at least 15 minutes. For eyes, call a physician. Remove and wash contaminated clothing before reuse. If swallowed, drink promptly a large quantity of milk, egg whites, gelatin solution or if these are not available, drink large quantities of water. Call a physician immediately.

NOTE TO PHYSICIAN:

Probable mucosal damage may contraindicate the use of gastric lavage. Measures against circulatory shock, respiratory depression and convulsion maybe needed.

STORAGE AND HANDLING:

Wear all protective equipment when handling. Avoid freezing. If frozen, return slowly to room temperature and mix thoroughly before using. Keep container closed when not in use. Rinse empty container thoroughly with water before discarding. Apply product only as specified on the label.



DIRECTIONS FOR USE:

SANITIZING BUILDINGS AND EQUIPMENT ON THE FARM: To sanitize surfaces of buildings, equipment, or utensils which have previously been thoroughly cleaned, use 1 ounce of Fremont 9932 Disinfectant in 5 gallons of water. Spray or swab solution on surfaces to be sanitized. Allow to drain dry without rinsing.

SANITIZING POULTRY DRINKING WATER: Add 1 cunce of Fremont 9932 Disinfectant to every 10 gallons of drinking water. The regular use in the drinking water also helps keep the waterers free of slime and mineral deposits.

FOOD PLANT SANITIZATION: Use 1 cunce of Fremant 9932 Disinfectant in each 5 gallons of water as the final sanitizing rinse on previously-cleaned food-processing equipment and utensils. Drain, but do not rinse. When used at this dilution (1:640), Fremant 9932 Disinfectant does not require a final potable water rinse, as prescribed in Federal Food Additive Regulation 121.2547.

SHOE BATH: To help prevent tracking disease organisms into poultry houses, farrowing houses, and hag barns, place a show bath inside the doorway, containing 3 ounces of Fremont 9932 Disinfectant per gallon of water. After scraping shoes outside doorway, stand in shoe bath for 30 seconds prior to entering building interior. Change shoe bath daily.

DEODORANT: Fremont 9932 Disinfectant destroys many odors as it sanitizes and disinfects. For general deodorant applications (garbage pails, refuse containers, etc.), swab or spray on a solution of 1 ounce of disinfectant per gallon of water.

CLEANING AND DISINFECTING BUILDINGS AND EQUIP-MENT ON THE FARM: BEFORE PROCEEDING AS INDICATED BELOW, remove all animals and feeds from premises, cars, boats, trucks, and other equipment. Remove all litter and manure from floors, walls, and surfaces of barns, pens, stalls, chutes, and other facilities and fixtures occupied or traversed by animals. Empty all troughs, racks, and other feeding and watering appliances, saturating all surfaces with Fremont 9932 Disinfectant solution. Immerse all halters, ropes, and other types of equipment used in handling and restraining animals, as well as forks, shovels, and scrapers. Ventilate buildings, cars, boats, and other closed spaces. Do not house livestock or employ equipment until treatment has been absorbed, set, or dried. All treated feed racks, mangers, troughs, automatic feeders, fountains, and waterers must be thoroughly rinsed with potable water prior to reuse.

THEN, clean and disinfect in one easy step with Fremont 9932 Disinfectant. Use 1/2 ounce of Fremont 9932 Disinfectant per gallon of water. Scrub surfaces to be cleaned and disinfected with a good brush or with a power sprayer. Start at the highest point of the building or equipment being cleaned, and wark down. Let solution drain dry without rinsing.

FREMONT 9932 DISINFECTANT

* Active Ingredients

EPA Establishment No. 7053-MN-1

EPA Registration No. 7053-22

* Provides 1.75% titratable iodine

U.S. PATENT NOS. 3,028,299 2,977,315 2,931,777

NET WEIGHT

NET VOLUME

FREMONT INDUSTRIES, INC. Box 67, Shakopee, Minnesota 55379

DANGER

KEEP OUT OF REACH OF CHILDREN. SEE RIGHT PANEL FOR ADDITIONAL PRECAUTIONARY STATEMENTS AND FIRST AID.

FOR INDUSTRIAL USE ONLY

DANGER

CAUSES EYE DAMAGE AND SKIN IRRITATION. Do not get in eyes, on skin, or Wear goggles or face shield and rubber gloves when handling. Maybe harmful if so Avoid contamination of food.


FIRST AID

In case of contact, immediately flush eyes or skin with plenty of water for at least For eyes, call a physician. Remove and wash contaminated clothing before reuse. If swallowed, drink promptly a large quantity of milk, egg whites, gelatin solution these are not available, drink large quantities of water. Call a physician immedia

NOTE TO PHYSICIAN: Probable mucosal damage may contraindicate the use of g Measures against circulatory shock, respiratory depression, and convulsions maybe

STORAGE AND HANDLING

Wear all protective equipment when handling. Avoid freezing, if frozen, return stroom temperature and mix thoroughly before using. Keep container closed when no Rinse empty container thoroughly with water before discarding. Apply product only on label.

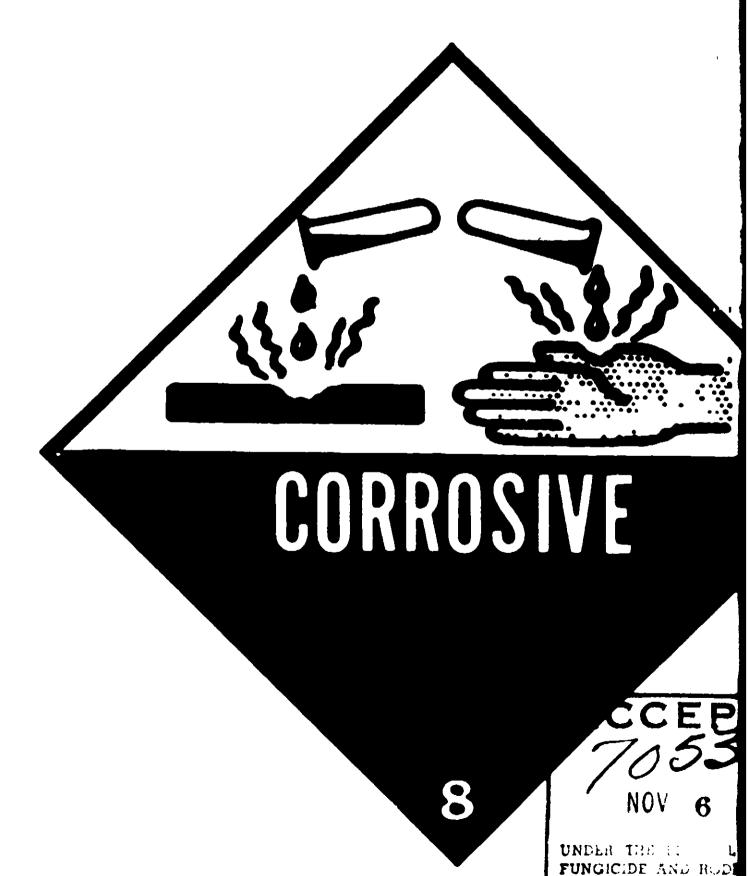

FOR ECONOMIC POIS

ED UNDER NO.