

OR DILUTION

Sanitizer	Titratable Iodine
1 liter	12 1/2 ppm
1 liter	25 ppm
1 liter	50 ppm

labeled under the Food Federal Food Drug and processing equipment titratable iodine, with-able water.

OR USE

Pre-clean equipment. Fill with solution containing 10 ppm titratable iodine). of sanitizing solution and

Pre-clean with water containing 2 ounces of 9931 Sanitizer per 10 gallons of water (provides after five minutes, drain able water.

FLOORS, CONVEYORS, MACHINES: Clean daily with of Fremont 9931 San- (provides 25 ppm titratable t end of batch run with of Fremont 9931 Sanitizer ides 50 ppm titratable

CONTAINERS: To san- erage containers, use a of Fremont 9931 Sanitizer ides 12 1/2 ppm titratable drain, and allow to air-dry.

FREMONT 9931 SANITIZER

A low-foaming iodophor for sanitizing in the beer-bottling, soft drink-bottling, milk-bot- tling, and food-canning industries.

*** ACTIVE INGREDIENTS:**

Butoxy polypropoxy polyethoxy ethanol-iodine complex	12.47%
Polyethoxy polypropoxy polyethoxy ethanol- iodine complex	0.37%

INERT INGREDIENTS:	87.16%
Total	100.00%

* Provides 1.6% titratable iodine

EPA Establishment No. 7053-MN-1

EPA Registration No. 7053-23

U. S. PATENT NOS. 3,650,965 3,028,299

NET WEIGHT

NET VOLUME

FREMONT INDUSTRIES, INC.
Box 67, Shakopee, Minnesota 55379

CAUTION

KEEP OUT OF REACH OF CHILDREN. SEE RIGHT PANEL FOR ADDITIONAL PRECAU- TIONARY STATEMENTS AND FIRST AID.

FOR INDUSTRIAL USE ONLY

CAUTION


Do not get in eyes, on skin or on clothing. Wear goggles or safety glasses and rubber gloves when handling. Maybe harm- ful if swallowed. Avoid contamination of food.

FIRST AID

In case of contact, flush immediately with water for 15 minutes; for eyes, get medical attention. Remove contaminated clothing and wash before reuse. If swallowed, drink promptly a large quantity of milk or if this is not available, large quantities of water and get medical attention.

STORAGE AND HANDLING:

Wear all protective equipment when handling. Avoid freezing, if frozen, return slowly to room temperature and mix thoroughly before using. Keep container closed when not in use. Rinse empty container thoroughly with water before discarding. Apply product only as specified on label.

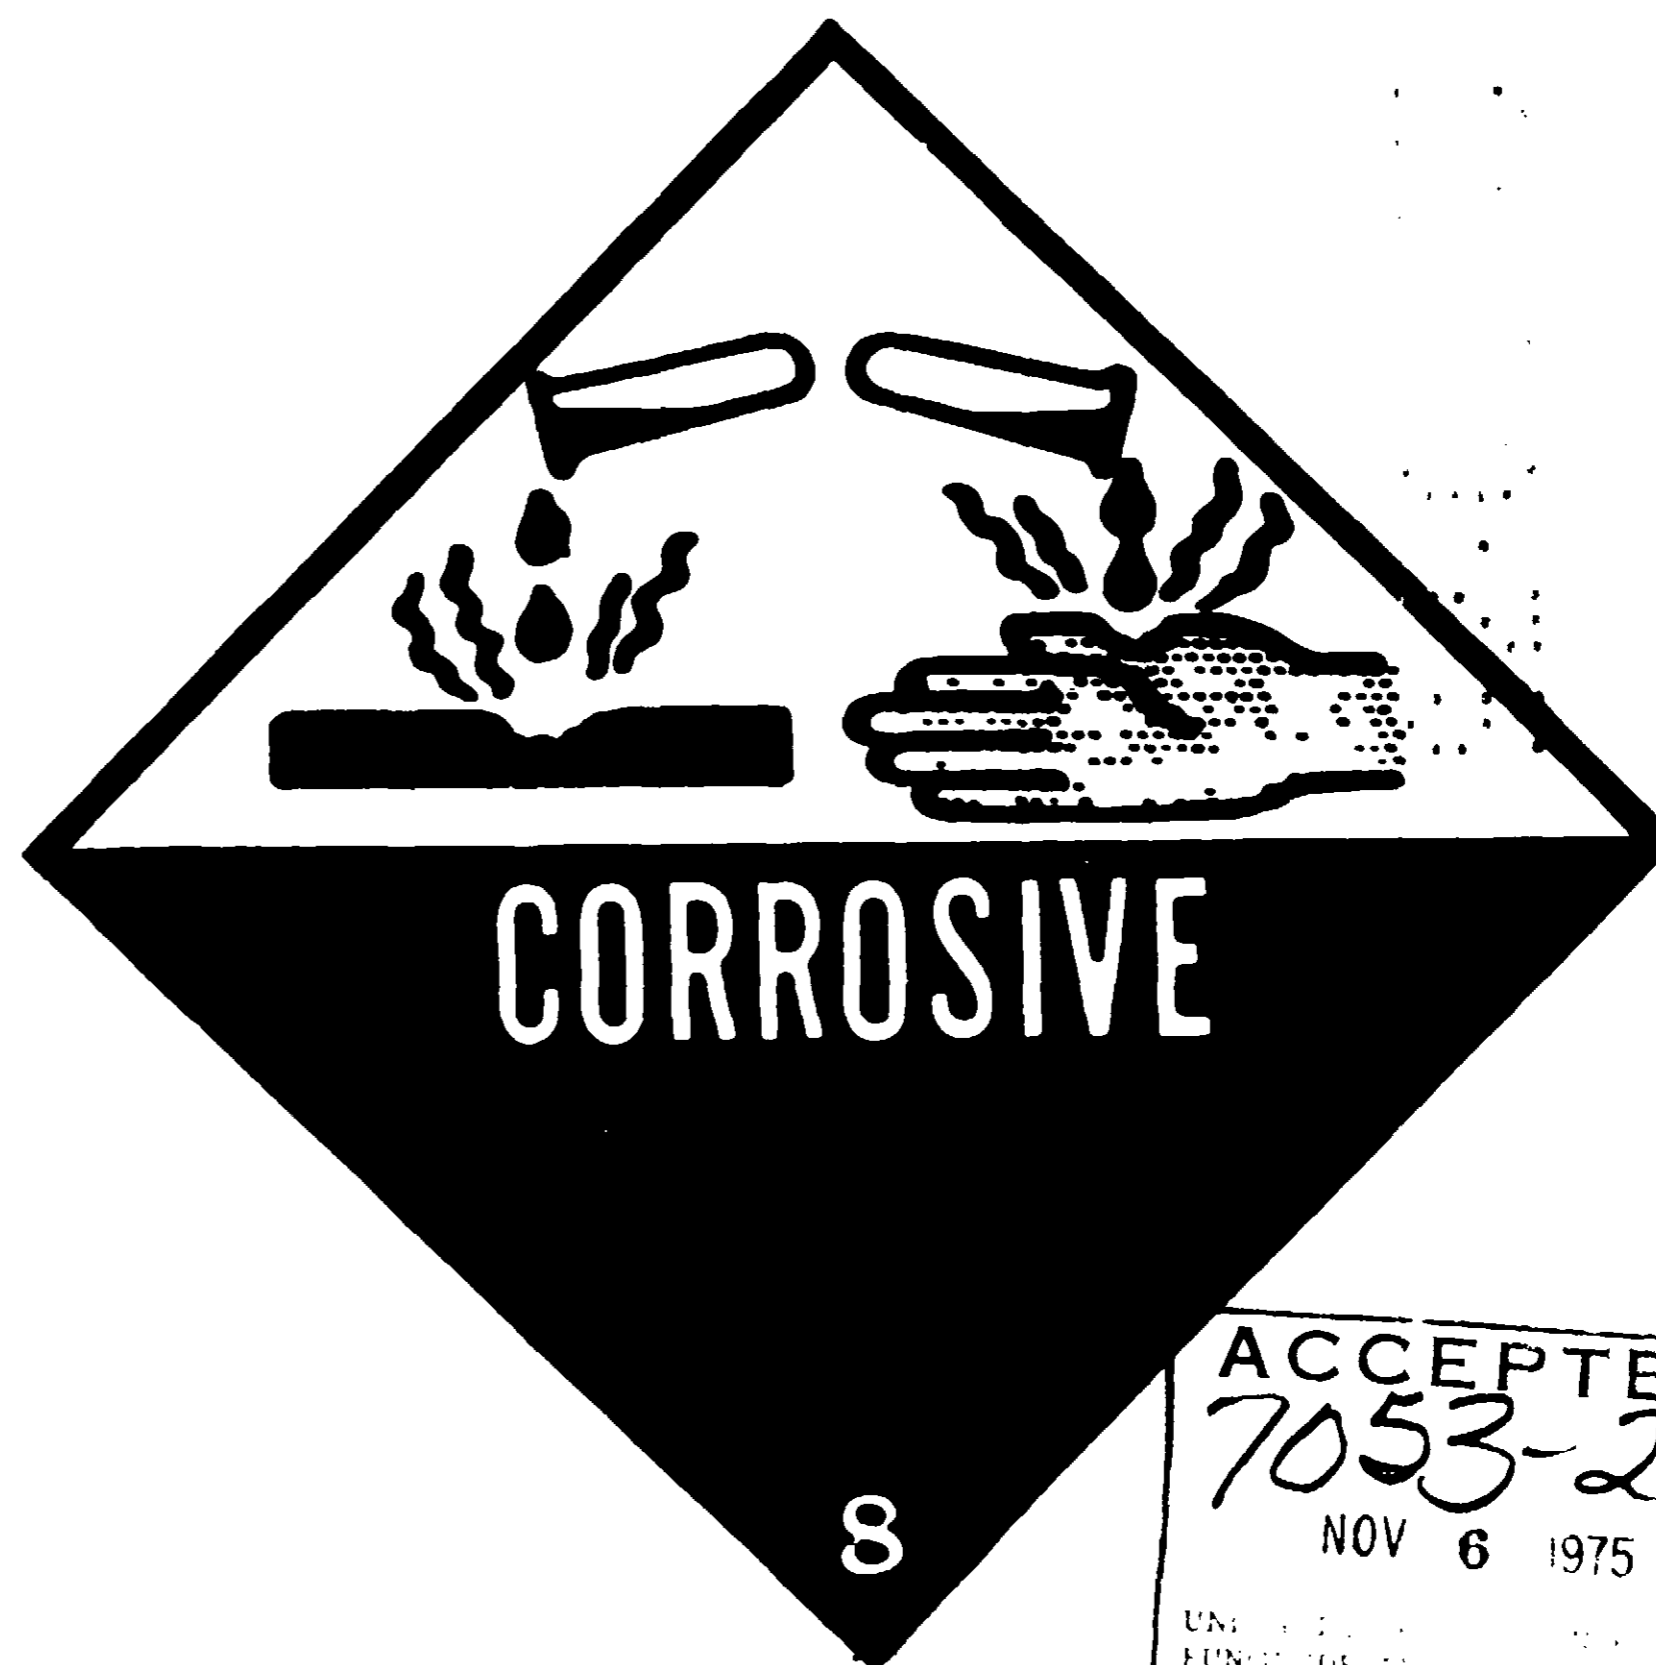

ACCEPTED
7053-23
NOV 6 1975
UNIVERSITY OF MINNESOTA
FUNGICIDE DIVISION
FOR FERTILIZER PERSON REGISTERED
LIT. NO.