

# FORMULA 601

**FOR CONTROL OF ALGAE & BACTERIAL & FUNGAL SLIMES IN INDUSTRIAL RECIRCULATING COOLING TOWERS, AIR WASHERS AND/OR EVAPORATIVE CONDENSERS**

**ACTIVE INGREDIENT** 10.0%  
Sodium salt of dichloro-s-triazinetrione

**INERT INGREDIENTS \*** 90.0%  
\* Includes stabilizing & desiccating agents


## WARNING:

**KEEP AWAY FROM CHILDREN. HARMFUL TO EYES AND SKIN. CONTACT WITH ORGANIC MATTER MAY CAUSE FIRE. WILL BURN WITH EVOLUTION OF CHLORINE & EQUALLY TOXIC GASES.** Avoid breathing dust. Avoid contact with skin or eyes. Do not take internally. Store away from flammable material. **OXIDIZING MATERIAL.** IN CASE OF CONTACT, immediately flood skin or eyes with cold water for at least 15 minutes; for eyes, get medical attention. Re-line polyethylene liner after each use and keep container tightly closed. Store in dry place. Keep containers off wet floors. Sweep up spillage and flush down sewer with LARGE VOLUME of water and provide adequate ventilation. **FOR INDUSTRIAL USE ONLY.** Do not re-use empty drum. Destroy by crushing and burying in a safe place away from water supplies. **DIRECTIONS FOR USE:** INITIAL DOSE: When system is noticeably fouled, apply 1.0 to 2.0 lb. of FORMULA 601 per 1000 gallons of water contained in system. Repeat initial dosage until 1 ppm chlorine residual is established, as determined by a chlorine test kit. **SUBSEQUENT DOSE:** When microbial control is evident, apply 1/2 to 1.0 lb. per 1000 gallons of contained water. Repeat as needed to maintain 1 ppm of chlorine residual in the recirculating water for at least 4 hours. Test water frequently enough to insure proper chlorine residual. This product should be applied to the water basin at a point where good mixing occurs. Badly fouled systems must be cleaned before treatment is begun.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply this product only as specified on this label.

EPA Reg. No. 7547-15

**PLEASE READ  
ANY CAUTION OR  
DIRECTION LABELS  
ON THIS DRUM**

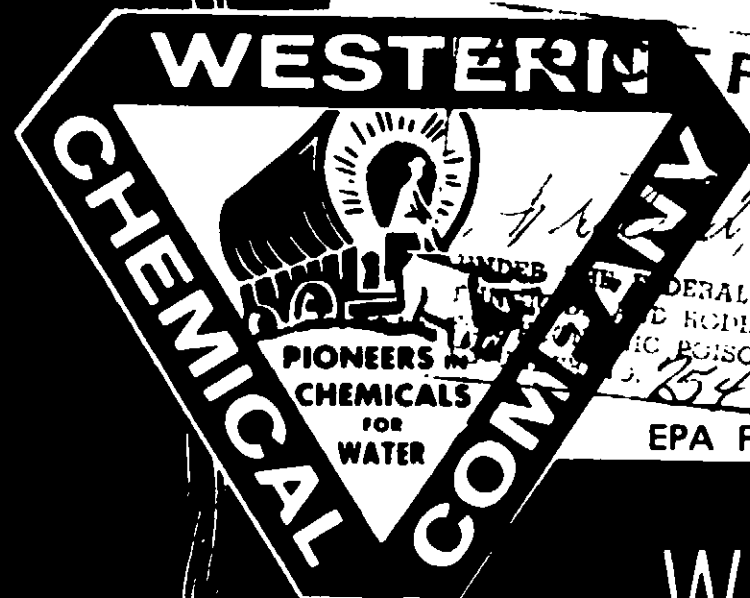


# WESTERN CHEMICAL COMPANY

1345 TANEY  
NORTH KANSAS CITY, MO.  
64116

7347-14

# FORMULA 603

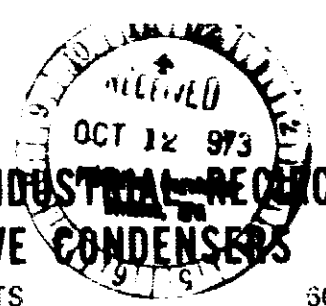


## FOR CONTROL OF ALGAE & BACTERIAL & FUNGAL SLIMES IN INDUSTRIAL RECIRCULATING COOLING TOWERS, AIR WASHERS AND/OR EVAPORATIVE CONDENSERS

ACTIVE INGREDIENT	40.0%	INERT INGREDIENTS	60.0%
<small>Sodium salt of 2,4,6-trichloro-1,3,5-triazine</small>		<small>Propylene Glycol, Propylene Glycol Ether</small>	

### WARNING:

**HARMFUL TO EYES AND SKIN. OXIDIZING MATERIAL. CONTACT WITH ORGANIC MATTER MAY CAUSE FIRE. WILL BURN WITH EVOLUTION OF CHLORINE & EQUALLY TOXIC GASES.** Avoid breathing dust. Avoid contact with skin or eyes. Do not take internally. Store in a cool, dry, well-ventilated area. Keep out of reach of children. IN CASE OF CONTACT immediately flush with water for 15 minutes. If in eyes, flush with water for 15 minutes. If on skin, wash with soap and water. If swallowed, drink water with E-MUCIL 200 (Mylan) or other non-alcoholic liquid. Keep out of reach of children. Do not use in drinking water. **DIRECTIONS FOR USE: INITIAL DOSE** - When system is first installed, add 1.0 ml/l of FORMULA 603 to the recirculating water. Repeat monthly. **SEQUENT DOSE** - Repeat monthly. **RESEQUENT DOSE** - When microbial control is required, add 1.0 ml/l of FORMULA 603 to the recirculating water. Repeat as needed to maintain control.

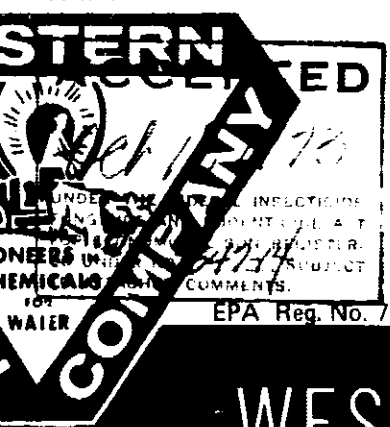

PLEASE READ ANY CAUTION OR DIRECTION LABELS ON THIS DRUM

**WESTERN CHEMICAL COMPANY** 1345 TANEY NORTH KANSAS CITY, MO. 64116