


REMEMBER TO MAIL THE ENCLOSED GUARANTEE REGISTRATION CARD

REMEMBER TO MAIL THE ENCLOSED GUARANTEE REGISTRATION CARD

RECEIVED
Sep 23 1971
7792-1

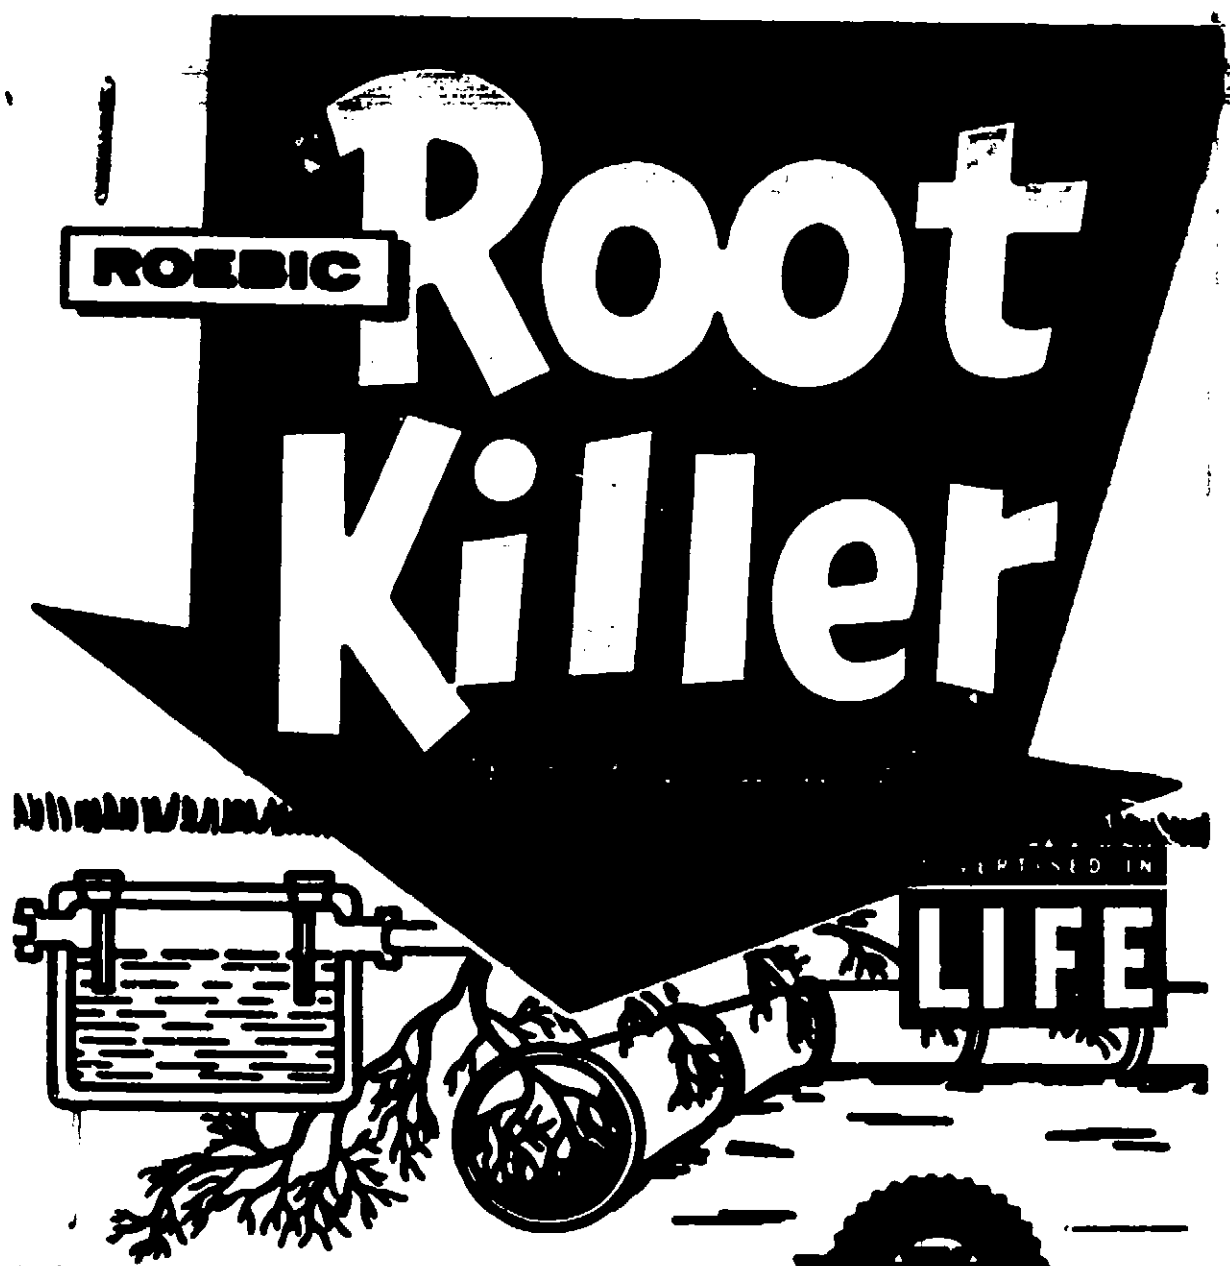

ROEBIC Root Killer

DIRECTIONS

The ideal time to apply ROEBIC Root Killer is before retiring at night, when the use of utilities is low.

IMPORTANT

ROEBIC Root Killer should never be applied through TUB or SINK drains.

FOR SEWER PIPES

Open the plastic container within and pour 1/3 of the crystals into a toilet bowl. Immediately flush the toilet repeatedly until all the crystals have flushed down. Repeat this procedure until the entire contents have been flushed down.

K-77 can also be used through distribution box direct to septic tank drainfield. Add sufficient water by hose or pail to carry crystals to point of root penetration or blockage.




CAUTION
Harmful if taken internally.
Keep out of the reach of children.

USDA Reg. No. 7792-1

ROEBIC LABORATORIES, INC.
383 Sachett Point Road
North Haven, Connecticut

© R. L. M.

SEWER PIPES AND SEPTIC TANK DRAIN FIELDS

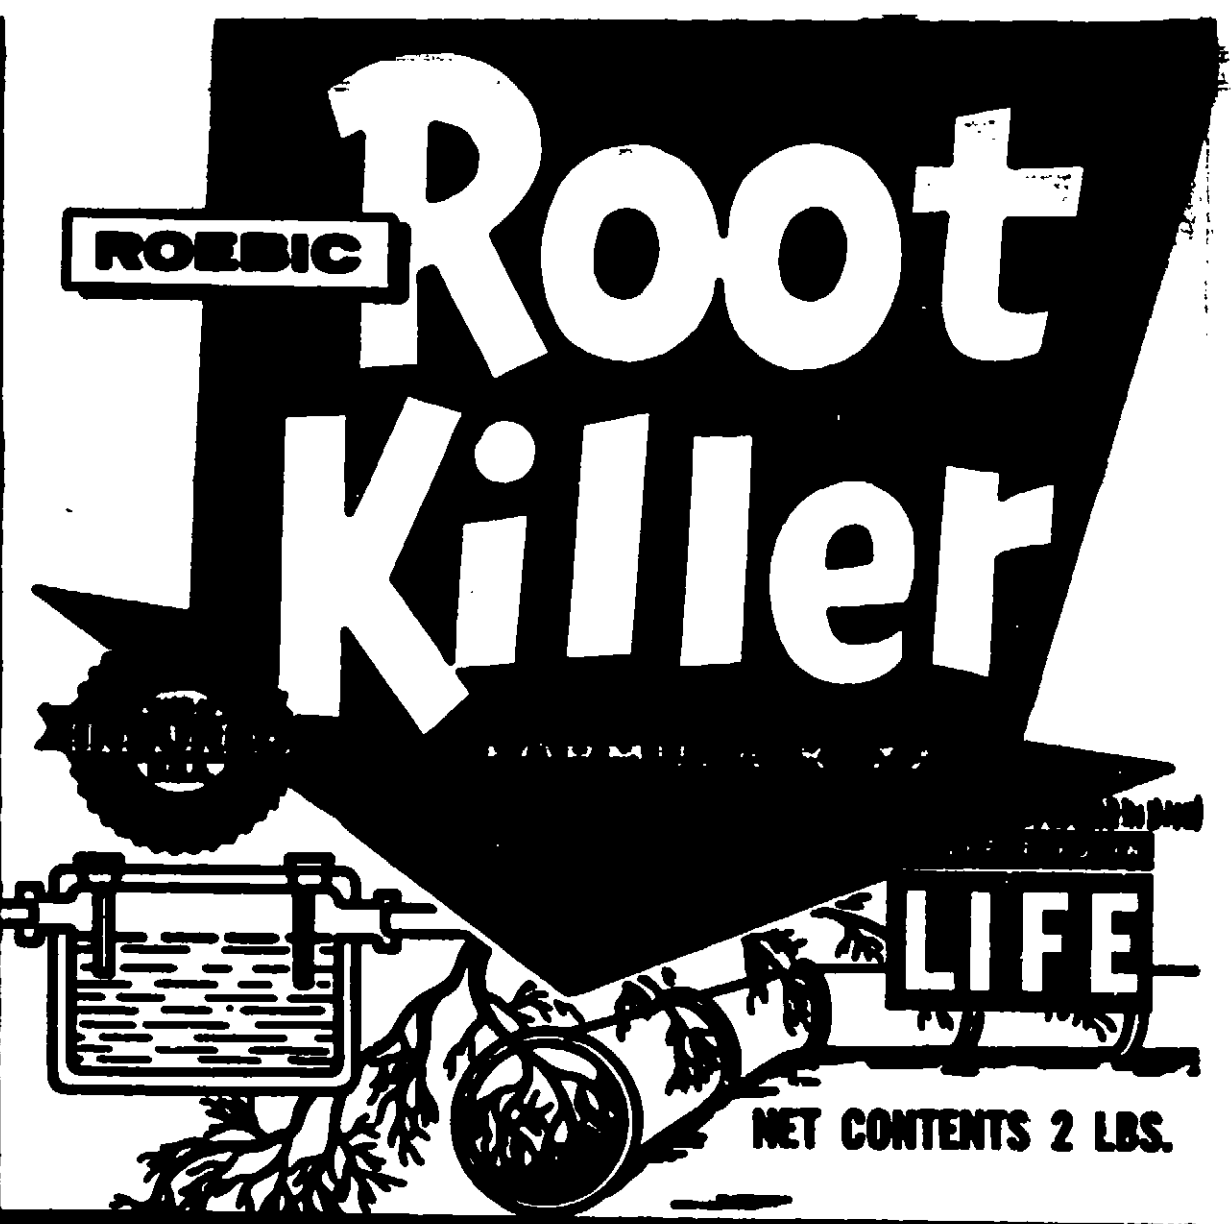

ROEBIC Root Killer

ROEBIC FORMULA K-77 Root Killer

The contents of ROEBIC Root Killer has been tested and proven successful in the control of root penetration for more than 18 years. It is a fast and economical method of preventing tree and shrub roots from causing blockage in pipes.

ROEBIC Root Killer K-77 is very easy to apply. It will not corrode sewer or drain pipes leading into or out of septic tanks or cesspools. It will not harm the necessary bacterial action in septic tanks and cesspools.

ROEBIC Root Killer does its work by attacking and destroying only the roots which have entered into the pipe lines. It prevents the regrowth of these roots at the point of entry.

The lifting of roots in pipes will not damage the trees or shrubs. The use of ROEBIC Root Killer avoids the need to dig down to pipes, clear out roots by hand and then reassemble the pipes.

By keeping pipes clear of roots and fungi, ROEBIC Root Killer prevents the formation of dangerous and odorous gases.

COPPER AS METALLIC NOT LESS THAN 25.20%

SEWER PIPES AND SEPTIC TANK DRAIN FIELDS

A FULL YEARS TREATMENT

ACTIVE INGREDIENT (Copper Sulphate) 99%.
INERT INGREDIENTS 1%.

ACCEPTED WITH COMMENTS