FUNGICIDE AND RODENTICIDE ACT FOR ECONOMIC POISON REGISTERED UNDER NO. 85 UU.15

ntact with moisforeign material

effluent should ain into lakes, not contaminate posal of wastes.


tablets to come he chlorine will or chemicals.

PECIFIED

al followed by all a Physician

with water for al attention. In th water.

EG. NO. 8544-15

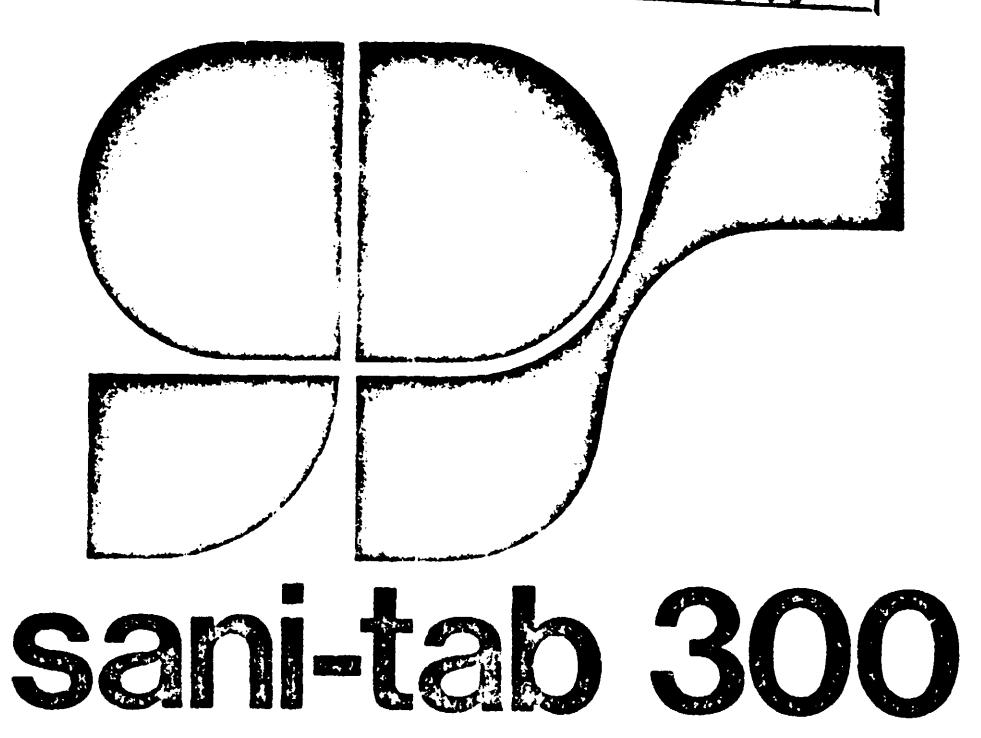

STABILIZED CHLORINE TABLETS

DANGER: Keep out of reach of children.

Corrosive. Causes eye damage. May cause severe burns to broken skin. Causes irritation on wet skin. Do not get in eyes. Avoid prolonged skin contact with tablets. Wash hands thoroughly after handling. May Be Fatal if Swallowed.

KEEP COVER CLOSED WHEN NOT IN USE.

NET WT. Ibs.



INSTRUCTIONS: Stabilize pool with SANI-CLOR Conditioner. If pool is already stabilized, do not add conditioner. Initially treat pool with SANI-CLOR liquid or SANI-CLOR granular chlorine as per label instructions until chlorine level reaches 1.0 to 1.5 ppm on the SANI-TEST Kit. After initial chlorination, add one (1) SANITAB 300 tablet into the skimmer or in a floating dispenser per 10,000 gallons of water daily or as needed. For comfort and effective pool care maintain pH between 7.2 to 7.8. Test pool water frequently with a SANI-TEST chlorine test kit. It will not be necessary to stabilize again as SANI-TAB 300 tablets are self stabilizing.

RINSE EMPTY CONTAINER THOROUGHLY AND DISCARD IT.

GENERAL POOL SUPPLY 8700 Bellanca Avenue, Los Angeles 90045