



ICC W-64

FOR ALGAE CONTROL IN COOLING TOWERS

ACTIVE INGREDIENT:

Poly [oxyethylene (dimethyliminio) ethylene
 . . (dimethyliminio) ethylene dichloride] 14.4%

INERT INGREDIENT 85.6%
 100.0%

CAUTION

KEEP OUT OF REACH OF CHILDREN

See additional cautions on right side panel

Net Gallons

EPA REG. NO: 9594-8

ACCEPTED
 UNDER THE FEDERAL INSECTICIDE AND RODENTICIDE ACT
 ECONOMIC POISON REGISTER
 EPA REG. NO. 9594-8

CAUTION


Harmful if swallowed. Do not get in eyes. Avoid contact with skin. In case of contact, flush with plenty of water for at least 15 minutes. If eye irritation persists, get medical attention. Avoid contamination of food.

Rinse empty container thoroughly with water and discard container.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply ICC W-64 only as specified on this label. Do not contaminate water by cleaning of equipment or disposal of waste.

DIRECTIONS

is used to control algae, bacteria, and fungi in commercial and industrial water cooling towers. For use, systems must be cleaned to remove algal microbiological slime and other deposits. An initial dosage of 4.2 to 11.4 fluid ounces of ICC W-64 per gallon of water to provide a concentration of 33 parts per million of ICC W-64 based on the total water in the system is recommended. Repeat dosage until control is evident. Subsequent dosage of 1.14 to 11.4 fluid ounces of ICC W-64 per gallon of water (8.25 to 82.5 parts per million of ICC W-64) should be employed every 2 to 5 days or as recommended. The frequency of addition depends upon the amount of bleedoff and the severity of the micro-biological problem. Slug additions should be made in the water cooling towers.

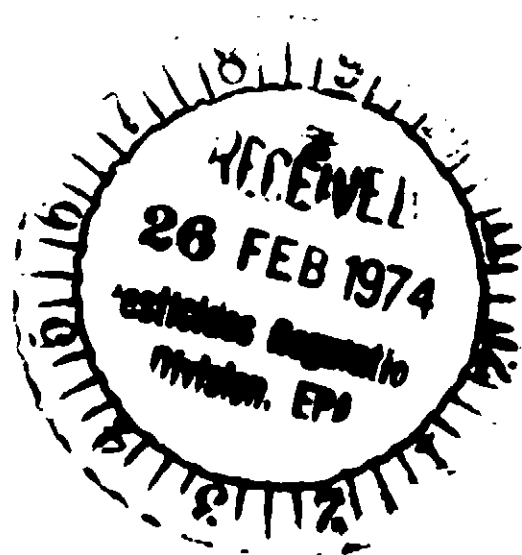

CHEMICALS

TICDS

ICC W-64

DIRECTIONS

FOR ALGAE CONTROL IN COOLING TOWERS

ACTIVE INGREDIENT

INERT INGREDIENT

CAUTION

CAUTION

KEEP OUT OF REACH OF CHILDREN

For additional information, contact your distributor

Net Gallons


REGISTERED TRADEMARK

INTERCONTINENTAL CHEMICAL CORPORATION

MANUFACTURING PLANTS:
SACRAMENTO, CALIF.

CINCINNATI, O.
ANAHEIM, CALIF.

OFFICES AND WAREHOUSES IN PRINCIPAL CITIES

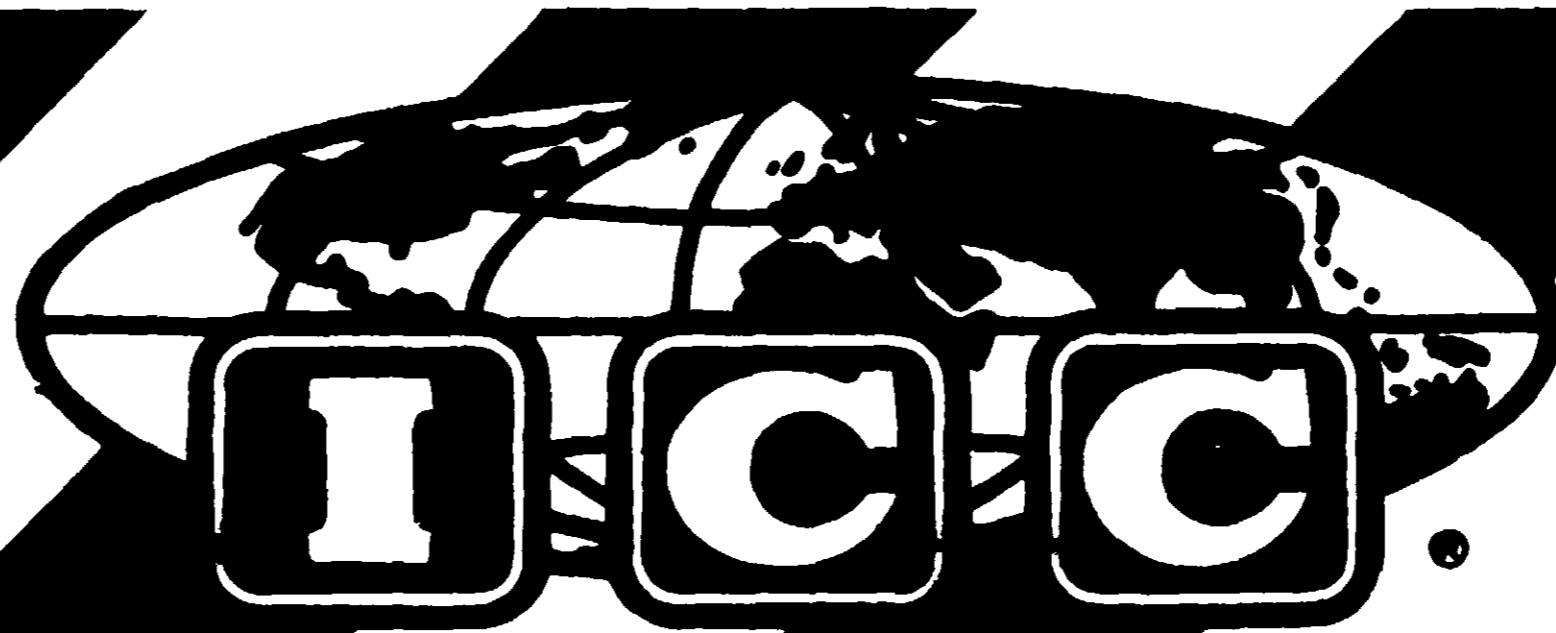

CHEMICALS

ACCEPTED

8/20/73 *9594-9*

UNDER THE FEDERAL INSECTICIDE
FUNGICIDE AND RODENTICIDE ACT
FOR ECONOMIC POISON REGISTERED
ED UNDER NO. 9594-9

DIRECTIONS

ICC W-62 is used to control algae, bacteria and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and other deposits. An initial slug addition of 13 to 35 fluid ounces of ICC W-62 per 1000 gallons of water to provide a concentration of 100 to 250 parts per million of ICC W-62 based on the total weight of water in the system is recommended. Repeat initial dosage until control is evident. Subsequent slug additions of 3.5 to 35 fluid ounces of ICC W-62 per 1000 gallons of water (25 to 250 parts per million of ICC W-62) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

ICC W-62

FOR ALGAE CONTROL IN COOLING TOWERS

ACTIVE INGREDIENT:

Poly [oxyethylene (dimethyliminio) ethylene
(dimethyliminio) ethylene dichloride] 4.8%

INERT INGREDIENT 95.2%
100.0%

CAUTION

KEEP OUT OF REACH OF CHILDREN

See additional cautions on right side panel

Net Gallons
EPA REG. NO.: 9594-9

CAUTION

Harmful if swallowed. Do not get in eyes. Avoid contact with skin. In case of contact, flush with plenty of water for at least 15 minutes. If eye irritation persists, seek medical attention. Avoid contamination of food.

Rinse empty container thoroughly with water and discard container.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply ICC W-62 only as specified on this label. Do not contaminate water by cleaning equipment or disposal of waste.

INTERMUNICIPAL CHEMICAL CORPORATION

MANUFACTURERS:
SANTA ANA, CALIF.

ANNATI, O.
SANTA ANA, CALIF.

SALES AND SERVICE IN ALL MAJOR CITIES