

APPLICATIONS

Used to inhibit the growth of algae and fungi in recirculating commercial cooling water systems. With SLIMEX-E, systems must be cleaned of algal growth, microbiological deposits. Then the system should be treated with an initial slug addition of 0.2 fluid ounces of SLIMEX-E per 1,000 gallons of water in the system. Repeat the initial treatment if algal growth is evident. Subsequent slug treatments of 0.2 fluid ounces of SLIMEX-E per 1,000 gallons of water should be made every 30 days. The required frequency depends on the relative amount of algal growth and the severity of the microbiological conditions. The amount of SLIMEX-E should be determined by the manufacturer of water cooling towers.

1-811-811-811 No. 9601 OH



SLIMEX-E



Mfg. by Chardon Laboratories, Inc., Columbus, Ohio

KEEP OUT

Causes eye irritation. Do not get in eyes, nose, mouth, or on face. Avoid breathing dust. Handle with care. Wash hands after handling. Hazardous if inhaled. Contaminates clothing.

FIRST AID: If in eyes, flush eyes with water for at least 15 minutes. If in mouth, do not induce vomiting. Move and get medical attention if necessary.

If swallowed, do not induce vomiting. If a raw egg is swallowed, do not induce vomiting. Then induce vomiting with warm water immediately.

Do not recondition equipment until thoroughly cleaned and buried.


This product should not be applied to lakes, streams, or rivers. Apply this product according to label directions.

Ne

APPLICATIONS

SLIMEX-E is used to inhibit the growth of algae, bacteria, and fungi in recirculating commercial and industrial cooling water systems. Before treatment with SLIMEX-E, systems must be cleaned to remove algal growth, microbiological slime, and other deposits. Then the system should be treated with an initial slug addition of 5.1 to 10.2 fluid ounces of SLIMEX-E per 1,000 gallons of water in the system. Repeat the initial dosage until control is evident. Subsequent slug additions of 1.7 to 10.2 fluid ounces of SLIMEX-E per 1,000 gallons of water should be made every 1 to 5 days or as needed. The required frequency of treatment depends on the relative amount of bleedoff and the severity of the microbiological problem. Slug additions of SLIMEX-E should be made to the sump of water cooling towers.

EPA Reg. No. 9601-8 EPA Est. No. 9601-OH-1

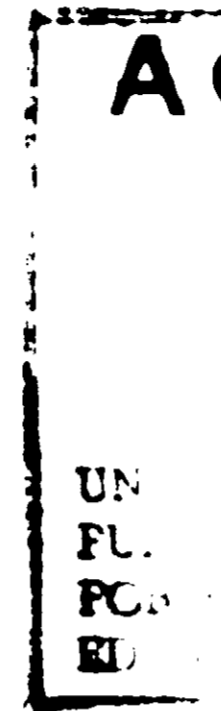

WARNING

KEEP OUT OF REACH OF CHILDREN

Causes eye damage and skin irritation. Do not get in eyes, on skin, or on clothing. Wear goggles or face shield and rubber gloves when handling. Harmful or fatal if swallowed. Avoid contamination of food.

FIRST AID: In case of contact, immediately flush eyes or skin with plenty of water for at least 15 minutes. For eyes, call a physician. Remove and wash contaminated clothing before reuse.

If swallowed, give patient doses of powdered charcoal immediately or all he can swallow of raw egg white, milk, gruel, or flour and water. Then induce vomiting with salt, soap, or mustard in warm water. Call a physician immediately.

Do not reuse empty drum. Return to drum reconditioner or destroy by perforating or crushing and burying in a safe place.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Apply this product only as specified on this label.

Net Contents _____ Gal(s).

Lab Control No.