



# POOLMASTER<sup>®</sup> INC.

## QUALITY PRODUCTS

### P.M. 90 SWIMMING POOL CHLORINE TABLETS

A Highly Effective  
Algaecide Germicide  
For Maintaining Clear  
Dew-Sparkling Pool  
Water

1-inch diameter  
Slow-Dissolving Tablets  
Provide Continuous  
Chlorination of  
Swimming Pool Water

**DANGER: KEEP OUT OF REACH OF CHILDREN**

Harmful or fatal if swallowed. **CORROSIVE.** Causes severe eye damage and skin irritation. May cause irritation to nose and throat if inhaled. See First Aid and other precautions on the back/side panel.

**ACTIVE INGREDIENT**  
Trichloro-s-triazinetriene 99.5%  
**INERT INGREDIENTS** 0.5%

[90% Available Chlorine]

E.P.A. Reg. No. 9610-6

MADE IN U.S.A.

NET WT

### P.M. 90 SWIMMING POOL CHLORINE TABLETS

DIRECTIONS



# POOLMASTER<sup>®</sup> INC

QUALITY PRODUCTS

## P.M. 90

### SWIMMING POOL CHLORINE TABLETS

**A Highly Effective  
Algaecide-Germicide  
For Maintaining Clear,  
Clean, Sparkling Pool  
Water.**

**1-inch diameter  
Slow Dissolving Tablets  
Provide Continuous  
Chlorination of  
Swimming Pool Water.**

UNDER THE FEDERAL INSECTICIDE,  
FUNGICIDE AND ROENTGEN RADIATION  
ACT FOR ECONOMIC POISON REGISTER-  
ED UNDER NO. 9610-6

MAY 16 1973

**DANGER: KEEP OUT OF REACH OF CHILDREN**

Harmful or fatal if swallowed. CORROSIVE. Causes severe eye damage and skin irritation. May cause irritation to nose and throat if inhaled. See First Aid and other precautions on the back side panel.

**ACTIVE INGREDIENT**  
Trichloro-s-triazinetrione 99.5%  
**INERT INGREDIENTS** 0.5%

{90 Available Chlorine}

EPA Reg No 9610 6

Dist. by POOLMASTER, INC. 160 Jefferson, Menlo Park, CA 94025

NET WT

# P.M. 90

## SWIMMING POOL CHLORINE TABLETS

### DIRECTIONS

For freshly filled pools or pools that have been using other materials for chlorination, water preparation, conditioning is necessary in order to obtain the maximum efficiency from P.M. 90 CHLORINE TABLETS.

#### CONDITIONING.

1. Filter should be clean. As a precautionary measure, filter should be backwashed and allowed to operate continuously for at least 8 hours.

maintain a chlorine residual of 1.0-1.5 ppm. Each tablet weight is approximately .6 oz.

P.M. 90 CHLORINE TABLETS dissolve slowly and provide continuous chlorination of pool water for several days. Amount and frequency of application will vary with water temperature and bather load. Test chlorine level daily with a chlorine test kit and adjust tablet usage as necessary to maintain a chlorine residual of 1.0-1.5 ppm.

Use P.M. 90 CHLORINE TABLETS as a refill for automatic chlorinators.

Dist. by POOLMASTER, INC. 160 Jefferson, Menlo Park, CA 94025

NET WT

# P.M. 90 SWIMMING POOL CHLORINE TABLETS

## DIRECTIONS

For freshly filled pools or pools that have been using other materials for chlorination, water preparation, conditioning is necessary in order to obtain the maximum efficiency from P.M. 90 CHLORINE TABLETS.

### CONDITIONING.

1. Filter should be clean. As a precautionary measure, filter should be backwashed and allowed to operate continuously for at least 8 hours. Do not add Alum to sand and gravel filters for at least 24 hours.

2. Water should be tested with an accurate test set. Test the pH level and adjust it to 7.4-7.8. If the pH is below 7.4, add POOLMASTER pH CORRECT to raise it. If pH is above 7.8, add POOLMASTER DRY ACID.

3. Gradually add 2-1/2 lbs. of POOLMASTER "PREP" for each 10,000 gallons of water through surface skimmer. Care should be taken to break up any lumps that may form. For best circulation, shut off the main drain to increase the water flow through the skimmer.

4. Allow one to two hours for total dispersal. Test water again and adjust pH to 7.4-7.8.

5. Superchlorinate with 8 oz. of calcium hypochlorite or with 1 gallon of 10 - 14% sodium hypochlorite for each 20,000 gallons of water. Caution - never permit swimming or swimmers during superchlorination period or while chlorine residual is above 2.0 ppm. This superchlorination is necessary for proper water conditioning to make certain chlorine demand (the level of chlorine needed in pool water to kill bacteria) is satisfied prior to beginning regular treatment.

6. Check the chlorine residual the following day. If the chlorine test shows less than 1.0 ppm chlorine residual, repeat the same superchlorination as explained above. An available chlorine residual of 1.0 - 1.5 ppm must be maintained. Never permit the residual to go below 1.0 ppm at any time.

### REGULAR TREATMENT

Simply drop 4-6 tablets of P.M. 90 CHLORINE TABLETS into the skimmer basket every other day, or as needed, per each 10,000 gallons of water to

maintain a chlorine residual of 1.0-1.5 ppm. Each tablet weight is approximately .6 oz.

P.M. 90 CHLORINE TABLETS dissolve slowly and provide continuous chlorination of pool water for several days. Amount and frequency of application will vary with water temperature and bather load. Test chlorine level daily with a chlorine test kit and adjust tablet usage as necessary to maintain a chlorine residual of 1.0-1.5 ppm.

When using P.M. 90 CHLORINE TABLETS as a refill for automatic chlorinators or floating dispensers, see the chlorinator instructions from the chlorinator manufacturer.

**DANGER: CORROSIVE.** Do not take internally. Do not get in eyes, on skin or on clothing. Avoid breathing dust. Causes burns on broken skin. Wear goggles or face shield and rubber gloves when handling. Avoid contamination of food.

**FIRST AID:** In case of contact, immediately flush eyes or skin with plenty of water for at least 15 minutes. For eyes, call a Physician. Remove and wash contaminated clothing before reuse. Internally - if swallowed, drink promptly a large quantity of milk, egg whites, plain water or if these are not available, drink large quantities of water. Avoid alcohol. Call a Physician immediately.

**NOTE TO PHYSICIAN:** Probable mucosal damage may contraindicate the use of gastric lavage. Measures against circulatory shock, respiratory depression and convulsion may be needed.

**STORE IN A COOL, DRY, WELL VENTILATED AREA.** Corrosive. Moisture contamination may liberate irritating and hazardous chlorine-containing gases. Oxidizing materials; do not mix with other chemicals. Contact with organic matter, heat, moisture may cause fire. Will burn with evolution of chlorine or equally toxic gases. Rinse empty container thoroughly with water and discard.

ACCEPTED  
ED UNDER NO. 9610-b



# POOLMASTER<sup>®</sup> INC

QUALITY PRODUCTS

160 JEFFERSON, MENLO PARK, CA 94025


ACCEPTED

7/10/74

JUL 23 1974

UNDER THE FEDERAL INSECTICIDE  
FUNGICIDE AND RODENTICIDE ACT  
EPA REG. NO. 7418 SUBJECT  
TO ATTACHED COMMENTS.

A Highly Effective  
Algaecide-Germicide  
For Maintaining Clear,  
Clean, Sparkling Pool  
Water.

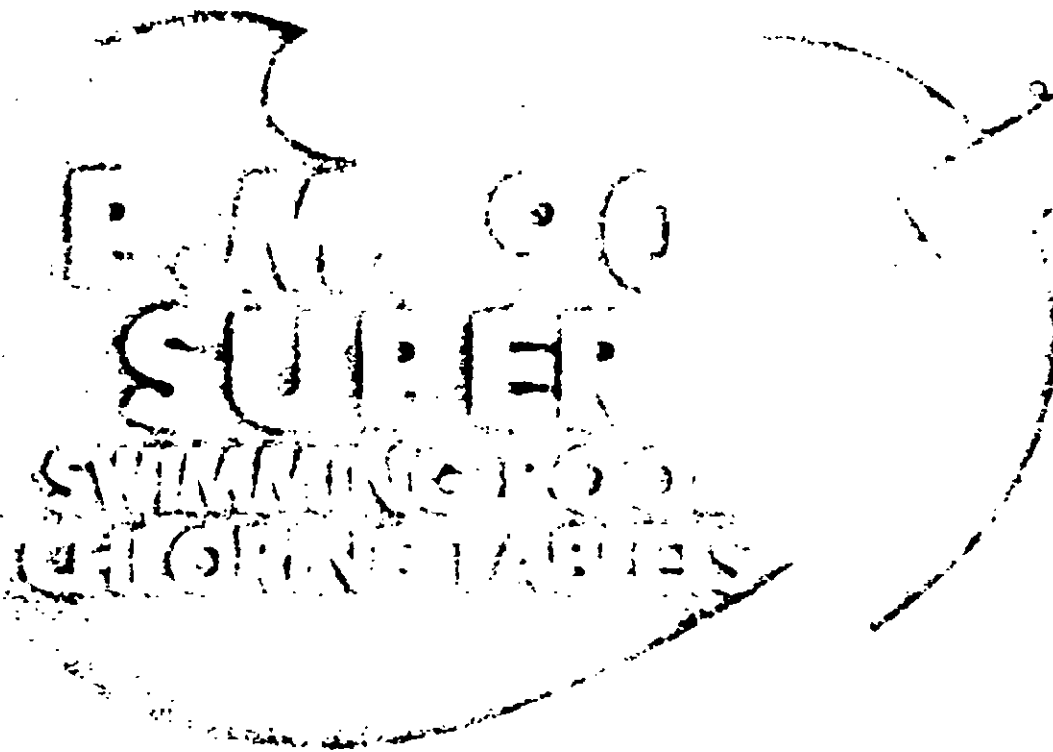

Large 3" diameter

Slow Dissolving Tablets

Provide Continuous

Chlorination of

Swimming Pool Water.

KEEP OUT OF REACH OF CHILDREN

ACTIVE INGREDIENTS  
NET WEIGHT

Dist. by POOLMASTER, INC. 160 Jefferson, Menlo Park, CA 94025

NET WT.

EPA 90 SUPER  
SWIMMING POOL CHLORINE TABLETS

DIRECTIONS

Directions text is extremely faint and mostly illegible due to high contrast and noise in the scan.



**POOLMASTER**®  
INC  
QUALITY PRODUCTS

**P.M. 90**

**SWIMMING POOL  
CHLORINE TABLETS**

A Highly Effective  
Algaecide Germicide  
For Maintaining Clear  
Clean Sparkling Pool  
Water

1 1/2 inch diameter  
Slow Dissolving Tablets  
Provide Continuous  
Chlorination of  
Swimming Pool Water

MADE IN U.S.A.

9410-6

**DANGER: KEEP OUT OF REACH OF CHILDREN**

Harmful or fatal if swallowed. CORROSIVE. Causes severe eye damage and skin irritation. May cause irritation to nose and throat if inhaled. See First Aid and other precautions on the back/side panel.

**ACTIVE INGREDIENT**

Trichloro-s-triazinetrione 99.5%

**INERT INGREDIENTS** 0.5%

[90% Available Chlorine]

E.P.A. Reg. No. 9610-6

NET WT

**P.M. 90**  
**SWIMMING POOL CHLORINE TABLETS**

DIRECTIONS

1. Add 1 tablet per 10,000 gallons of water.  
2. Allow 12 hours for chlorine to build up.  
3. Test water for chlorine level.  
4. Maintain chlorine level between 1.0 and 1.5 ppm.  
5. Add 1 tablet per 10,000 gallons of water when chlorine level drops below 1.0 ppm.  
6. Do not use in hot tubs or whirlpools.  
7. Do not use in swimming pools with metal equipment.  
8. Do not use in swimming pools with vinyl or fiberglass linings.  
9. Do not use in swimming pools with concrete or masonry surfaces.  
10. Do not use in swimming pools with plaster or pebble finishes.



**POOLMASTER**®  
INC  
QUALITY PRODUCTS