

Chemtrol


No. 19

**MICROORGANISM
CONTROL CHEMICAL**

DIRECTIONS:

Chemtrol 19 is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algae growth, microbiological slime and other deposits. An initial slug addition of 1.90 to 4.75 fluid ounces of Chemtrol 19 per 1000 gals. of water, to provide a concentration of 16 to 40 parts per million of Chemtrol 19 based on the total weight of water in the system is recommended. Subsequent slug additions of 0.47 to 4.75 fluid ounces of Chemtrol 19 per 1000 gals. of water (4 to 40 parts per million of Chemtrol 19) should be employed every 2 to 5 days or as needed until control is evident. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

NOTE: Chemtrol 19 intended for industrial use only. Do not apply to potable water of domestic water systems.

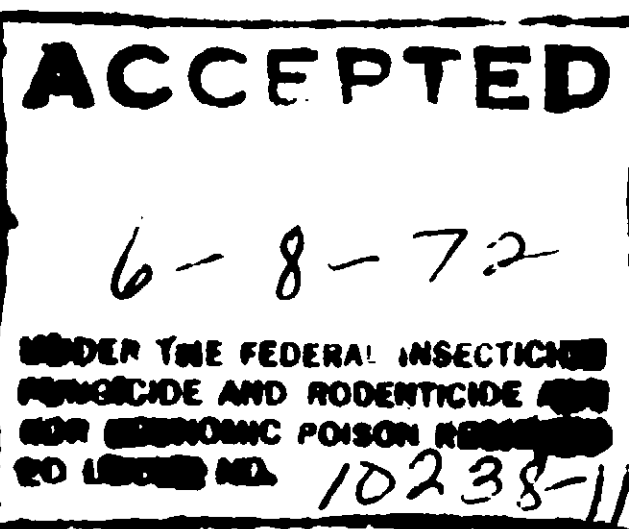

Comment

ACTIVE INGREDIENT:

Poly [oxyethylene (dimethyliminio)
ethylene (dimethyliminio)-ethylene
dichloride] 30%

INERT INGREDIENT: 70%

TOTAL 100%

USDA Registration No. 10238-11

CAUTION:

KEEP OUT OF REACH OF CHILDREN

Harmful if swallowed. Avoid contact with skin and eyes. In case of contact flush with plenty of water for at least 15 minutes. If eye irritation persists get medical attention. Avoid contamination of food.

This product is toxic to fish. Do not add treated effluent to lakes, streams or ponds. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse container. Destroy when empty.

Buyer assumes all risk of use, storage or handling of this material not in strict accordance with directions given herewith.

Chemtrol Company

P. O. BOX 15388

TULSA, OKLAHOMA 74115

Net Contents Shown Elsewhere On Container

ACCEPTED WITH COMMENTS