

WATER CHLORINATION

Use 0.1 to 0.5 ppm of available chlorine. Determine proper concentrations and amounts of residual chlorine with a chlorine test kit.


FOOD PROCESSING

Use 200 ppm of available chlorine solution for terminal rinsing of pre-cleaned food handling equipment.

After cleaning, use 600 ppm of available chlorine solution for disinfecting walls, floors, etc.

ALPHA CHLOR DILUTION TABLE

100 ppm (1:5000) use	1 oz. Alpha Chlor to 4 gals. water
200 ppm (1:2500) use	2 oz. Alpha Chlor to 4 gals. water
400 ppm (1:1250) use	4 oz. Alpha Chlor to 4 gals. water
500 ppm (1:1000) use	5 oz. Alpha Chlor to 4 gals. water
800 ppm (1:625) use	8 oz. Alpha Chlor to 4 gals. water
1000 ppm (1:500) use	10 oz. Alpha Chlor to 4 gals. water

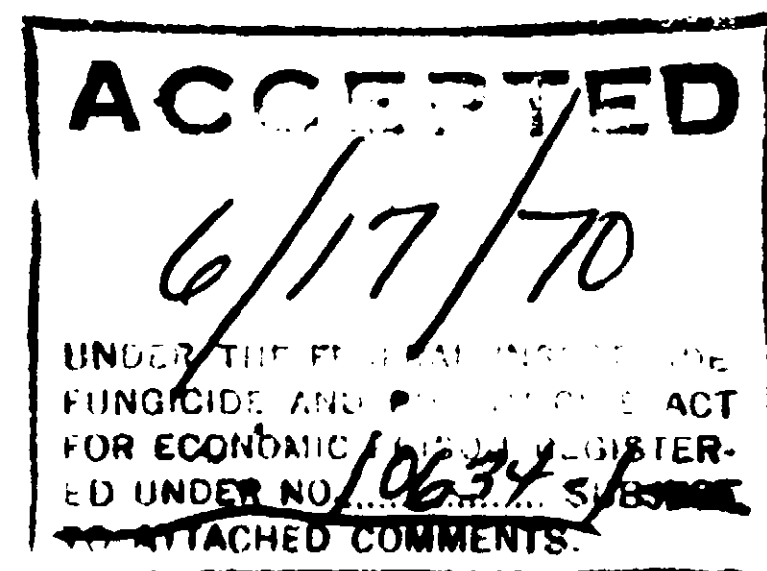

CAUTION

DISINFECTANT AND GERMICIDE

ALPHA CHLOR

ACTIVE INGREDIENTS:	
SODIUM HYPOCHLORITE	5.25%
INERT INGREDIENTS	94.75%
TOTAL	100.00%

NET CONTENTS: 1 U.S. GALLON

USDA REG. NO. 10634-1

MANUFACTURED BY
ALPHA CHEMICAL SERVICES, INC. - STOUGHTON, MASS.