

ALGAECIDE - W

DANGER-KEEP OUT OF REACH OF CHILDREN

HARMFUL OR FATAL IF SWALLOWED OR ~~ABSORBED~~ THROUGH SKIN. INJURIOUS TO EYES. CAUSES IRRITATION. RAPIDLY ~~ABSORBED~~ THROUGH SKIN.

DO NOT GET INTO EYES, ON SKIN OR CLOTHING.

WASH THOROUGHLY AFTER HANDLING. KEEP PACKAGE TIGHTLY CLOSED WHEN NOT IN USE. USE WITH ADEQUATE VENTILATION.

FIRST AID

IN CASE OF CONTACT FLUSH EYES IMMEDIATELY WITH PLENTY OF WATER FOR AT LEAST 15 MINUTES AND GET MEDICAL ATTENTION. FOR SKIN WASH WITH SOAP AND PLENTY OF WATER.

FISH PRECAUTIONS


THIS PRODUCT IS TOXIC TO FISH.. ~~TREATED~~ EFFLUENT SHOULD NOT BE DISCHARGED WHERE IT WILL DRAIN INTO LAKES, PONDS, STREAMS, OR PUBLIC WATER.

DIRECTIONS FOR USE

ALGAECIDE-W IS USED TO CONTROL ALGAE, BACTERIA, AND FUNGI IN RECIRCULATING COMMERCIAL AND INDUSTRIAL WATER COOLING TOWERS. PRIOR TO ITS USE, SYSTEMS MUST BE CLEANED TO REMOVE ALGAE GROWTH, MICROBIOLOGICAL SLIME, AND OTHER DEPOSITS. AN INITIAL SLUG ADDITION OF 6.0 TO 15.0 FLUID OUNCES OF ALGAECIDE-W PER 1000 GALLONS OF WATER, TO PROVIDE A CONCENTRATION OF 48 TO 120 PARTS PER MILLION OF ALGAECIDE-W BASED ON THE TOTAL WEIGHT OF WATER IN THE SYSTEM IS RECOMMENDED. SUBSEQUENT SLUG ADDITIONS OF 1.5 TO 15.0 FLUID OUNCES OF ALGAECIDE-W PER 1000 GALLONS OF WATER (12 TO 120 PARTS PER MILLION) SHOULD BE EMPLOYED EVERY 2 TO 5 DAYS OR AS NEEDED. THE FREQUENCY OF ADDITION DEPENDS UPON THE RELATIVE AMOUNT OF BLEEDOFF AND THE SEVERITY OF THE MICROBIOLOGICAL PROBLEM. SLUG ADDITIONS SHOULD BE MADE IN THE SUMP OF WATER COOLING TOWERS. DO NOT REUSE EMPTY DRUM. DESTROY WHEN EMPTY.

E.P.A. REG. NO. 11576-4

FO
INC

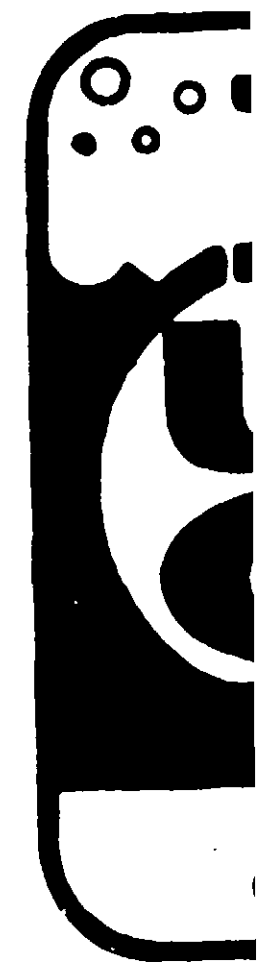

31

ACTIVE IN
Poly [oxy
iminio)et
io)ethyle

TOTAL----

INERT INC

Weight Or

A

ALGAECIDE - W

KEEP OUT OF REACH OF CHILDREN

IF SWALLOWED OR ABSORBED THROUGH SKIN. INJURIOUS IRRITATION. RAPIDLY ABSORBED THROUGH SKIN.

AVOID CONTACT WITH EYES, ON SKIN OR CLOTHING.

AFTER HANDLING. KEEP PACKAGE TIGHTLY CLOSED WHEN NOT IN USE WITH ADEQUATE VENTILATION.

IF EYES ARE FLUSHED IMMEDIATELY WITH PLENTY OF WATER FOR SEVERAL MINUTES AND GET MEDICAL ATTENTION. FOR SKIN WASH WITH WATER.


TOXIC TO FISH.. TREATED EFFLUENT SHOULD NOT BE DISCHARGED OR DRAIN INTO LAKES, PONDS, STREAMS, OR PUBLIC

DIRECTIONS FOR USE

USE TO CONTROL ALGAE, BACTERIA, AND FUNGI IN COMMERCIAL AND INDUSTRIAL WATER COOLING TOWERS. SYSTEMS MUST BE CLEANED TO REMOVE ALGAE GROWTH, SLIME, AND OTHER DEPOSITS. AN INITIAL SLUG ADDITION OF 15 FLUID OUNCES OF ALGAECIDE-W PER 1000 GALLONS OF WATER, AT A CONCENTRATION OF 48 TO 120 PARTS PER MILLION OF ALGAECIDE-W TO THE WEIGHT OF WATER IN THE SYSTEM IS RECOMMENDED. SUBSEQUENT ADDITIONS OF 1.5 TO 15.0 FLUID OUNCES OF ALGAECIDE-W PER 1000 GALLONS (12 TO 120 PARTS PER MILLION) SHOULD BE EMPLOYED AS NEEDED. THE FREQUENCY OF ADDITION DEPENDS ON THE AMOUNT OF BLEEDOFF AND THE SEVERITY OF THE MICROBIOLOGICAL PROBLEM. SLUG ADDITIONS SHOULD BE MADE IN THE SUMP OF THE SYSTEM. DO NOT REUSE EMPTY DRUM. DESTROY WHEN EMPTY.

E.P.A. REG. NO. 11576-4

FOR CHEMICAL CONTROL OF
INDUSTRIAL WATER POLLUTION

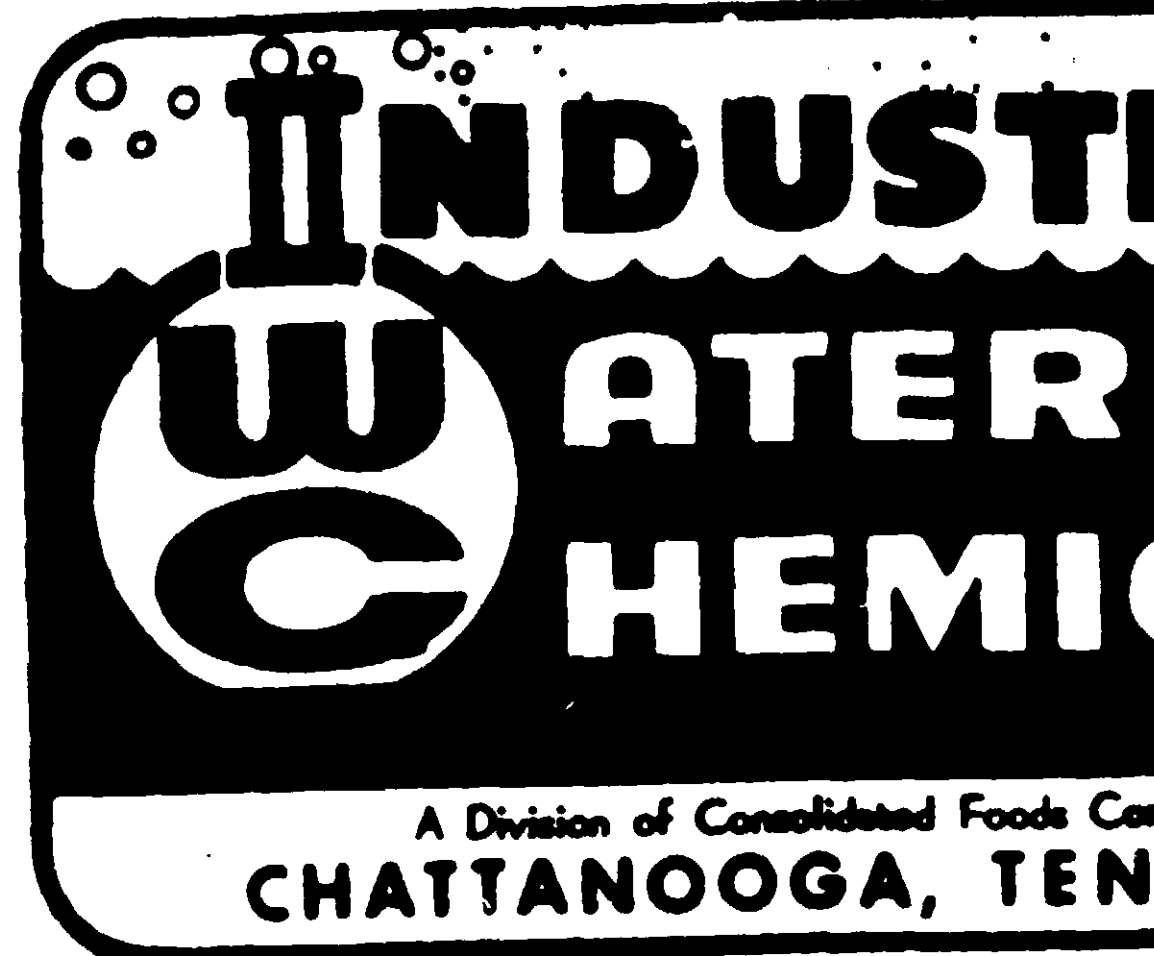

314 Spears Ave. Phone

ACTIVE INGREDIENTS

Poly [oxyethylene(dimethyl-
iminio)ethylene(dimethyliminio)
ethylene dichloride]-----
-----9.99%

TOTAL-----9.99%

INERT INGREDIENTS----90.01%

Weight One Gallon-8.2 lbs.

ACCEPTED

5-18-72

11576-4

DATE
GROSS
TARE
NET
COST
MARK