

# ALGAE-GUARD

PREVENTS ALGAE GROWTH IN COOLING TOWERS & AIR CONDITIONERS

EPA Reg. No. 11741-2

*June 24, 1973*

## CAUTION KEEP OUT OF REACH OF CHILDREN

Harmful if swallowed. Avoid contact with skin and eyes. In case of contact, flush with plenty of water for at least 15 minutes. If eye irritation persists, get medical attention. Avoid contamination of food.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Destroy when empty.

## INGREDIENTS

ACTIVE INGREDIENTS: Poly[oxyethylene (dimethyliminio)-ethylene (dimethyliminio) ethylene dichloride] - - - - - 15%


INERT INGREDIENTS: - - - - - 85%

## APPLICATIONS

ALGAE-GUARD is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. To obtain best results, systems must be cleaned to remove algal growth, microbiological slime and other deposits.

An initial slug addition of 3.9 to 9.75 fluid ounces of ALGAE-GUARD per 1000 gallons of water to provide a concentration of 32 to 80 parts per million of ALGAE-GUARD based on the total weight of water in the system is recommended. Repeat initial dosage until control is evident. Subsequent slug additions of 1.0 to 9.75 fluid ounces of ALGAE-GUARD per 1000 gallons of water (8 to 80s parts per million of ALGAE-GUARD) should be employed every 2 to 5 days or as needed.

The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

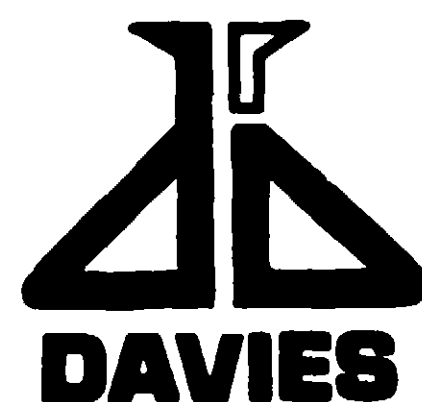

# D. W. DAVIES & CO., INC.

3200 PHILLIPS AVE.

RACINE, WISCONSIN 53403

PHONE (414) 637-6133