

DIRECTIONS

"To establish a chlorine residual, add ½ gallon for each 15,000 gallons of water. Repeat dosage until a chlorine residual of 0.6 to 1.0 ppm is established. Add 1 quart for each 15,000 gallons of water daily or as needed to maintain a chlorine residual of 0.6 to 1.0 ppm. Test pool water frequently with a chlorine test kit to maintain the desired chlorine residual. The pool water should be maintained at pH 7.2 to 7.6 as determined by a test kit.

WARNING:

Keep out of reach of children. Harmful if swallowed. May produce chemical burns. Do not get on skin or in eyes. In case of contact with skin and eyes, flush with plenty of water. If skin irritation persists, get medical attention. For eyes get prompt medical attention.

FIRST AID:

If swallowed, *drink promptly* a large quantity of milk, egg whites or gelatin solution. If these are not available, drink large quantities of water. Call physician immediately.

"Rinse empty containers thoroughly with water before discarding."

**HARMFUL IF SWALLOWED
DO NOT TAKE INTERNALLY
KEEP OUT OF REACH OF CHILDREN**

MANUFACTURED BY
AQUA CHEMICAL COMPANY
SPRINGFIELD, MASS. 01108
NET CONTENTS: ONE GALLON






DANGER:
KEEP OUT OF REACH OF CHILDREN
SEE OTHER WARNINGS ON BACK OF LABEL
NET CONTENTS: ONE GALLON

E.P.A. Reg. 12465-4-13059

12465-4
MAY 7 1973
UNDER THE FEDERAL INSECTICIDE
FUNGICIDE AND ROVIDENTICIDE ACT
THIS PRODUCT IS LISTED IN THE
FEDERAL REGISTER REGISTERED
DATE 12/24/65 SUBJECT

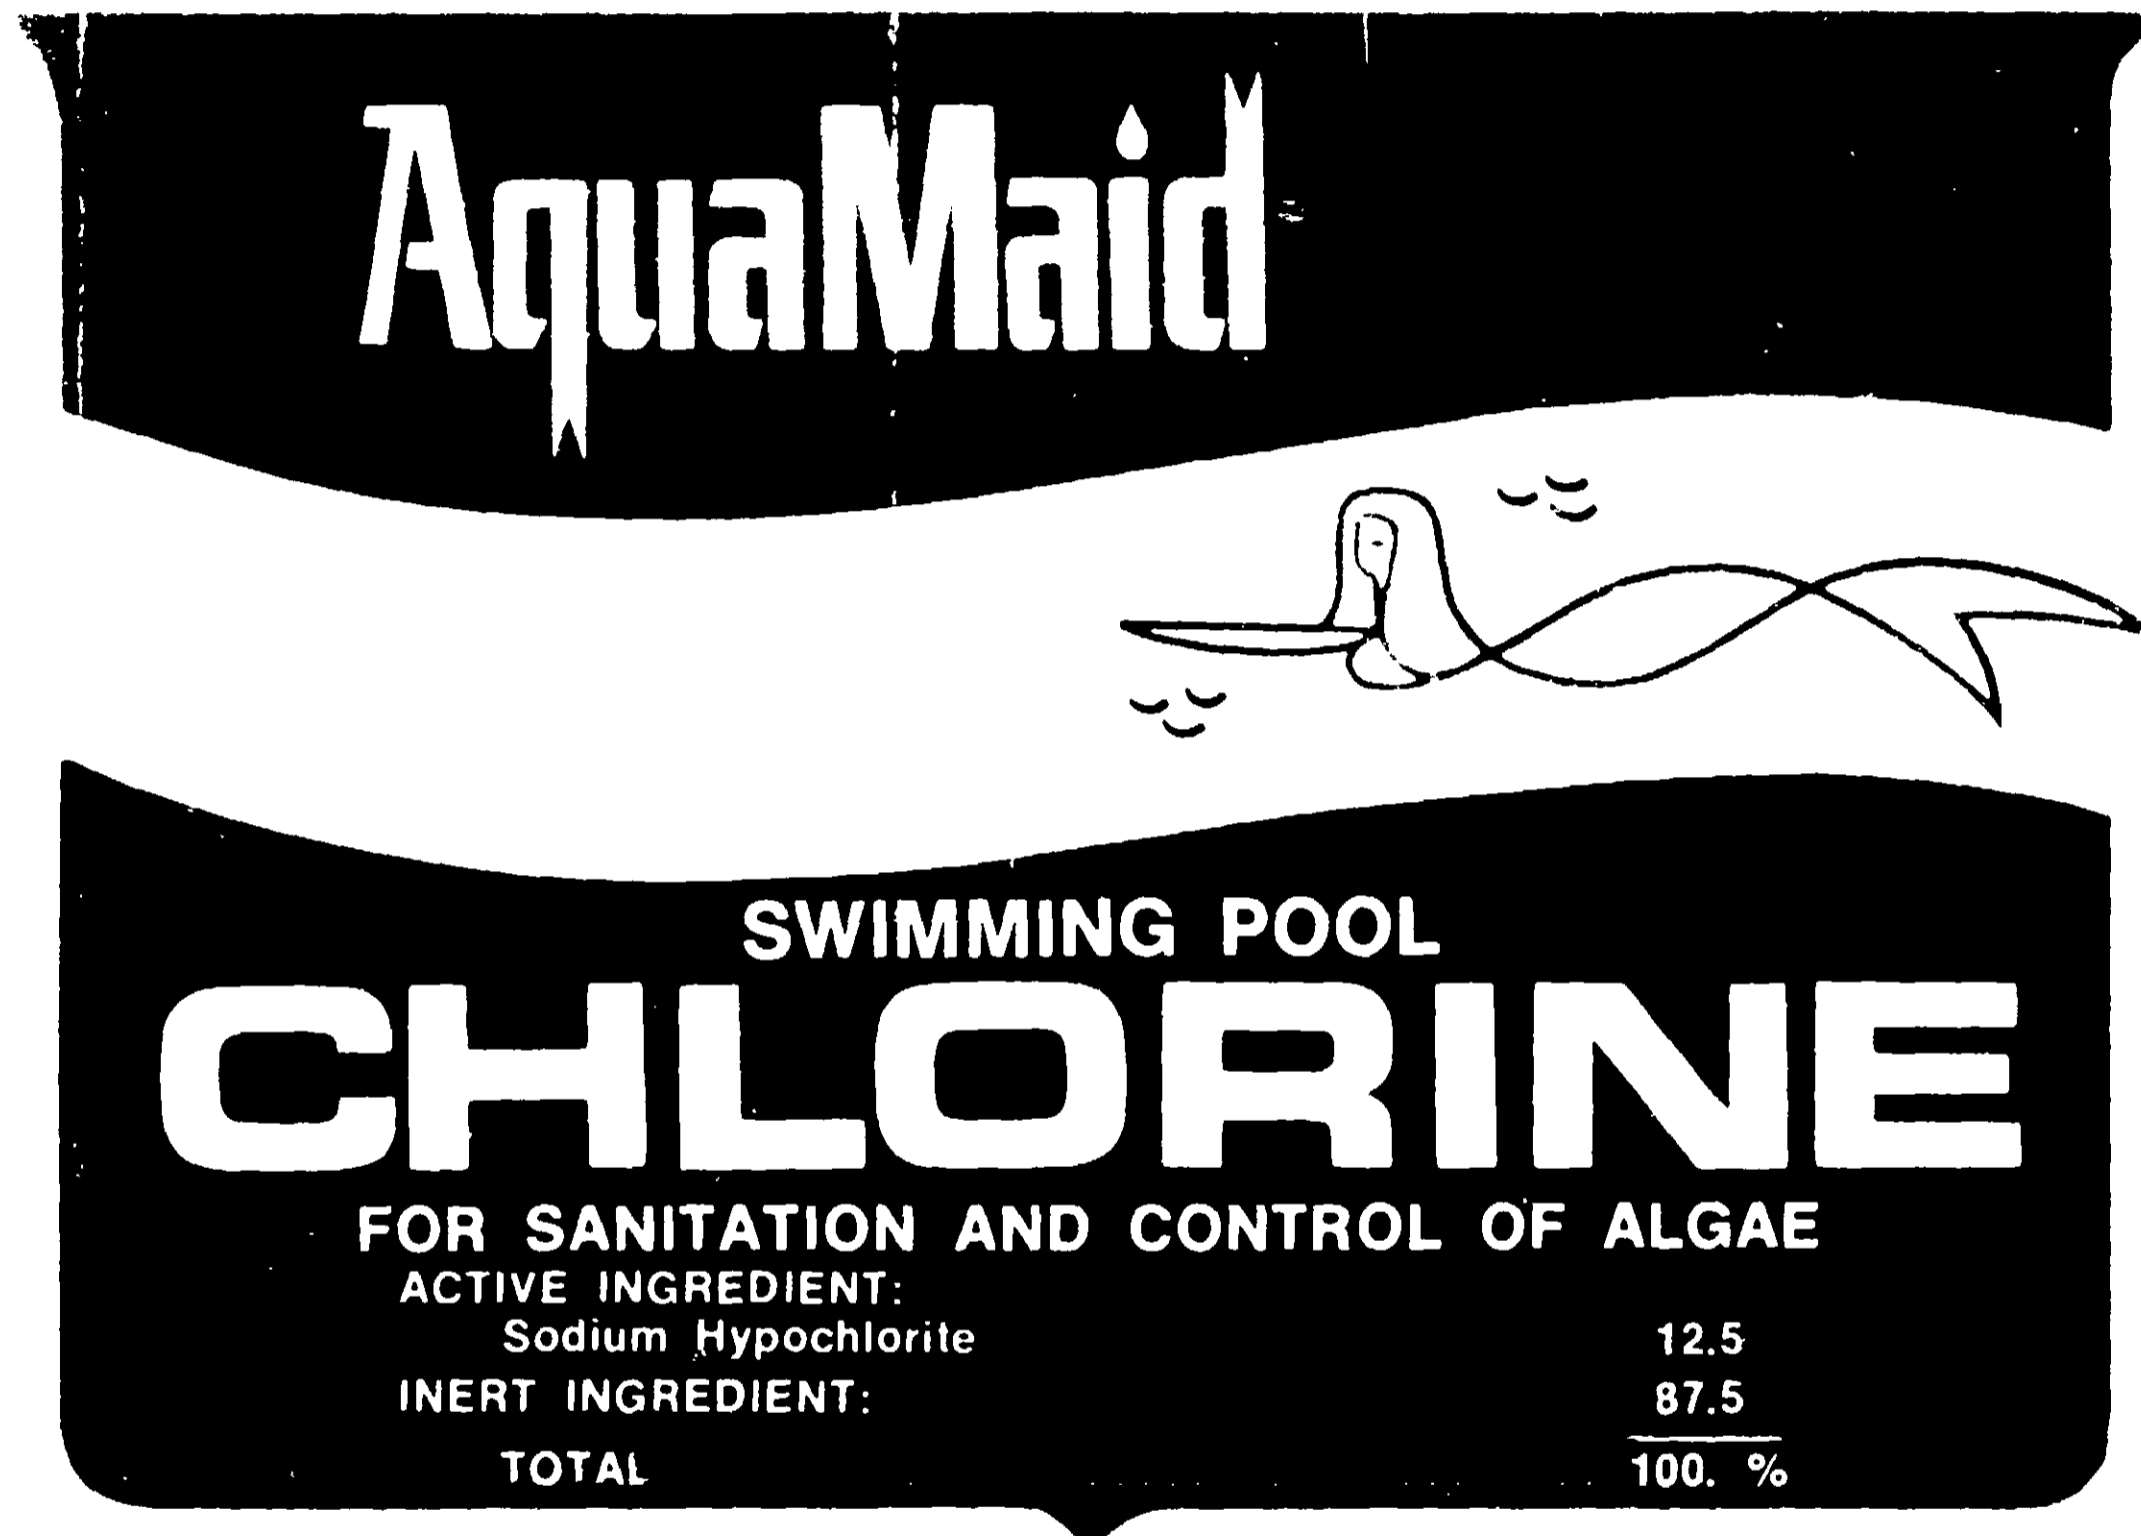

DANGER:
KEEP OUT OF REACH OF CHILDREN
SEE OTHER WARNINGS ON BACK OF LABEL
NET CONTENTS: ONE GALLON