


Industrial Maintenance Corporation

WATER TREATMENT SPECIALISTS

CHARLOTTE, NORTH CAROLINA

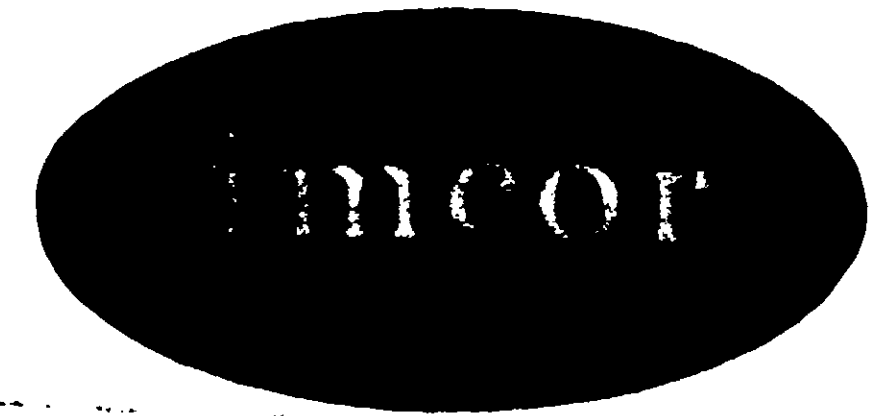

DIRECTIONS FOR USE

BA-105 is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and other deposits. An initial slug addition of 6.13 to 15.32 fluid ounces of BA-105 per 1,000 gallons of water to provide a concentration of 48 to 120 parts per million of BA-105 based on the total weight of water in the system is recommended. Repeat initial dosage until control is evident. Subsequent slug additions of 1.53 to 15.32 fluid ounces of BA-105 per 1,000 gallons of water (12 to 120 parts per million of BA-105) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleed off and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

EPA Reg. No. 17866-1

BA-105

COMPOSITION

	Percent by weight
Active ingredient -----	10.0%
Poly (oxyethylene (dimethyliminio) ethylene (dimethyliminio)-ethylene dichloride) ---	10.0%
Inert ingredient -----	90.0%
Weight per gallon _	8.49 pounds
Weight of active ingredient per gallon ---	0.85 pound

Manufactured By

INDUSTRIAL MAINTENANCE CORPORATION

2830 S. Griffith Street
Charlotte, N. C. 28203

1973

17866-1

WARNING

KEEP OUT OF THE REACH OF CHILDREN

Harmful if swallowed. Avoid contact with skin and eyes. In case of contact, flush with plenty of water for at least 15 minutes. If eye irritation persists, get medical attention. Avoid contamination of food.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse container. Destroy when empty.