

705

NET _____



scientific BOILER WATER CONDITIONING COMPANY

1 MAPLE AVE., LINDEN, N. J. *May 5*
201-486-2000

COMPOSITION

	Percent by weight
Active ingredient	6.0 percent
Poly (oxyethylene (dimethyl- minio)-ethylene dichloride).	
Inert ingredient	94.0 percent

Weight per gallon8.4 pounds
Weight of active in-
gredient per gallon ..0.5 pound

CAUTION

KEEP OUT OF THE REACH OF CHILDREN

Harmful if swallowed. Avoid contact with skin and eyes. In case of contact flush with plenty of water for at least 15 minutes. If eye irritation persists get medical attention. Avoid contamination of food.

This product is toxic to fish. Treated effluent should not be discharged where it will drain into lakes, streams, ponds, or public water. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse container.

Return to drum reconditioner or destroy by perforating or crushing and burying in a safe place away from water supplies.

2-61603


WATER TREATMENT

FORMULA NO. 705

EPA Reg. No. 30942-E

APPLICATION

Formula No. 705 is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algal growth, microbiological slime and other deposits. An initial slug addition of 10.1 to 25.25 fluid ounces of Formula No. 705 per 1000 gallons of water to provide a concentration of 80 to 200 parts per million of Formula No. 705 based on the total weight of water in the system is recommended. Repeat initial dosage until control is evident. Subsequent slug additions of 2.52 to 25.25 fluid ounces of Formula No. 705 per 1000 gallons of water (20 to 200 parts per million of Formula No. 705) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

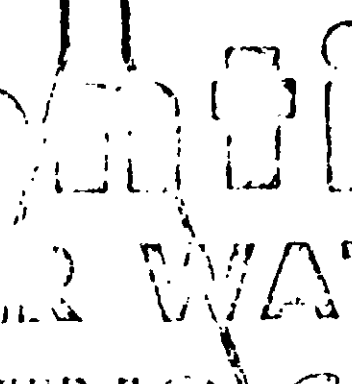

Scientific
BOILER WATER
CONDITIONING COMPANY

1 MAPLE AVE., LINCOLN, N. J.

406-1169