


For use on metal containers

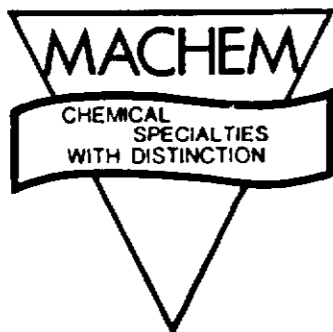

### TOWER-CIDE NF

ACCEPTED

NO. 3 878  
34284-5  
UNDER THE FEDERAL INSECTICIDE  
FUNGICIDE AND RODENTICIDE ACT  
FOR ECONOMIC POISON REGISTERED  
ED UNDER NO.

#### ACTIVE INGREDIENT

Poly [oxyethylene (dimethyliminio) ethylene-  
(dimethyliminio) ethylene dichloride] ..... 10.0%

INERT INGREDIENT ..... 90.0%

This product contains 0.85 lb. of active ingredient per gallon and weights 8.49 lb. per gallon.

**KEEP OUT OF REACH OF CHILDREN**

**CAUTION**

#### PRECAUTIONARY STATEMENTS HAZARDS TO HUMANS AND DOMESTIC ANIMALS

**CAUTION:** Harmful if swallowed. Avoid breathing vapors. Avoid contact with skin, eyes or clothing.

**FIRST AID:** If swallowed, drink promptly a large quantity of milk, egg whites, gelatin solution, or if these are not available, drink large quantities of water. Avoid alcohol. Call a physician immediately.

**ENVIRONMENTAL HAZARDS:** This pesticide is toxic to fish. Keep out of lakes, streams, or ponds. Permits may be required for discharges containing this pesticide into lakes, streams, ponds or public water. For guidance, contact the regional office of the Environmental Agency.

#### DIRECTIONS FOR USE GENERAL CLASSIFICATION

2

It is a violation of Federal law to use this product in a manner inconsistent with its labeling.

**Tower-Cide NF** is used to control algae, bacteria, and fungi in recirculating commercial and industrial water cooling towers. Prior to its use, systems must be cleaned to remove algae growth, microbiological slime, and other deposits.

An initial slug addition of 6.13 to 15.32 fluid ounces of **Tower-Cide NF** per 1,000 gallons of water to provide a concentration of 48 to 120 parts per million of **Tower-Cide NF**, based on the total weight of water in the system, is recommended. Repeat initial dosage until control is evident.

Subsequent slug additions of 1.53 to 15.32 fluid ounces of **Tower-Cide NF** per 1,000 gallons of water (12 to 120 parts per million of **Tower-Cide NF**) should be employed every 2 to 5 days or as needed. The frequency of addition depends upon the relative amount of bleedoff and the severity of the microbiological problem. Slug additions should be made in the sump of water cooling towers.

**STORAGE & DISPOSAL:** Keep container closed when not in use. Do not contaminate water, food, or feed by storage, disposal, or cleaning of equipment. The container must be triple rinsed (or equivalent) and offered for recycling, reconditioning, or disposal in an approved landfill or buried in a safe place. Rinsate that cannot be used or reprocessed should be disposed of in a landfill approved for pesticides or buried in a safe place away from water supplies. Open dumping is prohibited.

Manufactured by:  
**Mid-America Chemical Company**  
203 South Compress  
Oklahoma City, OK 73125

EPA REG. NO. 34284-5

EPA EST. NO. 3131-OKC-1

NET CONTENTS:

22