


APPLICATIONS

Micro-Biocide #41 is used to inhibit the growth of algae, bacteria, and fungi in recirculating commercial and industrial cooling water systems. Before treatment with Micro-Biocide #41, systems must be cleaned to remove algal growth, microbiological slime, and other deposits. Then the system should be treated with an initial slug addition of 5.1 to 10.2 fluid ounces of Micro-Biocide #41 per 1,000 gallons of water in the system. Repeat the initial dosage until control is evident. Subsequent slug additions of 1.7 to 10.2 fluid ounces of Micro-Biocide #41 per 1,000 gallons of water should be made every 1 to 5 days or as needed. The required frequency of treatment depends on the relative amount of bleedoff and the severity of the microbiological problem. Slug additions of Micro-Biocide #41 should be made to the sump of water cooling towers.

EPA Reg. No. 35928-2

EPA Est. No. 35928-INO1

**MARATHON
INC.**

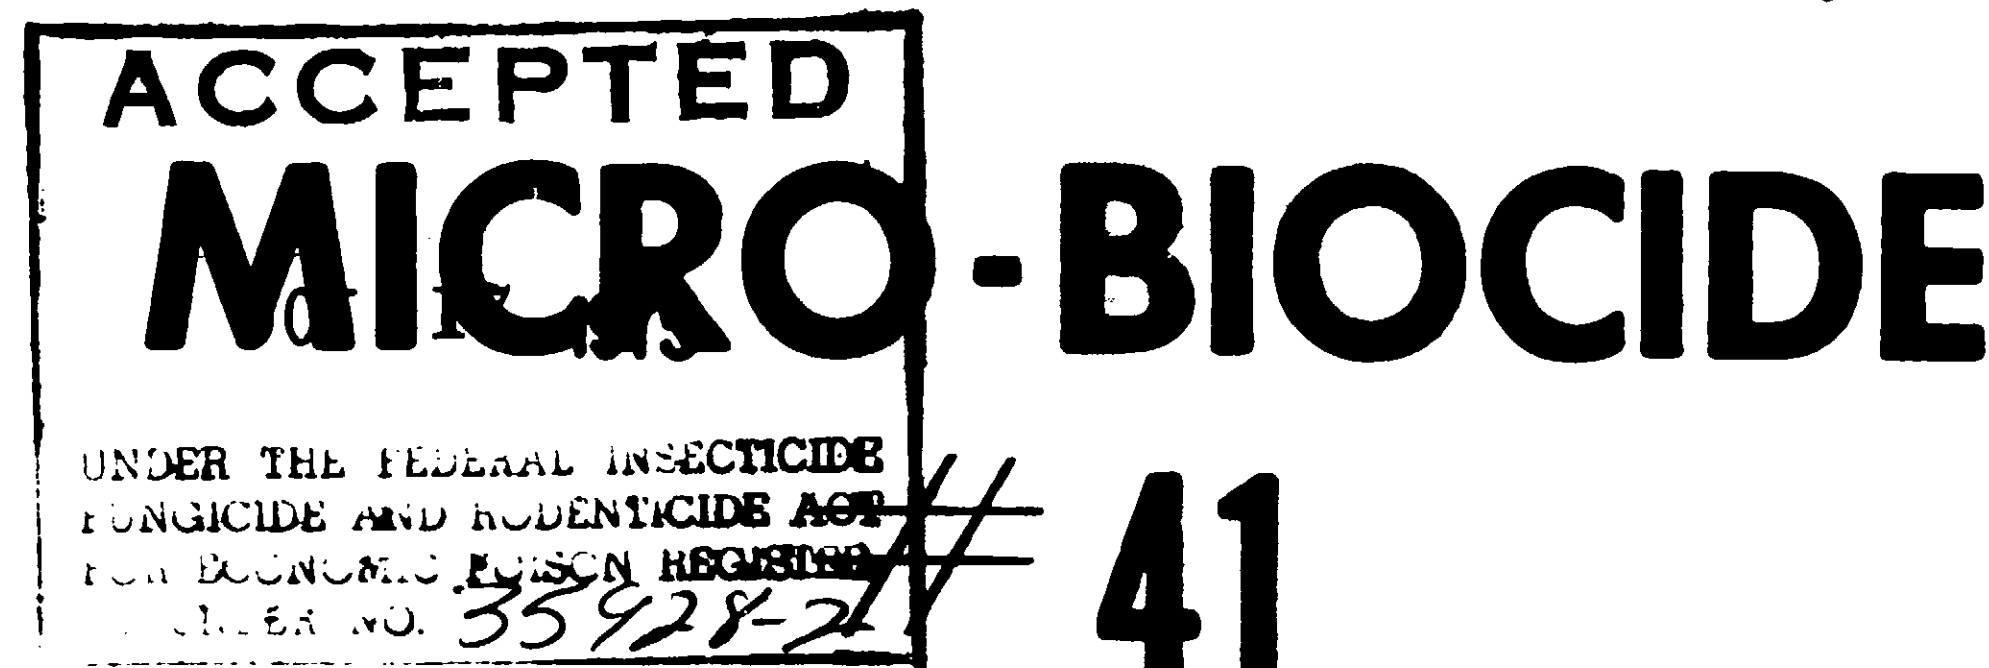

COMPOSITION

Active ingredients	11.66 percent
Disodium cyanodithioimidocarbonate	4.90 percent
Potassium N-methyldithiocarbamate	6.76 percent
Inert ingredients	88.34 percent

Mfg. by Marathon, Inc., Brownsburg, In. 46112

Wear
skin an
plenty
irritatio
contam

This
treated
not cor
ment of
on label
empty.

MARATHON INC.

ACCEPTED

MICRO-BIOCIDES

MICRO-BIOCIDES

UNDER THE FEDERAL INSECTICIDE
FUNGICIDE AND RODENTICIDE ACT
FOR ECONOMIC POISON REGISTRATION
REGISTERED UNDER NO. 35928-2

41

COMPOSITION

Active ingredients	11.66 percent
Disodium cyanodithioimidocarbonate	4.90 percent
Potassium N-methyldithiocarbamate	6.76 percent
Inert ingredients	88.34 percent

Mfg. by Marathon, Inc., Brownsburg, In. 46112

WARNING

KEEP OUT OF THE
REACH OF CHILDREN

Harmful if swallowed. Avoid contact with skin and eyes. In case of contact flush with plenty of water for at least 15 minutes. If eye irritation persists get medical attention. Avoid contamination of food.

This product is toxic to fish. Do not add treated effluent to lakes, streams or ponds. Do not contaminate water by cleaning of equipment or disposal of waste. Use only as directed on label. Do not reuse container. Destroy when empty.

Net Contents _____ Gal(s).

Lab Control No.