

PROTEAM SUPREME

THE
ULTIMATE
POOL WATER
TREATMENT

Compatible with
Bromine or Chlorine
Treated Pools

Developed to increase the efficiency of Bromine or Chlorine and reduce consumption of these costly sanitizers. Enhances water quality and reduces eye and skin irritation. Serves as a long lasting algae suppressant and creates sparkling blue swimming pool water.

ACTIVE INGREDIENT

Sodium Tetraborate Pentahydrate
Inert

99.5%
+ 0.5%

100.0%


EPA APPROVED -- PATENT PENDING

CAUTION

Keep out of reach of children. Causes eye, skin and breathing irritation. Do not mix Proteam Supreme with any other chemicals before adding to pool water. **FIRST AID:** 1. Skin contact — thoroughly wash with soap and water. 2. Eye contact — flush with large amounts of water, lifting lids, get medical attention. 3. If swallowed — induce vomiting, get medical attention. 4. Inhaled — move to fresh air, administer artificial respiration, get medical attention.

ACCEPTED
51708-11
AUG 27 1985
Under the Federal Insecticide,
Fungicide, and Rodenticide Act,
as amended, for the pesticide
Label No. under
EPA Reg. No.

NEW WEIGHT
Lbs
Kgs

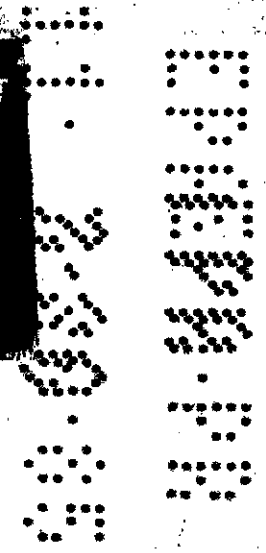

BEST AVAILABLE COPY

PROTEAM SUPREME

PROTEAM SUPREME increases the efficiency of the sanitizer (bromine or chlorine) by relieving it of much of its algacidal work. This cuts consumption of the costly sanitizer, and increases the length of filter run. Water quality is enhanced and eye and skin irritation is reduced. PROTEAM SUPREME is also a long lasting algae suppressant designed to control all types of algae found in swimming pools and aid in the removal of old algae stains.

DIRECTIONS

- 1— For initial application, introduce one pound of PROTEAM SUPREME per each one thousand gallons of pool water by broadcasting the material over the surface area of the pool with the filter running. This initial treatment should be added in two doses with one half of the necessary amount being added in each application.
- 2— The pH of the pool water will rise as a normal reaction to the introduction of PROTEAM SUPREME. After a normal turnover of pool water adjust the pH to 7.2-7.8 using a reliable acid demand test kit. PROTEAM SUPREME is compatible with all materials normally used in swimming pool maintenance.
- 3— Test the pool water a minimum of once a week or as may be required by local HEALTH Authority Regulations. The sanitizer level should be kept at a minimum of 1.0 ppm (parts per million) and proper water balance should be maintained. The PROTEAM SUPREME residual should be tested at least once each month and should be maintained at 20 ppm. A PROTEAM PRODUCTS dealer can provide this test and water analysis.
- 4— PROTEAM SUPREME is lost from the water only through filter backwash and splash-out. If replacement is required as indicated by a PROTEAM SUPREME water test, addition of one pound of PROTEAM SUPREME in 10,000 gallons will raise the level approximately two parts per million.

WINTERIZATION

A pool that has been treated with PROTEAM SUPREME will remain clear and beautiful throughout the winter months with little or no effort. The pool should be tested to assure that an adequate level of PROTEAM SUPREME (20 ppm) is present before being shut down.

STORAGE and DISPOSAL

STORAGE: Store in original container in a locked storage area inaccessible to children or pets. Storage areas should be cool and dry. Keep container tightly closed.

CONTAINER DISPOSAL: Completely empty container into application equipment. Then dispose of empty container in a sanitary landfill or by incineration.


Manufactured by:

The John Girvan Company

8296-S Western Way Circle, Jacksonville, FL 32216

EPA REG. NO. 51706-11


EPA EST. NO. 51706-FL-01

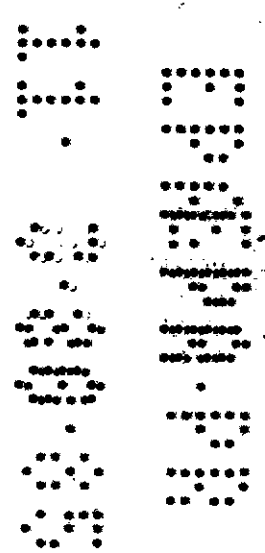

1/2 51708-11 10 32

Compatible with
Bromine or Chlorine
Treated Pools

Developed to
increase the efficiency
of Bromine or Chlorine and
reduce consumption of these
costly sanitizers. Enhances water
quality and reduces eye and skin
irritation. Serves as a long lasting algae
suppressant and creates sparkling blue swim-
ming pool water.

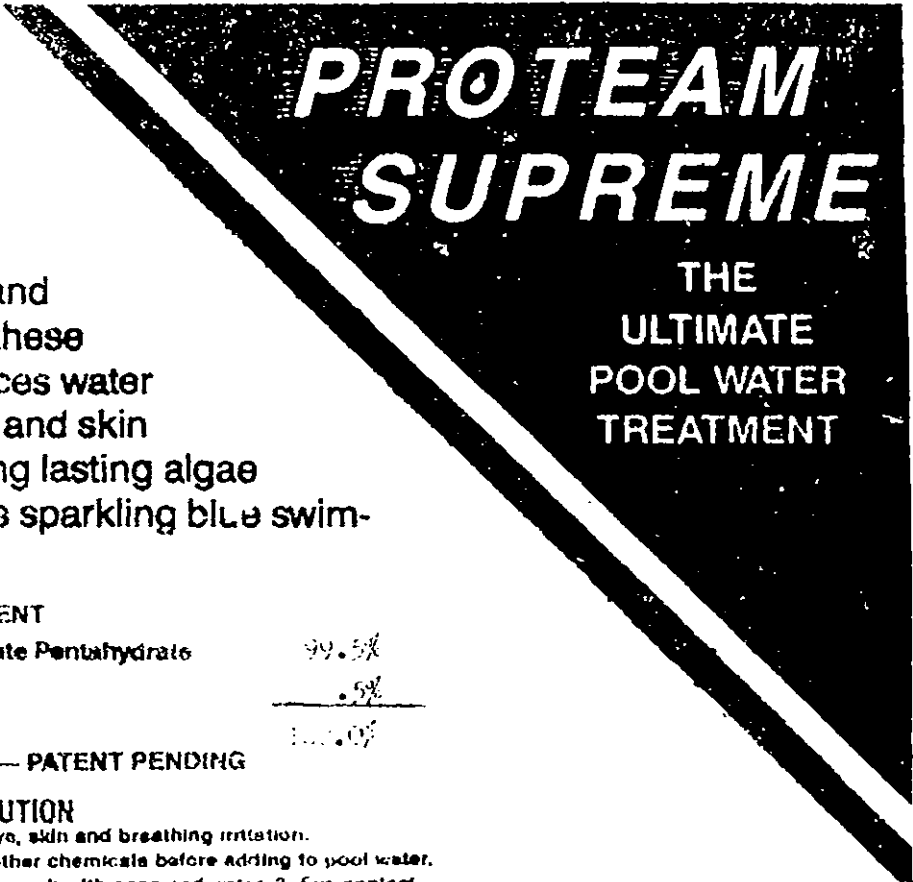

ACTIVE INGREDIENT

Sodium Tetraborate Pentahydrate 99.5%

Inert .5%

100.0%

EPA APPROVED — PATENT PENDING

CAUTION


Keep out of reach of children. Causes eye, skin and breathing irritation.

Do not mix Proteam Supreme with any other chemicals before adding to pool water.

FIRST AID: 1. Skin contact — thoroughly wash with soap and water. 2. Eye contact — flush with large amounts of water, lifting lids, get medical attention. 3. If swallowed — induce vomiting, get medical attention. 4. Inhaled — move to fresh air administer artificial respiration, get medical attention.

ACCEPTED
51708-11
AUG 27 1985
Under the Federal Insecticide,
Fungicide, and Rodenticide Act,
as amended, for the pesticide
registered under
EPA Reg. No.

NEW WEIGHT
Lbs.
Kgs

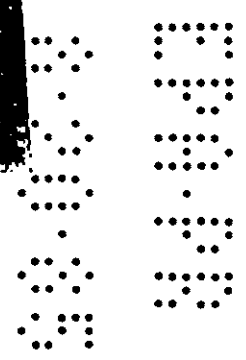

PROTEAM SUPREME

PROTEAM SUPREME increases the efficiency of the sanitizer (bromine or chlorine) by relieving it of much of its algaecidal work. This cuts consumption of the costly sanitizer, and increases the length of filter run. Water quality is enhanced and eye and skin irritation is reduced. PROTEAM SUPREME is also a long lasting algae suppressant designed to control all types of algae found in swimming pools and aid in the removal of old algae stains.

DIRECTIONS

- 1— For initial application, introduce one pound of PROTEAM SUPREME per each one thousand gallons of pool water by broadcasting the material over the surface area of the pool with the filter running. This initial treatment should be added in two doses with one half of the necessary amount being added in each application.
- 2— The pH of the pool water will rise as a normal reaction to the introduction of PROTEAM SUPREME. After a normal turnover of pool water adjust the pH to 7.2-7.8 using a reliable acid demand test kit. PROTEAM SUPREME is compatible with all materials normally used in swimming pool maintenance.
- 3— Test the pool water a minimum of once a week or as may be required by local HEALTH Authority Regulations. The sanitizer level should be kept at a minimum of 1.0 ppm (parts per million) and proper water balance should be maintained. The PROTEAM SUPREME residual should be tested at least once each month and should be maintained at 20 ppm. A PROTEAM PRODUCTS dealer can provide this test and water analysis.
- 4— PROTEAM SUPREME is lost from the water only through filter backwash and splash-out. If replacement is required as indicated by a PROTEAM SUPREME water test, addition of one pound of PROTEAM SUPREME in 10,000 gallons will raise the level approximately two parts per million.

WINTERIZATION

A pool that has been treated with PROTEAM SUPREME will remain clear and beautiful throughout the winter months with little or no effort. The pool should be tested to assure that an adequate level of PROTEAM SUPREME (20 ppm) is present before being shut down.

STORAGE and DISPOSAL

STORAGE: Store in original container in a locked storage area inaccessible to children or pets. Storage areas should be cool and dry. Keep container tightly closed.

CONTAINER DISPOSAL: Completely empty container into application equipment. Then dispose of empty container in a sanitary landfill or by incineration.

Manufactured by:

The John Girvan Company

8295-G Western Way Circle, Jacksonville, FL 32216
EPA REG. NO. 51708-11 EPA EST. NO. 51708-FL-01

