

59894-7

08/14/2002

1/4

MASTER LABEL REV.-2

K86 FRONT PANEL

10-01-01

## BACTRON K-86 MICROBIOCIDES

WATER TREATMENT MICROBIOCIDES FOR BUILDING AND INDUSTRIAL COOLING TOWERS, AND  
OIL FIELD WATER FLOODS OR SALT WATER DISPOSAL SYSTEMS.

Active Ingredients

Glutaraldehyde	43.30%
Alkyl (60% C <sub>14</sub> , 30% C <sub>16</sub> , 5% C <sub>18</sub> , 5% C <sub>12</sub> ) dimethyl benzyl ammonium chloride	3.50%
Alkyl (68% C <sub>12</sub> , 32% C <sub>14</sub> ) dimethyl ethyl benzyl ammonium chloride	3.50%

Other Ingredients

TOTAL	49.70%
	100.00%

**ACCEPTED**

AUG 14 2002

Under the Federal Insecticide, Fungicide, and  
Rodenticide Act as amended, for the  
pesticide, registered under  
EPA Reg. No. 59894-7

---

**KEEP OUT OF REACH OF CHILDREN**  
**DANGER**

---

**FIRST AID**

**IF IN EYES:** Hold eye open. Rinse slowly with water for 15-20 minutes. Remove contact lenses, if present, after the first 5 minutes, then, continue rinsing eye. Call a poison control center or doctor for treatment advice.

**IF ON SKIN OR CLOTHING:** Take off contaminated clothing. Rinse skin immediately with plenty of water for 15 to 20 minutes. Call a poison control center or doctor for treatment advice.

**IF SWALLOWED:** Call a poison control center or doctor immediately for treatment advice. Have person sip a glass of water if able to swallow. Do not induce vomiting unless told to do so by a poison control center or doctor. Do not give anything by mouth to an unconscious person. **Note to Physician:** Probable mucosal damage may contraindicate the use of gastric lavage.

**IF INHALED:** Move victim to fresh air. If not breathing, call 911 or an ambulance, then, give artificial respiration, preferably mouth-to-mouth, if possible. Call a poison control center or doctor for further treatment advice.

**SEE SIDE PANEL FOR ADDITIONAL PRECAUTIONARY STATEMENTS**

---


**M & S RESEARCH, INC**  
**11500 WEST HILL DRIVE**  
**ROCKVILLE, MD 20852**

Manufactured by: Champion Technologies, Inc.  
3355 W. Alabama, Suite 400  
Houston, Texas 77098

EPA Registration No.	59894-7			
EPA Establishment No.	8133-TX-01	8133-TX-02	8133-CA-01	8133-LA-02

**NET CONTENTS**

Net Volume	Net Weight
5 U.S. Gals	45 lbs
55 U.S. Gals	500 lbs

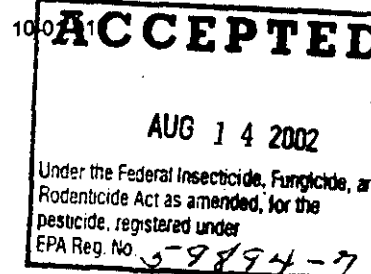

**PRECAUTIONARY STATEMENTS**  
**DANGER**  
**HAZARDS TO HUMANS AND DOMESTIC ANIMALS**  
**Keep Out of Reach of Children**

**Corrosive.** Causes severe eye and skin damage. May cause skin sensitization. Harmful or fatal if swallowed. Do not get in eyes, on skin or on clothing. Wear goggles, protective clothing and rubber gloves. Avoid breathing vapors. Wash thoroughly with soap and water after handling. Remove contaminated clothing and wash before reuse.

---

**ENVIRONMENTAL HAZARDS**

This pesticide is toxic to fish. Do not discharge effluent containing this product into lakes, streams, ponds, estuaries, oceans or any other waters, unless in accordance with requirements of National Pollutant Discharge Elimination System (NPDES) permit and permitting authority has been notified in writing prior to discharge. **DO NOT** discharge effluent containing this product into sewer systems without previously notifying local sewage treatment plant authority. For guidance contact your State Water Board or Regional Office of EPA.

---

**STORAGE AND HANDLING**

**BACTRON K-86** solutions are corrosive to many commonly used materials of construction such as steel, galvanized iron, aluminum, tin and zinc. These solutions can be stored and handled in baked phenolic-lined steel, polyethylene, stainless steel or reinforced epoxy-plastic equipment. To avoid freezing, locate the storage tank inside or underground, heating and insulation may be required. If heating is needed, exposure to high temperatures should be avoided. For short storage times (up to about 1 month), temperatures of up to 100° F can be tolerated, but the preferred maximum storage temperature is about 80° F. A stainless steel centrifugal pump is suggested for transfer service. Asbestos is suitable for gaskets and packing.

---

**PESTICIDE DISPOSAL**

Do not contaminate water, food or feed by storage or disposal. Open dumping is prohibited. Pesticide wastes are toxic. Improper disposal of excess pesticide, spray mixture or rinsate is a violation of Federal Law. If these wastes cannot be disposed of by use according to label instructions, contact your State Pesticide or your Environmental Control Agency, or the Hazardous Waste representative at the nearest EPA Regional Office for guidance.

---

**CONTAINER DISPOSAL**

Metal containers should be triple rinsed (or equivalent). Then, offer for recycling or reconditioning, or puncture and dispose of in a sanitary landfill or other procedures approved by state and local authorities. Plastic containers may be incinerated, if allowed by state and local authorities. If burned, stay out of smoke.

---

**USE AS HYDROGEN SULFIDE SCAVENGER (NON-BIOCIDAL):** This product may also be used as a hydrogen sulfide scavenger in oil field processing and refining operations. For hydrogen sulfide scavenging applications, inject **BACTRON K-86** full strength to attain concentrations of up to 500 ppm of active ingredient in target areas on a continuous basis or in slug treatment.

---

## DIRECTIONS FOR USE

It is a violation of Federal law to use this product in a manner inconsistent with its labeling

### WATER FLOODS

**BACTRON K-86** Microbiocide should be added to a water flood system at a point of uniform mixing such as the area of addition of make up water to the holding tank. **Initial Treatment:** When the system is noticeably contaminated, add 100 - 200 ppm BACTRON K-86 (0.09 - 0.18 gallons BACTRON K-86 per 1000 gallons flood water). Repeat until control is achieved. **Subsequent Dose:** When microbial control is evident, add 20 - 100 ppm BACTRON K-86 (0.09-0.18 gallons BACTRON K-86 per 1000 gallons flood water) weekly, or as needed to maintain control.

### DRILLING MUDS

**BACTRON K-86** Microbiocide should be added to a drilling fluid system at a point of uniform mixing such as a circulating tank. **Initial Treatment:** Add 50 - 1000 ppm BACTRON K-86 (0.19 - 3.8 gallons BACTRON K-86 per 100 barrels of fluid) to a freshly prepared drilling fluid depending on the severity of contamination. **Maintenance Dosage:** As the total volume of the system increases due to increased well depths, maintain 50 - 1000 ppm BACTRON K-86 level by adding 0.19 to 3.8 gallons of BACTRON K-86 per 100 barrels of additional fluid, or as needed, depending on the severity of contamination.

### COMPLETION AND WORKOVER FLUIDS

**BACTRON K-86** Microbiocide should be added to a packer fluid at a point of uniform mixing such as a circulating holding tank. Add 50 - 1000 ppm BACTRON K-86 (0.19 - 3.8 gallons BACTRON K-86 per 100 barrels of fluid) to freshly prepared fluid depending on the severity of contamination. Circulate the workover fluid system until the fluid returns clean, shut the system down and idle for several hours. Remove all the workover fluid. The well should be ready for productive use.

### PACKER FLUIDS


**BACTRON K-86** Microbiocide should be added to a packer fluid at a point of uniform mixing such as circulating holding tank. Add 50 - 600 ppm BACTRON K-86 (0.19 - 2.3 gallons BACTRON K-86 per 100 barrels of fluid) to a freshly prepared fluid depending on the severity of contamination. Seal the treated packer fluid in the wall between the casing and production tube.

---

HEALTH	2
FIRE	2
REACTIVITY	0
PERSONNAL PROTECTION	-

---

IN A CHEMICAL EMERGENCY CALL CHEMTREC AT 1-800-424-9300; BEFORE USING CONSULT MATERIAL SAFETY DATA SHEET. TO REQUEST A MATERIAL SAFETY DATA SHEET, CONTACT CHAMPION TECHNOLOGIES, INC. 713-431-2561, OR WRITE P.O. BOX 450499, HOUSTON, TEXAS 77245-0499

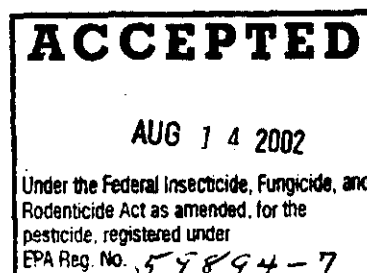

**DIRECTIONS FOR USE**  
(continued from right panel 1)

**COOLING TOWERS, AIR WASHERS AND RECIRCULATING COOLING WATER SYSTEMS**

**BACTRON K-86** Microbiocide should be added to a water treatment system at a point of uniform mixing such as the basin area. Addition may be made intermittently (SLUG DOSE) or continuously. Badly fouled systems can be shock treated with **BACTRON K-86** Microbiocide. Under these conditions, blow down should be discontinued for up to 24 hours.

**INTERMITTENT (SLUG DOSE) METHOD**

(1) Initial Dose: When the system is noticeably fouled, add 50 - 100 ppm (0.10 - 0.20 gallons) of **BACTRON K-86** Microbiocide per 1000 gallons of water to the system. Repeat until control is achieved.

(2) Subsequent Dose: When microbial control is evident, add 20 - 50 ppm (0.04 - 0.10 gallons) of **BACTRON K-86** Microbiocide per 1000 gallons of water to the system weekly, or as needed to maintain control. Badly fouled systems must be cleaned before treatment is begun.

**CONTINUOUS FEED METHOD**

(3) Initial Dose: When the system is noticeably fouled, apply 50 - 100 ppm (0.10 - 0.20 gallons) of **BACTRON K-86** Microbiocide per 1000 gallons of water in the system.

(4) Subsequent Dose: Maintain this treatment level by starting a continuous feed of 10 - 50 ppm (0.02 - 0.10 gallons) of **BACTRON K-86** Microbiocide per 1000 gallons of water in the system per day. Badly fouled systems must be cleaned before treatment is begun.

**HEAT TRANSFER SYSTEMS**

(Evaporate condensers, Hydrostatic Sterilizers and Retorts, and Pasteurizers and Warmers)

**BACTRON K-86** Microbiocide should be used at the same application rates, and in the same manner as described above. It should be added to the system at a point of uniform mixing such as a basin area, sump area, or other reservoir or collecting area from which the treated water will be circulated uniformly throughout the system.

**ACCEPTED**

AUG 14 2002

Under the Federal Insecticide, Fungicide, and  
Rodenticide Act as amended, for the  
pesticide, registered under  
EPA Reg. No. 59894-7