

Ultra-KleenTM Solution 1


Penetrates and Removes Biofilm and Other Organic Contaminants. Use as a Bactericide, Slimicide and Algicide in:

- Recirculating Cooling Water Systems
- Brewery Pasteurizing Systems
- Air Washers
- Pulp and Paper Mills producing pulp and paper that will not come in contact with food products
- Dye Machines
- Water-Jet Looms
- Tanks, Piping and Industrial Equipment used to store and convey Industrial Process Water or Aqueous Mixtures not related to food processing
- Deionized Water Supply Systems not used in food processing or for human drinking water or dental lines
- Drains and Filter Traps
- Chair Side Evacuator Traps and Pump Filter Traps

May be used with **Ultra-Kleen Solution 2** to adjust pH, to inhibit corrosion and to enhance cleaning. Please consult directions for use for specific recommendations.

Active Ingredients:

n-Alkyl(C ₁₂ 60%, C ₁₄ 30%, C ₁₆ 5%, C ₁₈ 5%) dimethylbenzylammonium chloride	3.00%
1,2-Dichloroethane dimethylbenzylammonium chloride	3.00%
TOTAL	94.00%
	100.00%

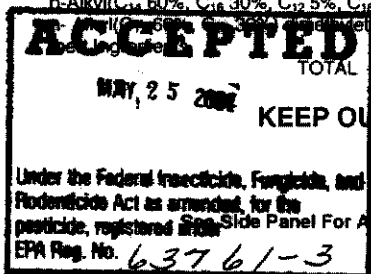

KEEP OUT OF REACH OF CHILDREN

DANGER

DIRECTIONS FOR USE

It is a violation of Federal law to use this product in a manner inconsistent with its labeling.

RECIRCULATING COOLING WATER SYSTEMS, INCLUDING COOLING TOWERS, EVAPORATIVE CONDENSERS AND BREWERY PASTEURIZERS. Effectively removes and controls biofilm and other organic contaminants in commercial and industrial cooling towers; influent water systems such as flow-through filters; and heat exchange water systems.

DOSAGE RATES. Initial Dose for badly fouled systems: Add 1 to 4 gal. Ultra-Kleen Solution 1 per 1000 gallons of water in the system. If cleaning is desired or if the pH of the system is below 8, add simultaneously Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1. Repeat until control is evident.

Routine Dose, when microbial control is evident: Subsequent slug additions of 28 to 64 oz. Ultra-Kleen Solution 1 per 1000 gallons of water (and if cleaning is desired or the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) should be employed every 2 to 5 days or as needed. The frequency of addition depends on the relative amount of bleedoff, the quality of the makeup water and rate of inflow of airborne or other contaminants. Slug additions should be made in the sump of water cooling towers.

AIR WASHERS. For use only in industrial air washing systems that maintain effective mist eliminating components. Effectively removes and controls biofilm and other organic contaminants in Industrial Water Scrubbing Systems.

DOSAGE RATES. Initial Dose for badly fouled systems: Add 3 to 16 gal. of Ultra-Kleen Solution 1 per 1000 gallons of water in the system. If cleaning is desired or if the pH of the system is below 8, add simultaneously Ultra-Kleen Solution 2

at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1. If necessary, apply a solution containing 0.4 to 2 oz. Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per gallon of water onto interior surfaces of the system that are not continuously submerged. Repeat until control is evident.

Routine Dose, when microbial control is evident: Subsequent slug additions of 28 to 128 oz. Ultra-Kleen Solution 1 per 1000 gallons of water and if cleaning is desired or the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1 should be employed every 1 to 5 days or as needed. The frequency of addition depends on the relative amount of bleedoff, the quality of the makeup water and rate of inflow of airborne or other contaminants. Slug additions should be made in the sump of Industrial Water Scrubbing Systems.

PULP AND PAPER MILLS. For use only in the production of pulp and paper that will not come in contact with food. Effectively removes and controls biofilm and other organic contaminants in pulp and paper mill fresh and seawater influent water systems, wastewater treatment systems, nonpotable water systems, and other process water.

DOSAGE RATES. Initial Dose for badly fouled systems: Add 3 to 16 gal. of Ultra-Kleen Solution 1 per 1000 gallons of water in the system. If cleaning is desired or if the pH of the system is below 8, add simultaneously Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1. If necessary, apply a solution containing 0.4 to 2 oz. Ultra-Kleen Solution 1 per gallon of water (and if cleaning is desired or if the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) onto interior surfaces of the system that are not continuously submerged.

Routine Dose, when microbial control is evident: Subsequent slug additions of 8 to 50 oz. Ultra-Kleen Solution 1 per 1000 gallons of water (and if cleaning is desired or if the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) should be employed every 1 to 5 days or as needed. The frequency of addition depends on the quality of the makeup water and rate of inflow of airborne or other contaminants.

DYE MACHINES. Effectively removes and controls biofilm and other organic contaminants in Textile Dyeing Machines.

DOSAGE RATES. Add 16 to 40 gal. of Ultra-Kleen Solution 1 per 1000 gallons of water in a dye storage tank. If cleaning is desired or the pH of the mixture is below 8, add simultaneously Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1. Circulate the mixture from the dye storage tank through the dye machine and all associated piping and other dye storage tanks. If necessary, apply a solution containing 2 to 5 oz. Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the mixture is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per gallon of water onto surfaces of the system that are not continuously submerged.

WATER-JET LOOMS. Effectively removes and controls biofilm and other organic contaminants in Water-Jet Looms.

DOSAGE RATES. Initial Dose for badly fouled systems: Prepare a mixture of 2 to 5 oz. of Ultra-Kleen Solution 1 per gallon of water. If cleaning is desired or if the pH of the mixture is below 8, add Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1. Pump the mixture through the Water-Jet Loom and all associated piping. If necessary, apply a solution containing 2 to 5 oz. of Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per gallon of water onto surfaces of the system that are not continuously submerged.

Subsequent Dose, when microbial control is evident: Subsequent slug additions of 5 to 25 oz. Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the mixture is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per 1000 gallons of daily water use should be employed every 1 to 5 days or as needed. The frequency of addition depends on the quality of the makeup water and rate of inflow of airborne or other contaminants.

TANKS, PIPING AND INDUSTRIAL EQUIPMENT USED TO STORE AND CONVEY INDUSTRIAL PROCESS WATER OR AQUEOUS MIXTURES. Do Not Use in equipment that will contact food. Effectively removes and controls biofilm and other organic contaminants in Tanks, Piping and Industrial Equipment used to store and convey Industrial Process Water or Aqueous Mixtures.

DOSAGE RATES. Fill equipment as completely as possible with a solution of 8 to 80 gal. of Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the mixture is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per 1000 gallons of system capacity. Circulate for at least 4 hours and then drain system. Rinse system with 6 volumes of water. If necessary, apply a solution containing 1 to 10 oz. Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the mixture is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per gallon onto surfaces of the equipment that are not submerged.

DEIONIZED WATER SUPPLY SYSTEMS NOT USED IN FOOD PROCESSING, FOR HUMAN DRINKING WATER OR DENTAL LINES. Effectively removes and controls biofilm and other organic contaminants in Tanks, Filters and Piping used to store and convey Deionized Water.

DOSAGE RATES. Add 3 to 16 gal. of Ultra-Kleen Solution 1 and if cleaning is desired or the pH of the mixture is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1 per 1000 gallons of system capacity. Circulate for at least 4 hours and then drain system. Rinse system with 6 volumes of water. If necessary, apply a solution containing 0.4 to 2 oz. Ultra-Kleen Solution 1 (and if cleaning is desired or the pH of the system is below 8, Ultra-Kleen Solution 2 at the rate of 1 to 3 times the volume of Ultra-Kleen Solution 1) per gallon onto surfaces of the equipment that are not submerged.

DRAINS. Effectively removes and controls plugging and odors caused by accumulation of biofilm and other organic contaminants in drains. Prevents stoppage and odors.

63761-3

05/25/2007

1/2

DOSAGE RATES. Initial Dose for badly fouled systems. Pour from 10oz. Ultra-Kleen Solution 1 around or into one-inch diameter or smaller drains up to 90 oz. Ultra-Kleen Solution 1 around or into three-inch diameter drains. Add simultaneously Ultra-Kleen Solution 2 at the same volume as Ultra-Kleen Solution 1 (10-90 oz). If the drain is not in use at the time, follow with one gallon of hot water for every 10 oz. of Ultra-Kleen Solution 1 added. Allow to stand for 30 minutes. Repeat until control is evident.

Subsequent Dose: When microbial control is evident, subsequent additions of 1.5-2 oz Ultra-Kleen Solution 1 into one-inch diameter or smaller drains up to 15 oz Ultra-Kleen Solution 1 into three-inch diameter drains, should be employed every 7 days or as needed. Add simultaneously Ultra-Kleen Solution 2 at the same volume as Ultra-Kleen Solution 1 (1.5-15oz). If the drain is not in use at the time, follow with one gallon of hot water for every 1.5 oz of Ultra-Kleen Solution 1 added.

CHAIR SIDE EVACUATOR TRAPS AND PUMP FILTER TRAPS. Effectively removes and controls plugging and odors caused by accumulation of biofilm in chair side evacuator traps and pump filter traps. Prevents stoppage and odor.

DOSAGE RATES. Initial Dose for badly fouled systems. Mix 10 oz. of Ultra-Kleen Solution 1 and 10 oz. of Ultra-Kleen Solution 2 into one gallon of hot water at the end of the working day. Draw all of the solution into the trap and allow to stand overnight. Repeat until control is evident.

Subsequent Dose: When microbial control is evident, subsequent slug additions of 1.5-2 oz. Ultra-Kleen Solution 1 and 1.5-2 oz of Ultra-Kleen Solution 2 mixed into one gallon of hot water should be employed every 7 days or as needed.

When mixtures of Ultra-Kleen Solution 1 and Ultra-Kleen Solution 2 are prepared in a batch process, always use the mixtures the same day they are prepared.

Sold By:
STERILEX CORPORATION
 11409 Cronhill Drive Ste L
 Owings Mills, MD 21117
 Phone: 1-800-511-1659 Fax: 410-581-8864



PRECAUTIONARY STATEMENTS

HAZARDS TO HUMANS AND DOMESTIC ANIMALS

DANGER. CORROSIVE. Causes irreversible eye damage and skin burns. Harmful if swallowed or absorbed through skin. Do not get in eyes, on skin, or on clothing. Wear goggles and/or face shield, protective clothing and rubber gloves. Wash thoroughly with soap and water after handling. Remove contaminated clothing and wash clothing before reuse.

ENVIRONMENTAL HAZARDS. This product is toxic to fish. Do not discharge effluent containing this product into lakes, streams, ponds, estuaries, ocean or other waters unless in accordance with the requirements of a National Pollution Discharge Elimination System (NPDES) permit and the permitting authority has been notified in writing prior to discharge. Do not discharge effluent containing this product to sewer systems without previously consulting the local sewage treatment plant authority. For guidance contact your local State Water Board or Regional Office of the EPA.

PHYSICAL AND CHEMICAL HAZARDS. When exposed to fire Ultra-Kleen Solution 1 may release oxygen and oxides of carbon and/or nitrogen.

FIRST AID

IF IN EYES:	Hold eye open and rinse slowly and gently with water for 15-20 minutes. Remove contact lenses, if present, after the first 5 minutes, then continue rinsing the eyes. Call a poison control center or doctor for treatment advice.
IF ON SKIN OR CLOTHING:	Take off contaminated clothing. Rinse skin immediately with plenty of water for 15-20 minutes. Call a poison control center or doctor for treatment advice.
IF SWALLOWED:	Call a poison control center or doctor immediately for treatment advice. Have a person sip a glass of water if able to swallow. Do not induce vomiting unless told to do so by the poison control center or doctor. Do not give anything by mouth to an unconscious person.
Have the product container or label with you when calling a poison control center or doctor, or going for treatment.	
NOTE TO PHYSICIAN:	Probable mucosal damage may contraindicate the use of gastric lavage.

NOTE: Seller warrants that this product complies with the specifications expressed in this label. Seller makes no other warranties; and disclaims all other warranties, express or implied, including but not limited to warranties of merchantability and fitness for the intended purpose. Seller's liability for default, breach or failure under this label shall be limited to the amount of the purchase price. Seller shall have no liability for consequential damages.

STORAGE AND DISPOSAL

Do not contaminate water, food or feed by improper storage or disposal.

STORAGE: Keep product in closed original container when not in use. Store in a cool area away from potential sources of heat, open flames, sunlight or other chemicals. Product should be stored below 90°F.

PESTICIDE DISPOSAL: Pesticide wastes are acutely hazardous. Improper disposal of excess pesticide, spray mixture or rinsate is a violation of Federal Law. If these wastes cannot be disposed of by use according to label instructions, contact your State Pesticide or Environmental Control Agency, or the Hazardous Waste Representative at the nearest EPA Regional Office for guidance.

CONTAINER DISPOSAL: Completely empty and triple-rinse container into application equipment. Dispose of empty container in a sanitary landfill, or incinerate. Burn only if allowed by state and local authorities.

NET WEIGHT _____ EPA REG. NO. 63761-3
 LOT NO. _____ EPA EST. NO. 4875-NJ-001

2/2