


Figure 2: Location of Thermistors for Water Temperature Monitoring in Mount Hope Bay

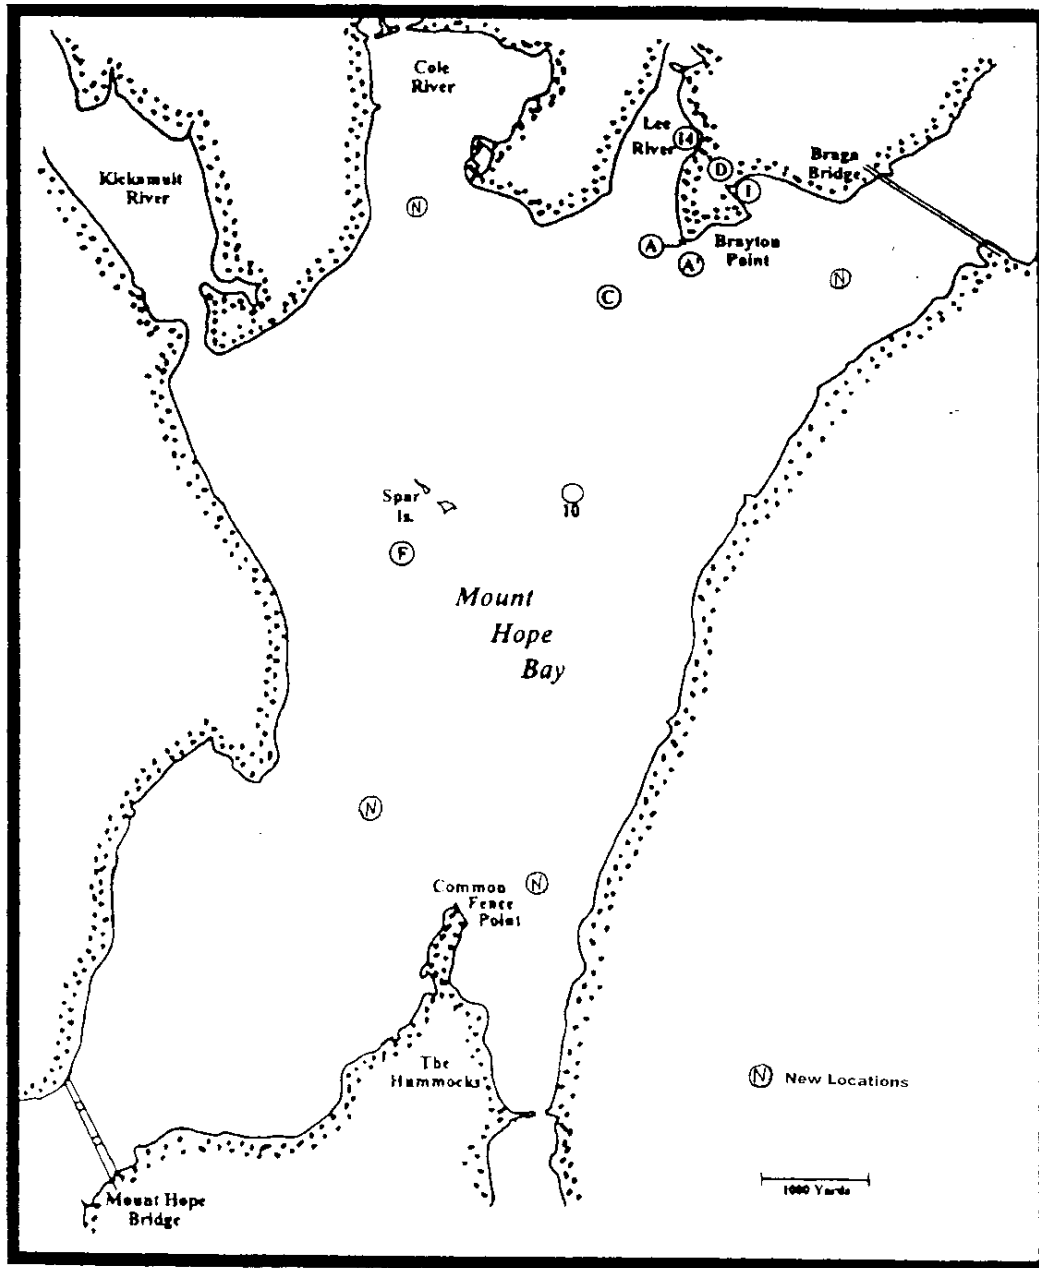

Revised from: PG&E Generating and Marine Research, Inc., Brayton Point Station 1998 Annual Report, September 1999.