




TERMINAL YARD

BROADWAY  
EMERGENCY VEHICLE ACCESS  
EMERGENCY EVACUATION

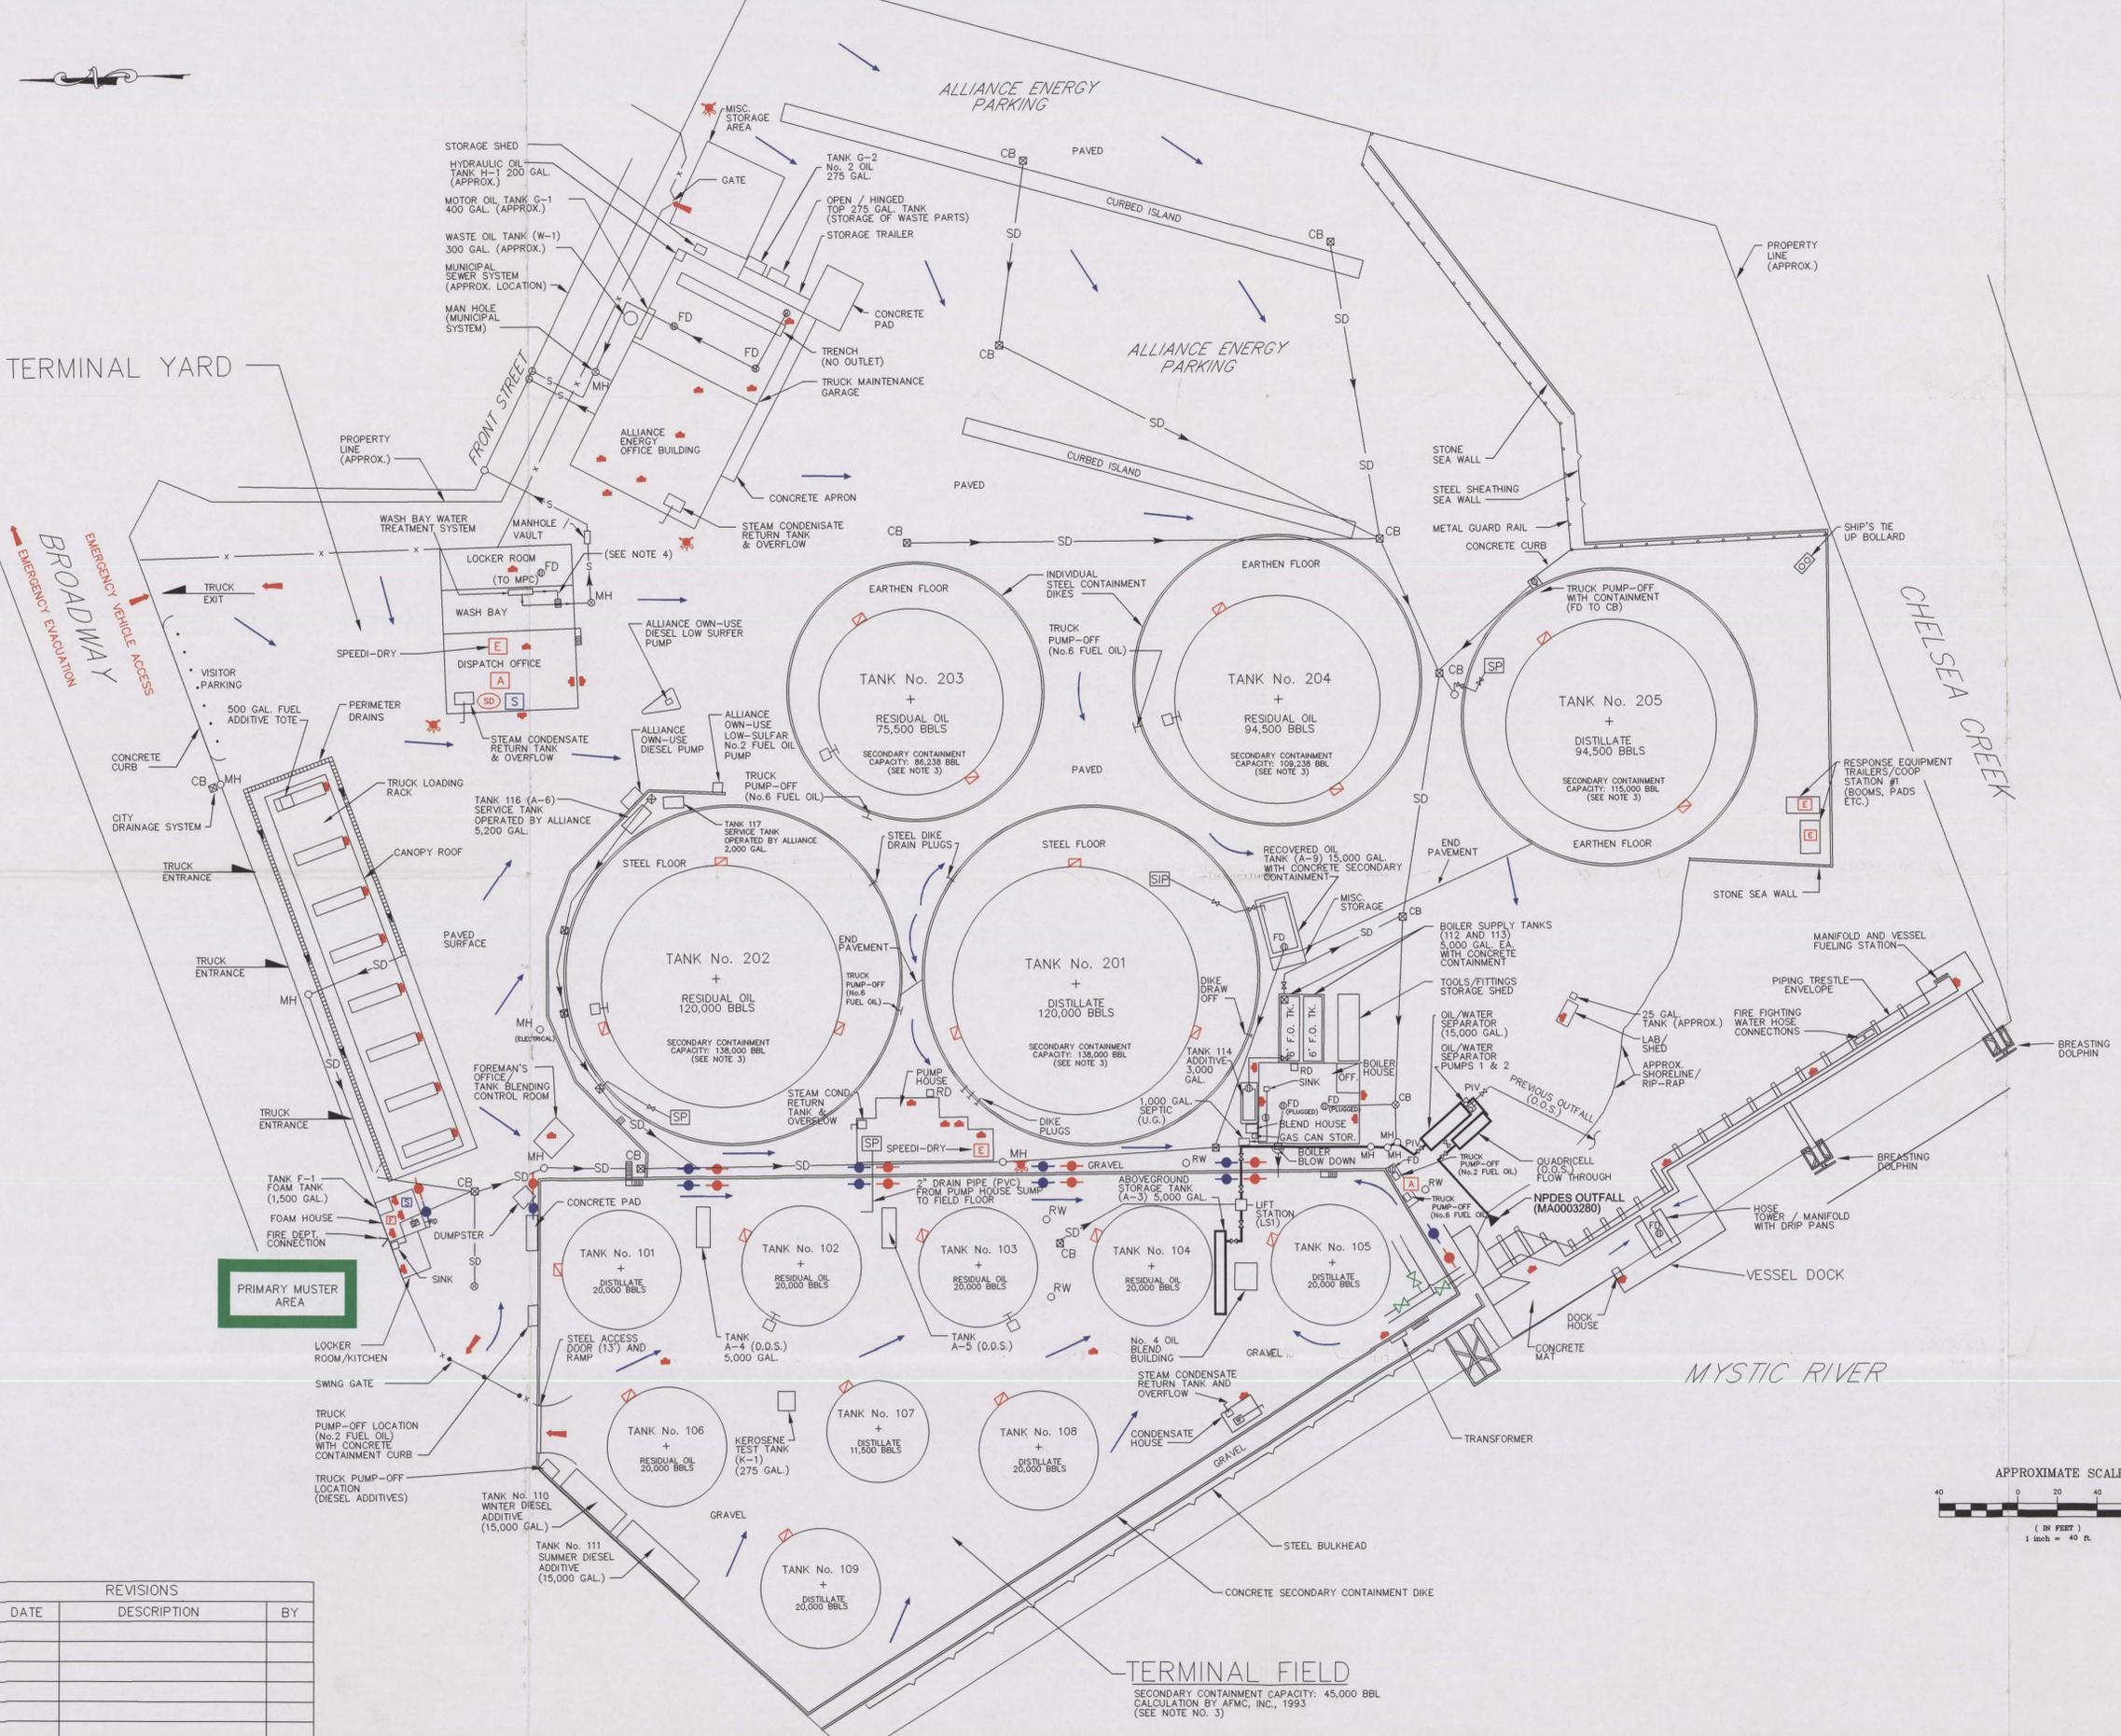


LEGEND

- WATER CONNECTION
- FOAM CONNECTION
- INFERRED STORM WATER FLOW DIRECTION
- EMERGENCY SHUT DOWN SWITCH
- EMERGENCY EQUIPMENT
- ROOF DRAIN
- SUMP EQUIPPED W/ PUMP
- POST INDICATOR VALVE
- TERMINAL ACCESS / EXITS
- FIRE EXTINGUISHER
- WATER HYDRANT
- FOAM CHAMBER
- SPRINKLER ACTIVATION SWITCH
- GATE VALVE (TYPICAL)
- U.S.C.G. JURISDICTIONAL VALVE
- SECONDARY CONTAINMENT DIKE
- MANHOLE
- CATCH BASIN
- PROPERTY LINE
- FOAM SYSTEM ACTIVATION SWITCH
- FIRE DEPARTMENT CONNECTION
- PULL ALARM
- RECOVERY WELL

NOTES:

1. THIS TERMINAL PLOT PLAN WAS MODIFIED FROM "SITE PLAN", (FILE NO. S1177851.DWG) PREPARED BY ENVIRONMENTAL COMPLIANCE SERVICES, INC. DATED FEB. 1994, AND "SITE PLAN" (DWG. NO. 2394-C-18) PREPARED BY CLEAN HARBORS ENVIRONMENTAL SERVICES, INC. DATED 7/93 PRESENTED IN THE TERMINAL SPEC PLAN (1993). ADDITIONAL INFORMATION WAS PROVIDED BY CHELSEA TERMINAL AND COLLECTED DURING SITE INSPECTIONS CONDUCTED BY TRITON ENVIRONMENTAL (APRIL & SEPTEMBER 1994).
2. PRODUCT PIPING AND FIRE PROTECTION SYSTEM PIPING ARE SHOWN IN FIGURES 3 AND 4 OF THIS ICP, RESPECTIVELY.
3. SECONDARY CONTAINMENT INFORMATION WAS TAKEN FROM OILP'S PREVIOUS SPEC PLAN PREPARED BY AFMC, INC. DATED AND CERTIFIED IN 1993.
4. PERMITTED DISCHARGE (WMRA 11 000614) FROM WASH BAY WATER TREATMENT SYSTEM IS THROUGH THE CATCH BASIN VIA A CLOSED PIPE TO DOMESTIC SEWER SYSTEM.
5. THE LOCATIONS OF STRUCTURES, FEATURES AND EQUIPMENT PRESENTED ON THIS PLAN SHOULD BE CONSIDERED APPROXIMATE. THE LOCATIONS OF TERMINAL EQUIPMENT HAS BEEN SHOWN SCHEMATICALLY BASED ON INFORMATION PROVIDED BY CHELSEA TERMINAL AND IS NOT BASED ON A SURVEY OF THE PROPERTY. THIS DRAWING SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. TRITON MAKES NO WARRANTY AS TO THE CORRECTNESS OR COMPLETENESS OF THE INFORMATION CONTAINED IN THIS DRAWING, AND THE USER ASSUMES ALL RISK OF LOSS TO PERSONS AND TO PROPERTY FROM RELIANCE THEREON.



REVISIONS			
NO.	DATE	DESCRIPTION	BY

TERMINAL FIELD  
SECONDARY CONTAINMENT CAPACITY: 45,000 BBL  
CALCULATION BY AFMC, INC., 1993  
(SEE NOTE NO. 3)

**TRITON ENVIRONMENTAL, INC.**  
101 Whitney Avenue  
New Haven, Connecticut 06510  
(203) 498-8833

FIGURE 2  
TERMINAL PLOT PLAN

CHELSEA SANDWICH, L.L.C.  
11 BROADWAY  
CHELSEA, MASSACHUSETTS

DRAWN BY: WJM      DATE: 6/8/00  
APPROVED BY: WJM      FILE NO.: 99230C