

H-1375-1-01 (8100)
February 11, 2010



US Environmental Protection Agency
Attention: Ms. Robin Johnson
Hydroelectric GP Processing
Municipal Assistance Unit (OEP06-3)
5 Post Office Square - Suite 100
Boston, MA 02109-3912

MAG 360006

Re: **Holyoke Gas & Electric - General NPDES Permit for Hydroelectric Facilities**

Dear Ms. Johnson:

On behalf of our client, Holyoke Gas & Electric, headquartered at 99 Suffolk Street in Holyoke, Massachusetts, we are submitting the enclosed Notice of Intent (NOI) to request coverage under the General Permit to discharge wastewater from Hydroelectric Generating facilities (NPDES General Permit No. MAG360000). Included in this packet, you will find NOI and supporting information for the Hadley Falls Station (MA0035882). It should be noted that all outfalls discharge intermittently into the tail race and are unsafe to sample. However, samples can be obtained from sumps discharging to Outfalls 002 and 003, which will require a confined space entry.

In addition, we have attached the previous Endangered Species Act Section 7 consultation as the facility discharges to the Connecticut River.

If you should any questions, please contact either Todd Ostrowski at (413) 572-3282 or me at (413) 572-3265.

Very truly yours,

TIGHE & BOND, INC.

Thomas C. Couture, P.E.
Senior Vice President

Enclosures

Copy: Charles Martel - Holyoke Gas & Electric (w/encl)
Robert Kubit - Massachusetts Department of Environmental Protection

J:\H\H1375\NOI\Hadley Fallstransmittal.Doc

7. Attach a topographic map indicating the location of the facility and the outfall(s) to the receiving water. Map attached? Yes

8. Provide the number of turbines and the combined turbine discharge (installed capacity) at maximum and minimum output, in cubic feet per second (cfs). Number of turbines 2 Combined turbine discharge (installed capacity): maximum output, cfs 8,400 and minimum output, cfs 0

9. Is the hydroelectric generating facility operated as a pump storage project?

B. Discharge Information (attach additional sheets as needed).

1. Name of receiving water into which discharge will occur: Connecticut River
Freshwater: Marine Water:

2. Attach a line drawing or flow schematic showing water flow through the facility including sources of intake water, operations contributing flow, treatment units, outfalls, and receiving waters(s). Line drawing or flow schematic attached? Yes

3. List each outfall under the following categories and number sequentially: equipment-related cooling water; equipment and floor drain water; maintenance-related water; facility maintenance-related water during flood/high water events, and equipment-related backwash strainer water (see Parts I.A.1, 2, 3, and 4; or Parts I.B.1, 2, 3, and 4). Attach additional sheets to identify outfalls as needed.

Equipment-related cooling water

Outfalls 001, 002, and 003

Equipment and floor drain water

Outfalls 001, 002, and 003

Maintenance-related water

Outfalls 002 and 003

Facility maintenance-related water during flood/high water events

Outfalls 002 and 003

Equipment-related backwash strainer water

Outfall 003

4. List each outfall discharging any combination of the following to identify the combined discharges: equipment-related cooling water, equipment and floor drain water, maintenance-related water, equipment-related backwash strainer water, and facility maintenance-related water during flood/high water events (see Parts I.A.5 and B.5) and continue the sequential numbering. Attach additional sheets to identify outfalls as needed.

5. Provide for each outfall the following:

- a. Latitude and longitude to the nearest second (see EPA's siting tool at: http://www.epa.gov/tri/report/siting_tool/) and the name(s) of the receiving water(s) into which the discharge will occur.
- b. The operations contributing flow and the treatment received by the discharge. Indicate the average flow from each operation.
- c. Indicate if the discharge can be sampled at least once per year or can be sampled using the representative outfall sampling provisions (see Parts I.A.6 or B.6 and III.E).
- d. Note if the outfall discharges intermittently or seasonally.

C. Chemical Additives

Are any non-toxic neutralization chemicals used in the discharge(s)? Yes ___ No ___ ^X If so, include the chemical name and manufacturer; maximum and average daily quantity used on a monthly basis as well as the maximum and average daily expected concentrations (mg/l) in the discharge, and the vendor's reported aquatic toxicity (NOAEL and/or LC₅₀ in percent for typically acceptable aquatic organism).

D. Endangered Species Act Eligibility Information

A facility, with a previous ESA Section 7 consultation with the National Marine Fisheries Service (NMFS), seeking coverage under the Massachusetts general permit and discharging to the Connecticut River or Merrimack River should provide one of the following, if available.

1. A formal certification indicating consultation with the National Marine Fisheries Service (NMFS) resulted in either a no jeopardy opinion or a written concurrence on a finding that the discharges are not likely to adversely affect the shortnose sturgeon or critical habitat. Information should also be provided indicating the hydroelectric facility's previous ESA Section 7 consultation with NMFS covered the discharges to be authorized under this general permit and demonstrating no significant changes in the discharges have occurred since the previous consultation.
2. Another operator's certificate of the ESA eligibility for those discharges to be authorized under this general permit.

E. Supplemental Information

Please provide any supplemental information, including antidegradation review information applicable to new or increased discharges. Attach any certification(s) required by the general permit.

F. Signature Requirements

The Notice of Intent must be signed by the operator in accordance with the signatory requirements of 40 CFR Section 122.22 (see below) including the following certification:

I certify under penalty of law that no chemical additives are used in the discharges to be authorized under this general permit except for those used for pH adjustment and (2) this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted.

Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, I certify that the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I certify that I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature _____ Date _____

Printed Name and Title _____

Federal regulations require this application to be signed as follows:

1. For a corporation, by a principal executive officer of at least the level of vice president;
2. For partnership or sole proprietorship, by a general partner or the proprietor, respectively, or,
3. For a municipality, State, Federal or other public facility, by either a principal executive officer or ranking elected official.

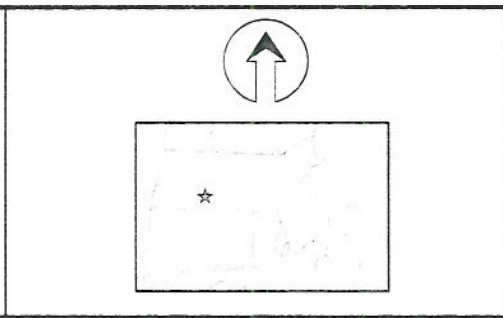
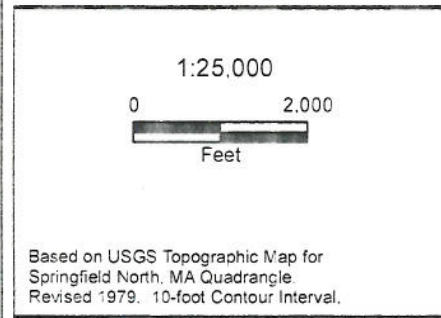
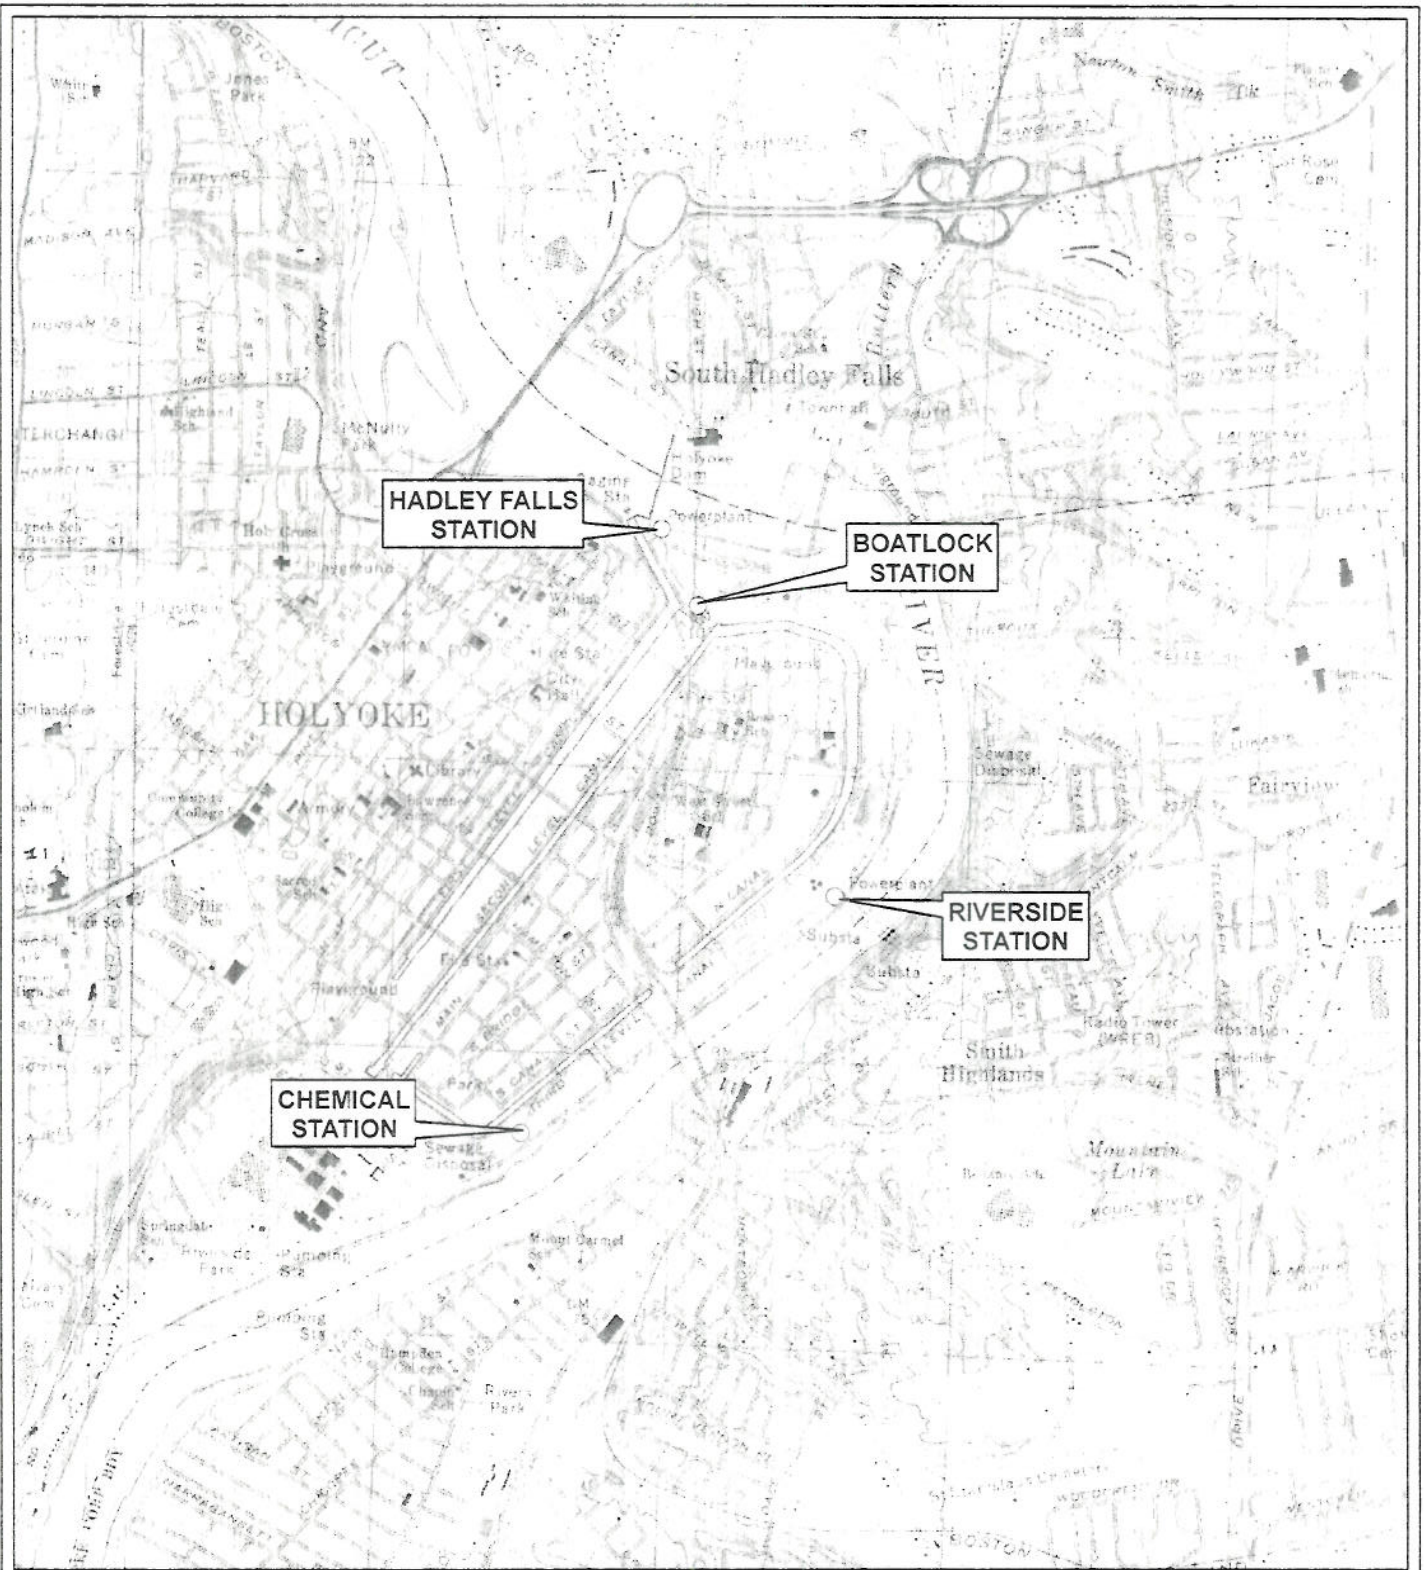


FIGURE 1
SITE LOCUS MAP

Holyoke, Massachusetts


Tighe & Bond

February 2010

HADLEY FALLS STATION
 NPDES INDIVIDUAL PERMIT MA0035882
 NPDES GENERAL PERMIT MAG3600000
 February 2010

Outfall 001 includes lubrication water and lantern ring water, which ensures proper seal on the shaft. The water, which is non-contact, is discharged directly into the Connecticut River via the tail race. Outfall 002 captures all lubrication and non-contact cooling water associated with Hadley Falls 1 Generator including floor drain water as well as backwash strainer water. Outfall 002 also discharges into the tail race intermittently or into Outfall 003, but can be sampled from the sump prior to discharging. Outfall 003 includes all non-contact cooling water associated with Hadley Falls 2 Generator and discharges directly into the tail race.

Connecticut River

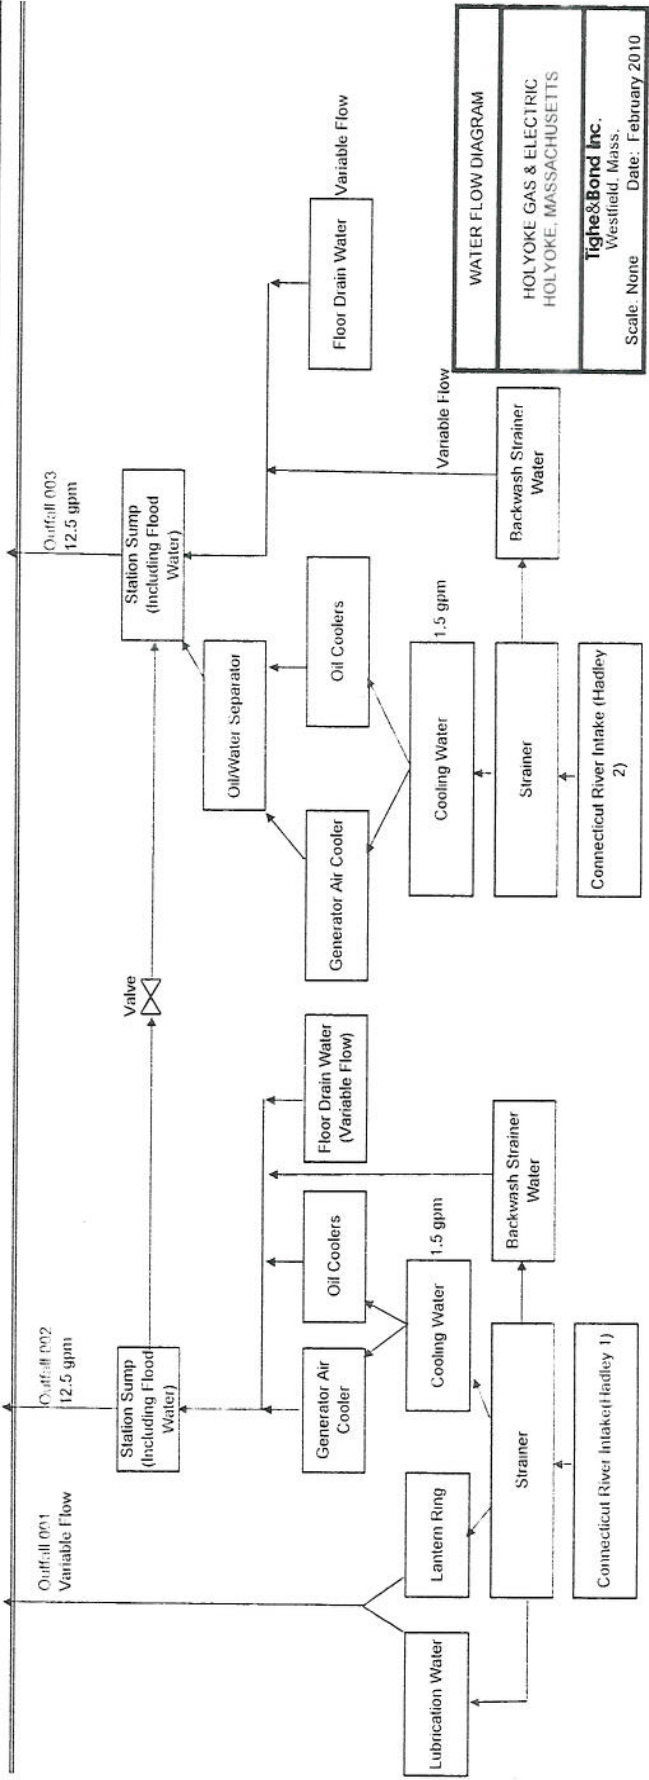

WATER FLOW DIAGRAM
 HOLYOKE GAS & ELECTRIC
 HOLYOKE, MASSACHUSETTS
IQHE&BOND Inc.
 Westfield, Mass.
 Scale: None Date: February 2010