


Figure 5.9.2-7 Kendall Station cooling water intake continuous temperatures compared with discrete temperatures collected by the Massachusetts Water Resources Authority (MWRA). MWRA value was averaged from a near surface and a near bottom temperature taken near the BU Bridge. The same calculation was performed on Hyatt Station data collected further downstream in the Basin (January - December 1999).

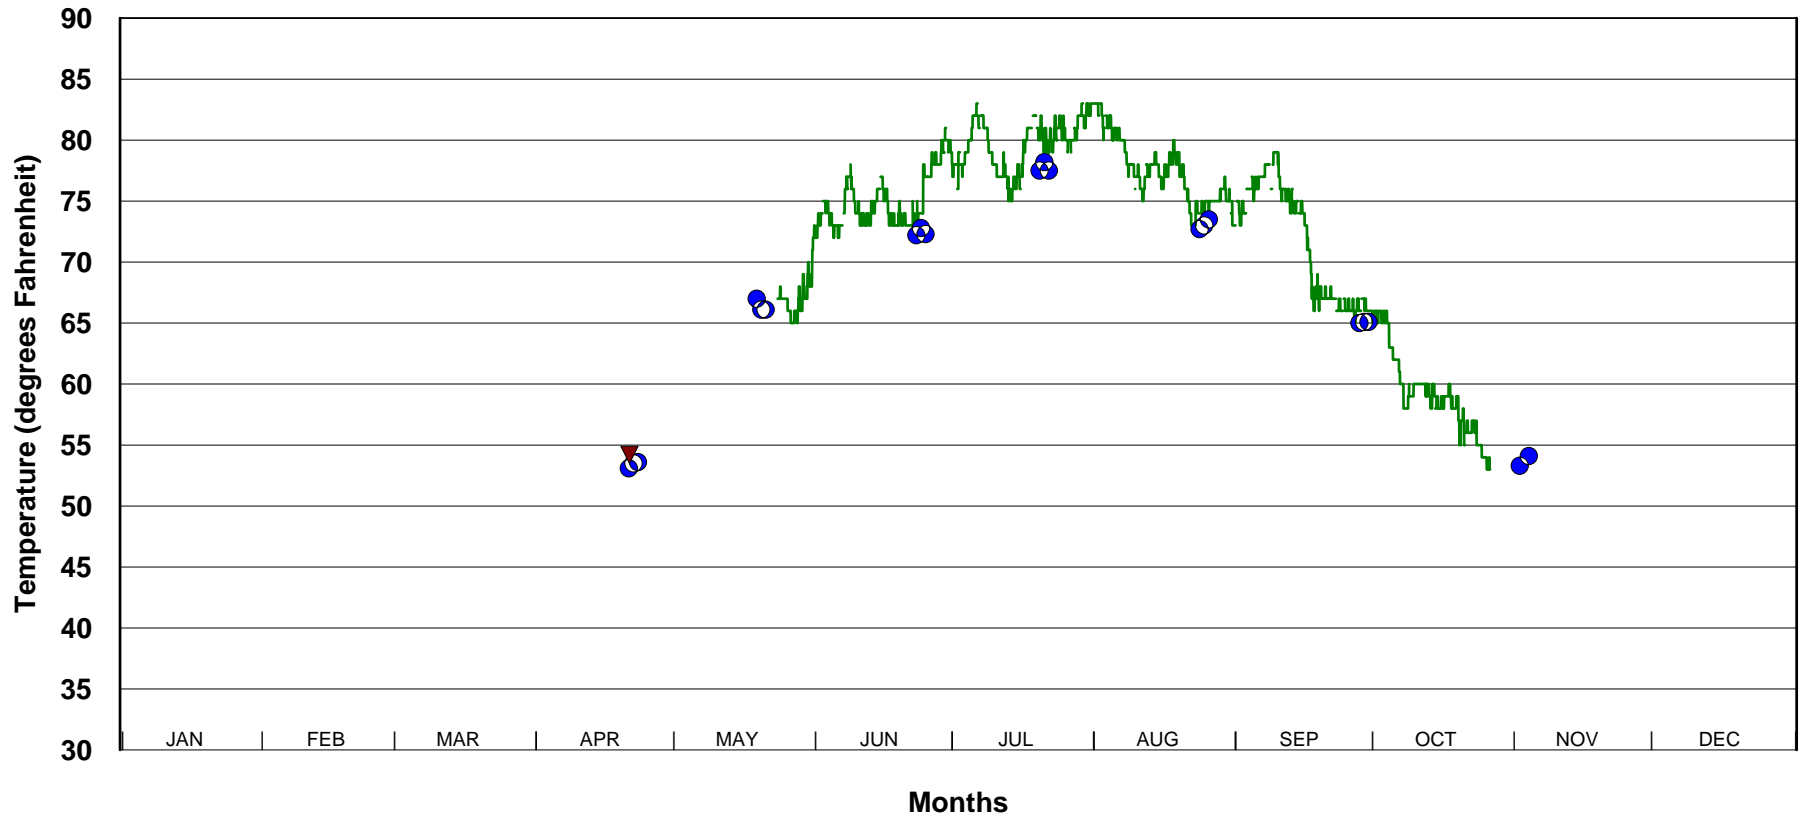

Data Source: Mirant Kendall and MWRA

1999 Intake Temps    MWRA Hyatt Data    MWRA BU Bridge Temp