

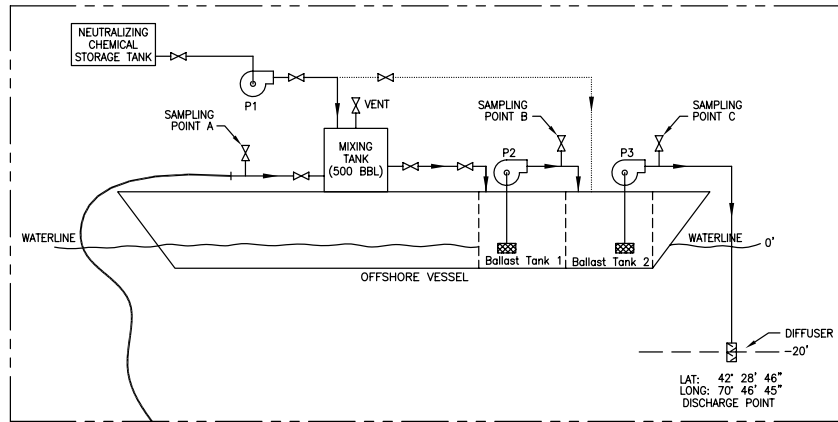


Neutralization and Discharge Vessel (MP 0.0)



Dewatering Vessel (MP 16.1)

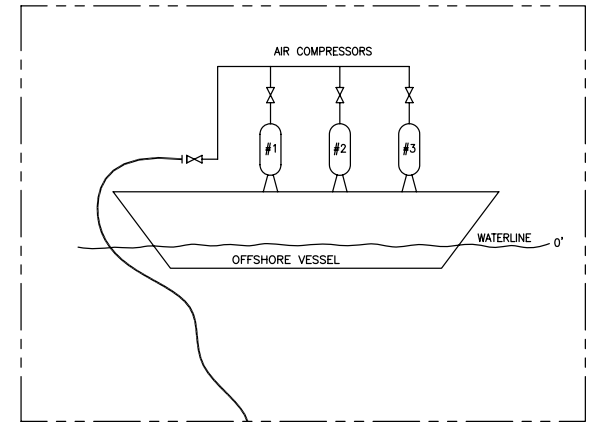

PUMPS	
P1	POSITIVE DISPLACEMENT CHEMICAL INJECTION PUMP
P2	CENTRIFUGAL PUMP (1200 to 2400 GPM)
P3	CENTRIFUGAL PUMP (1200 to 2400 GPM)

Duke Energy Gas Transmission
Algonquin Gas Transmission, LLC
600 Worcester St., Waltham, MA 01772-2544-000

DISPLACEMENT OF BIOCIDES INJECTED SEAWATER WITH COMPRESSED AIR NEUTRALIZATION AND DISCHARGE SCHEMATIC

DRAWN BY: R.P.G. CHK'D. BY: M.G.S.
DATE: 8-25-06 APPR. BY:

NO.	REVISION	DATE	APPR.
A	ISSUED FOR PERMIT	8-25-06	-

FIGURE 4 REV A