

COM Electric

Commonwealth Electric Company
2421 Cranberry Highway
Wareham, Massachusetts 02571
Telephone (617) 291-0950

J,
FYI
Keep this
in mind
J

August 14, 1984

Superfund Records Center

SITE: New Bedford

BREAK: 4.1

OTHER: 47391

Mr. Michael Deland
E.P.A. Regional Administrator
E.P.A. Region I
J. F. K. Federal Building
Boston, MA 02203

Dear Mr. Deland:

The purpose of this letter is to express our concern with the possible dredging of the Acushnet River.

The removal of the P.C.B. contaminated sediment could present a problem with our existing 10-15KV submarine cables and our 2-115KV pipe-type cable circuits. I am attaching plans indicating the approximate location of these cables.

We request the review of any preliminary plans for clean-up operations that may have any effect on our facilities.

Sincerely yours,

COMMONWEALTH ELECTRIC COMPANY







H. D. Cash
Director of Construction

RECEIVED
AUG 28 1984

HDC:rhs

Enc,

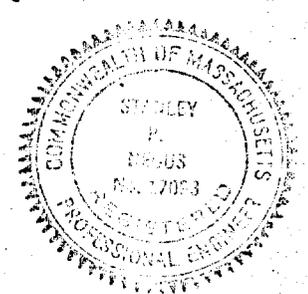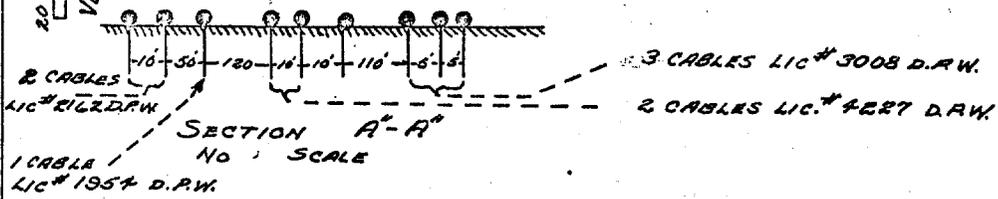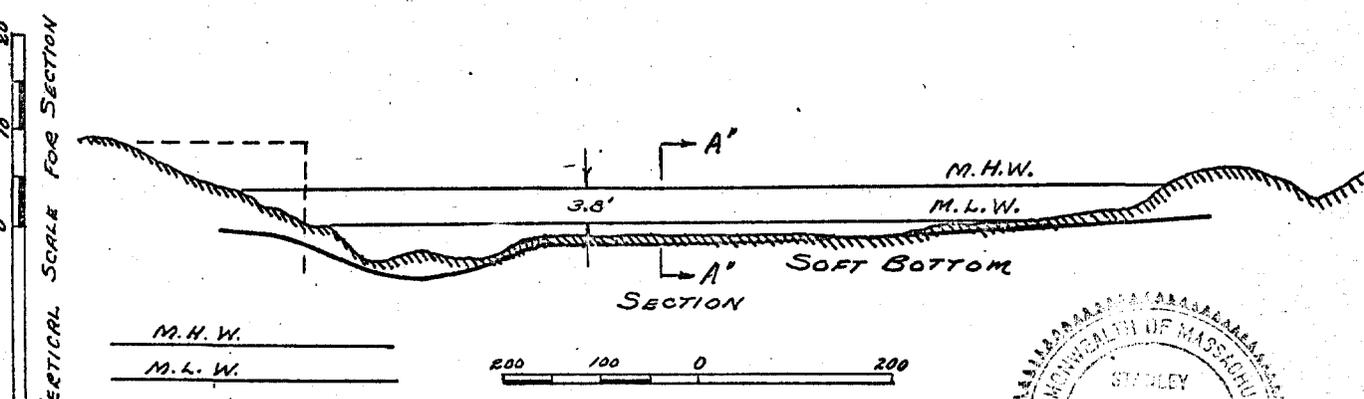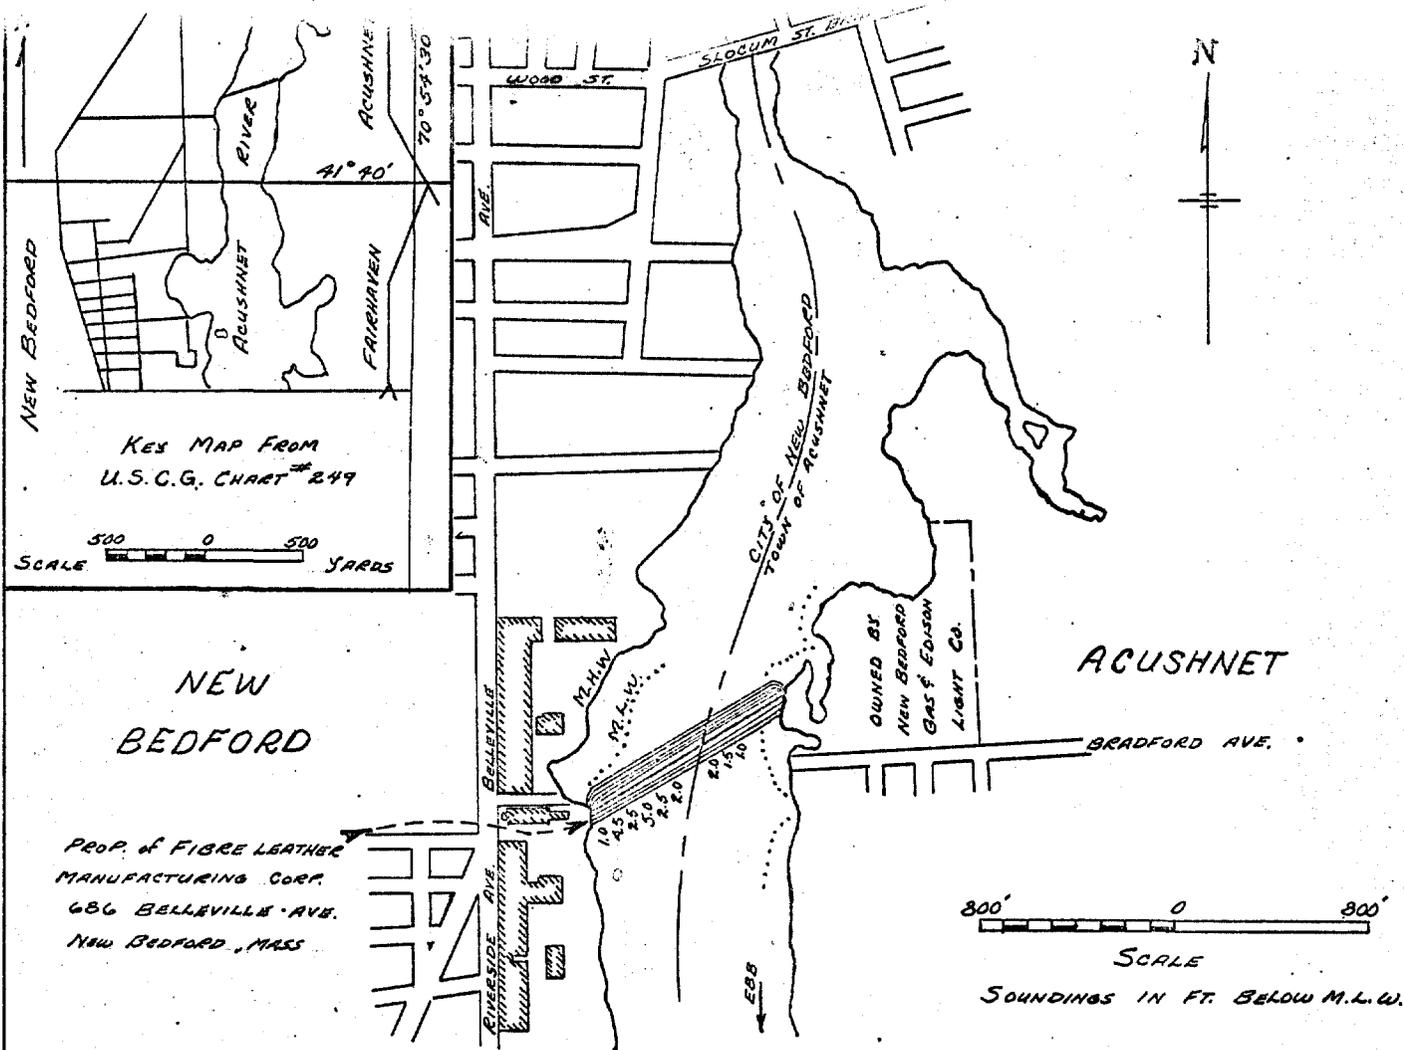

PLAN TO ACCOMPANY PETITION OF
NEW BEDFORD GAS & EDISON LIGHT CO.
TO LAY 1-SUBMARINE CABLE ACROSS
THE ACUSHNET RIVER BETWEEN NEW
BEDFORD AND ACUSHNET, MASS.

LICENSE PLAN NO. 5633
APPROVED BY DEPARTMENT OF PUBLIC WORKS OF MASSACHUSETTS
JANUARY 14, 1970
COMMISSIONER - DEPT. OF PUBLIC WORKS

ASSOCIATE COMMISSIONERS

Charles A. Dunlop
Robert S. Foster

PROPOSED CABLE LOCATIONS

SCALE AS SHOWN

J. I. H.
JULY 16, 1969