

Figure 7
Percentage of Samples with Surrogate Recoveries Within Acceptance Limits
Ground Water

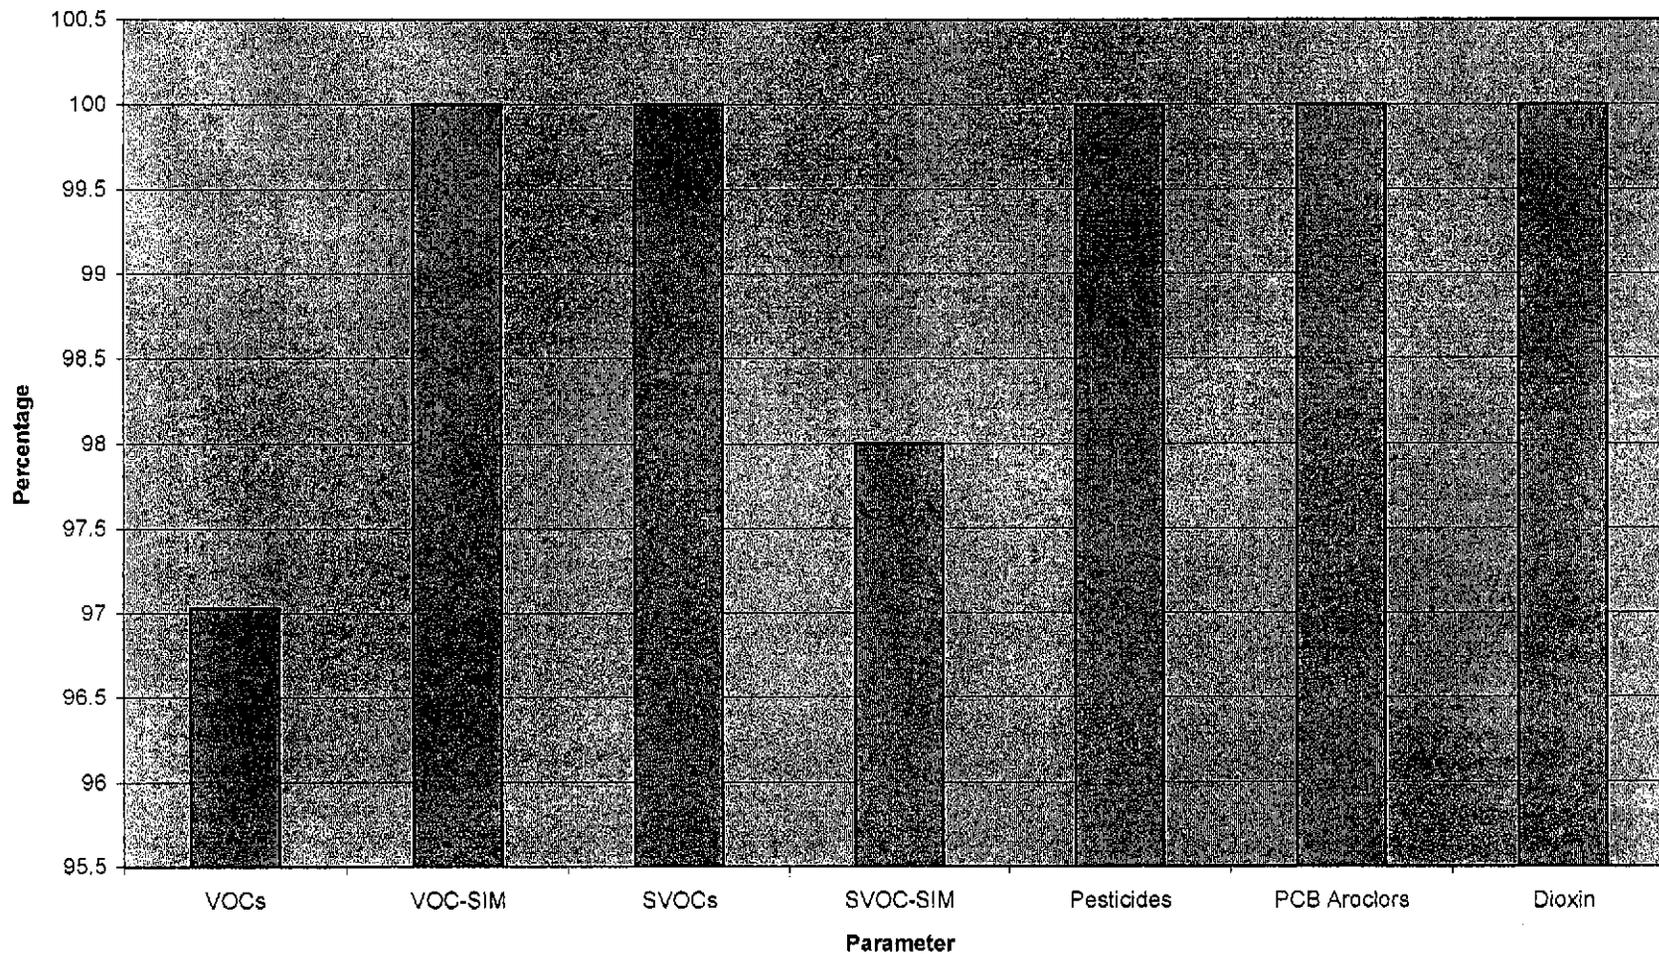


Figure 8
Percentage of Samples with Surrogate Recoveries Within Acceptance Limits
Outfall Surface Water

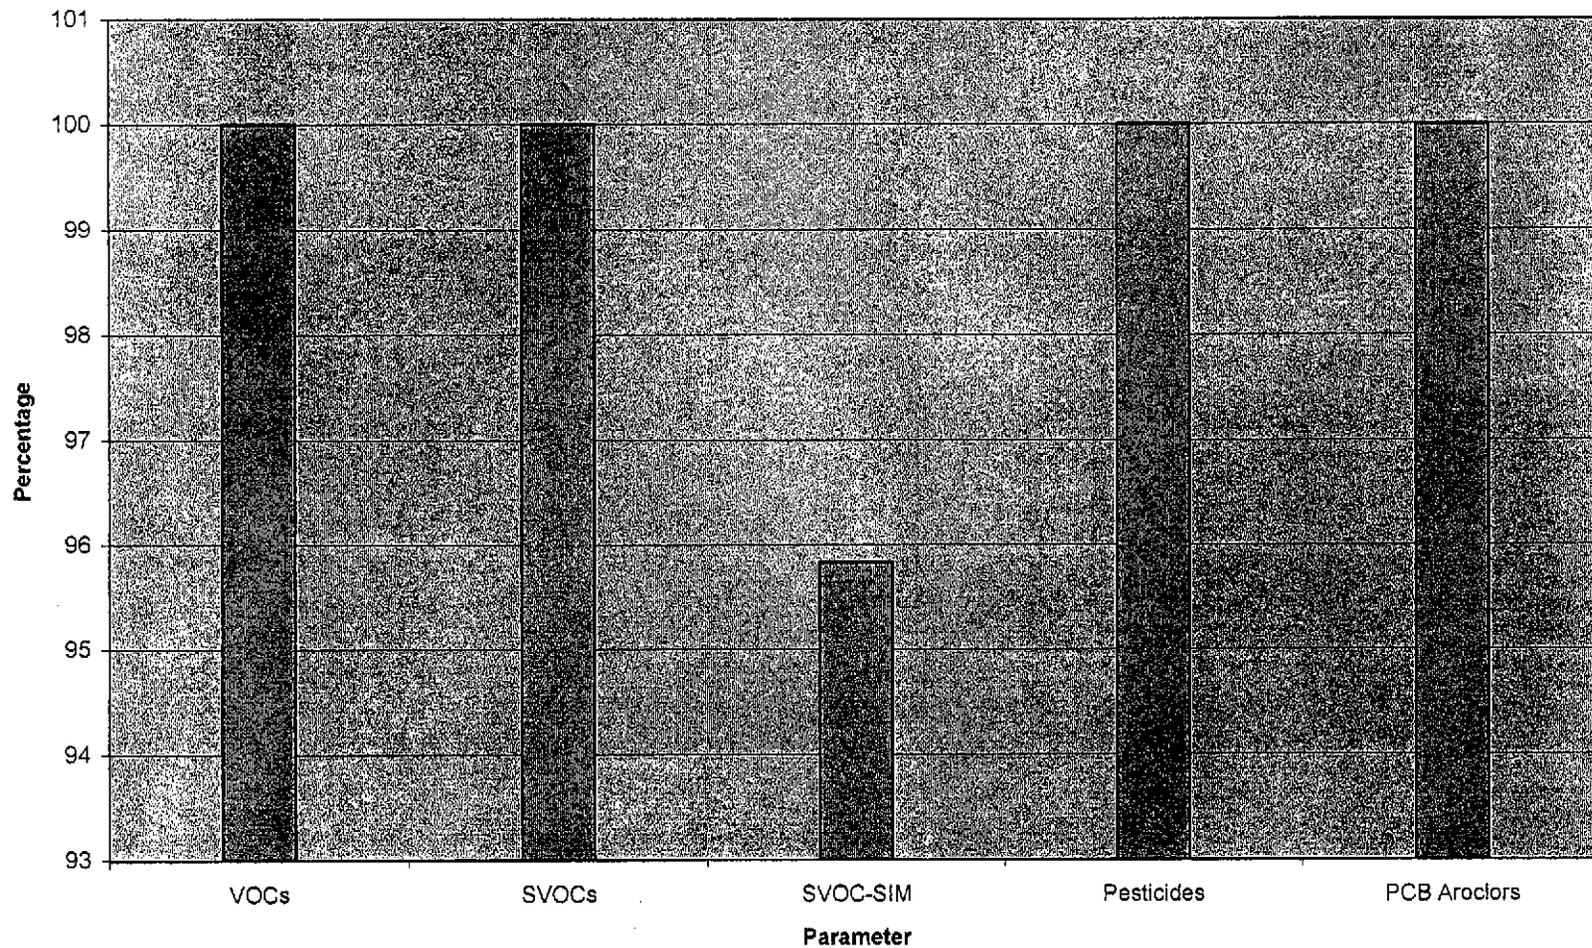


Figure 9
Percentage of Samples with Surrogate Recoveries Within Acceptance Limits
Residential Wells

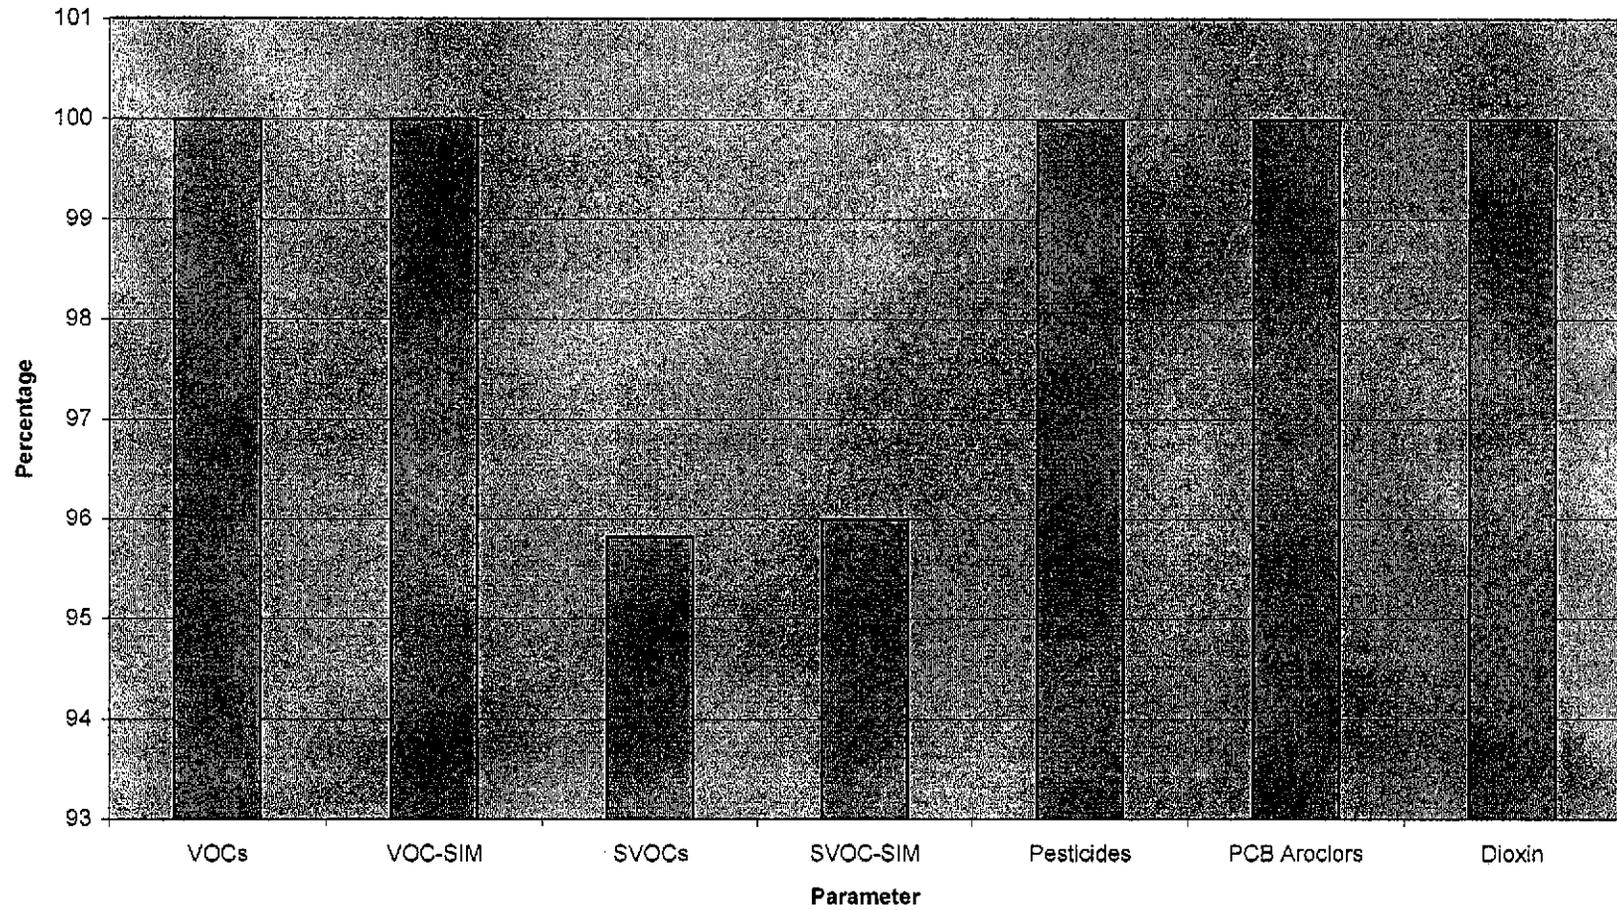


Figure 10
Percentage of Samples with Surrogate Recoveries Within Acceptance Limits
River Surface Water

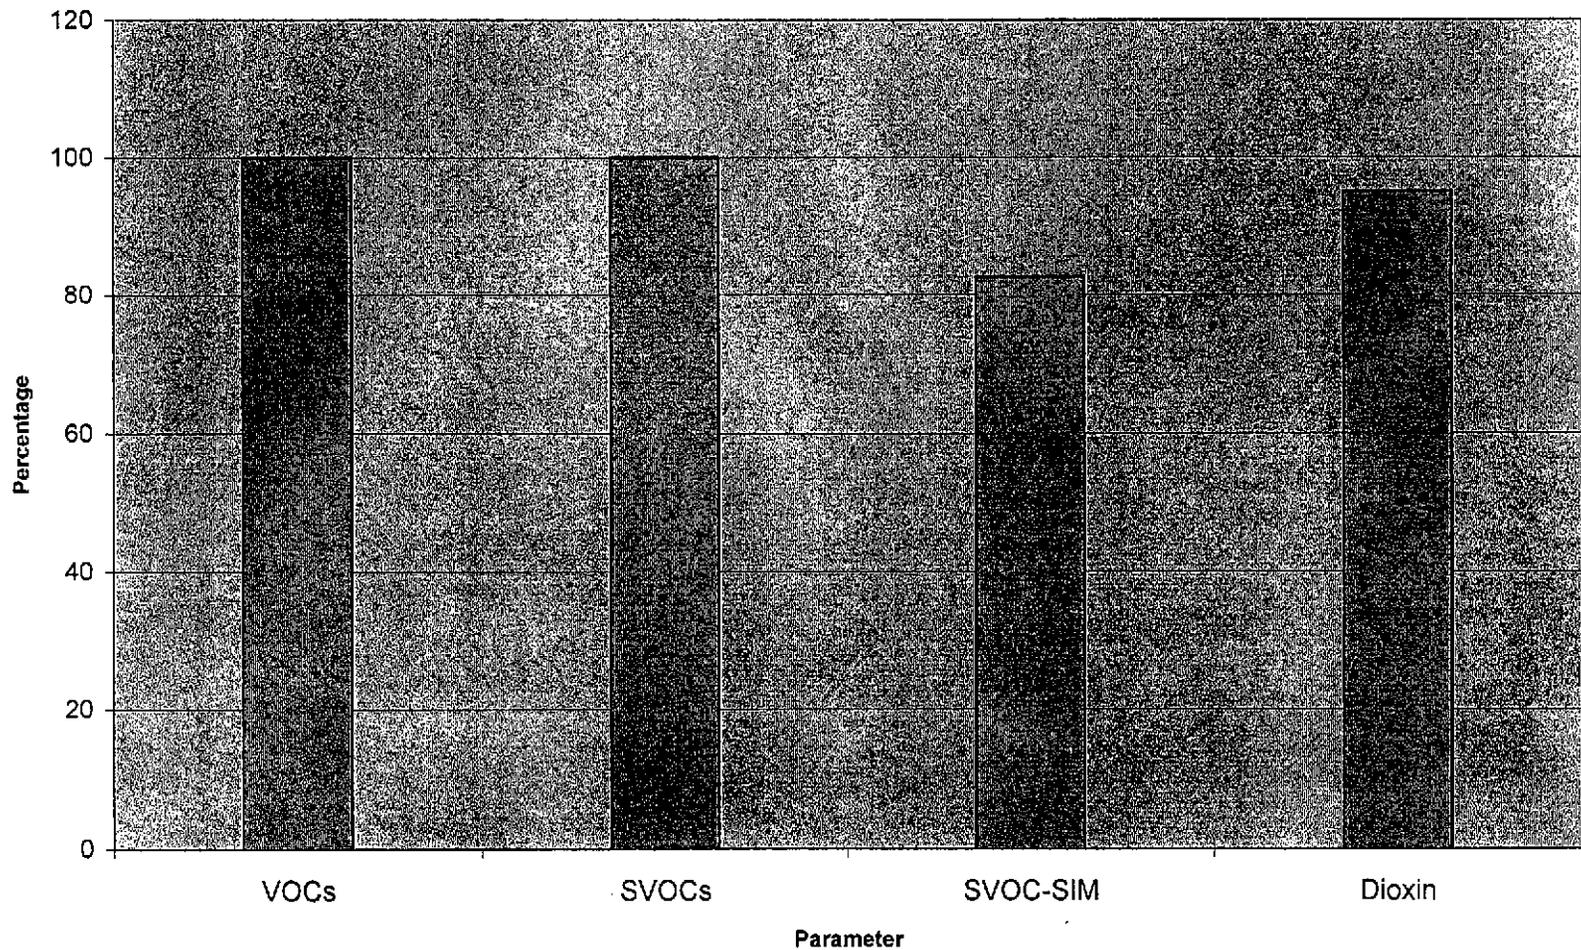


Figure 11
Percentage of Samples with Surrogate Recoveries Within Acceptance Limits
Soil Borings

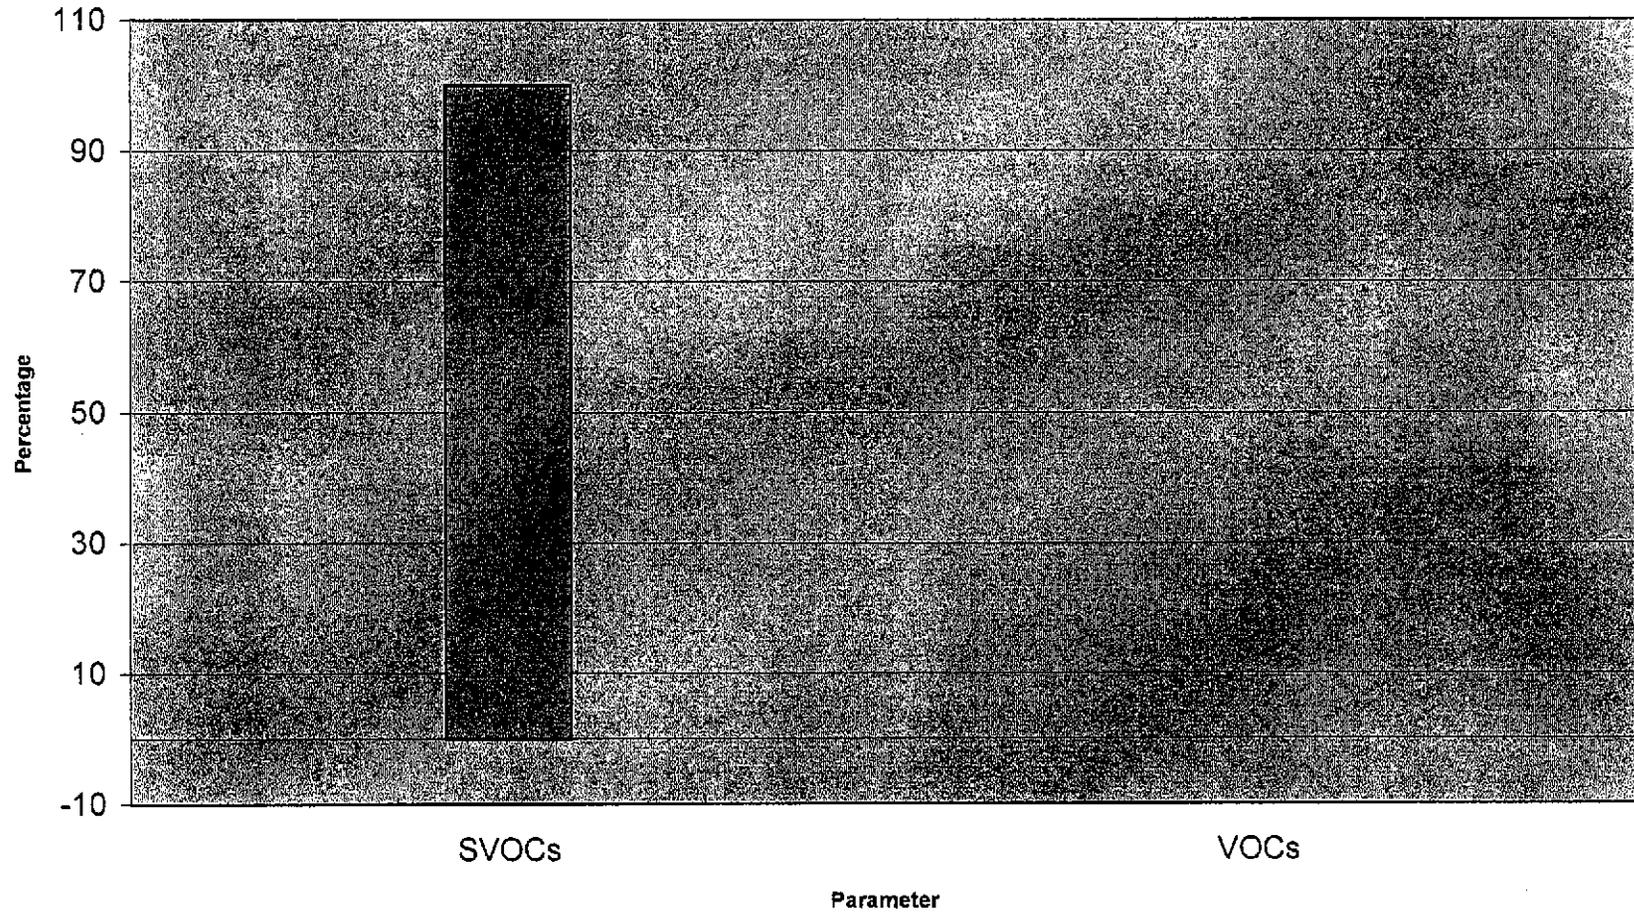


Figure 12
Field Duplicate Results
Lagoon Sludge

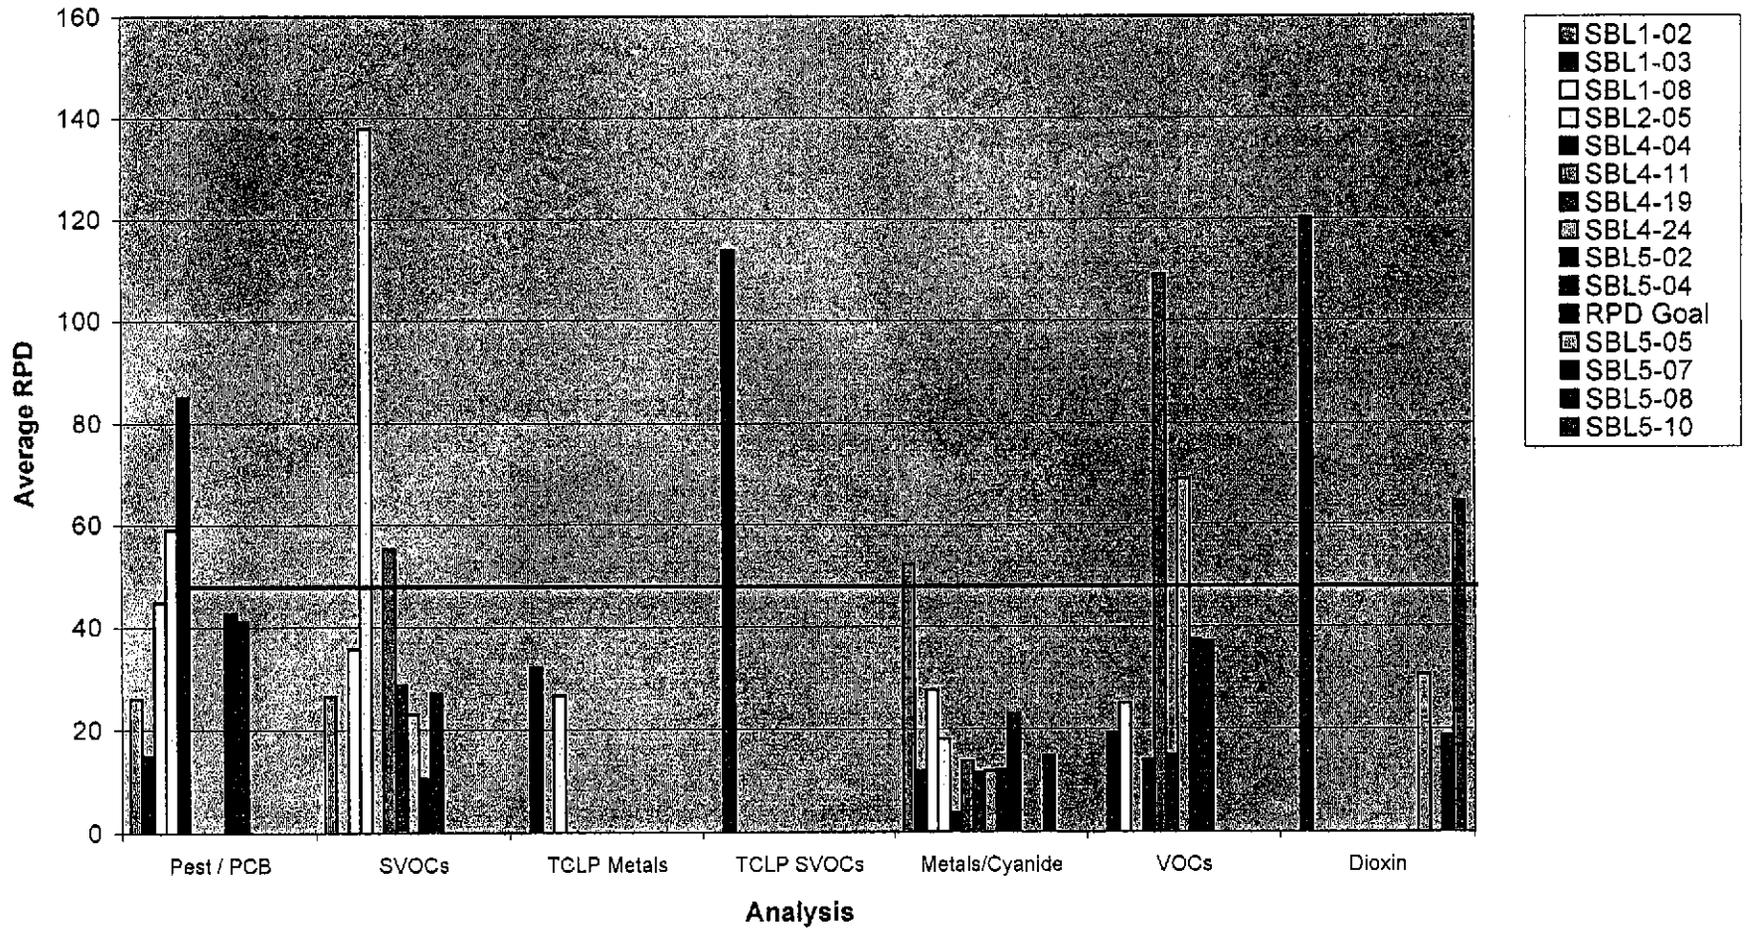


Figure 13
Field Duplicate Results
Floor Drain

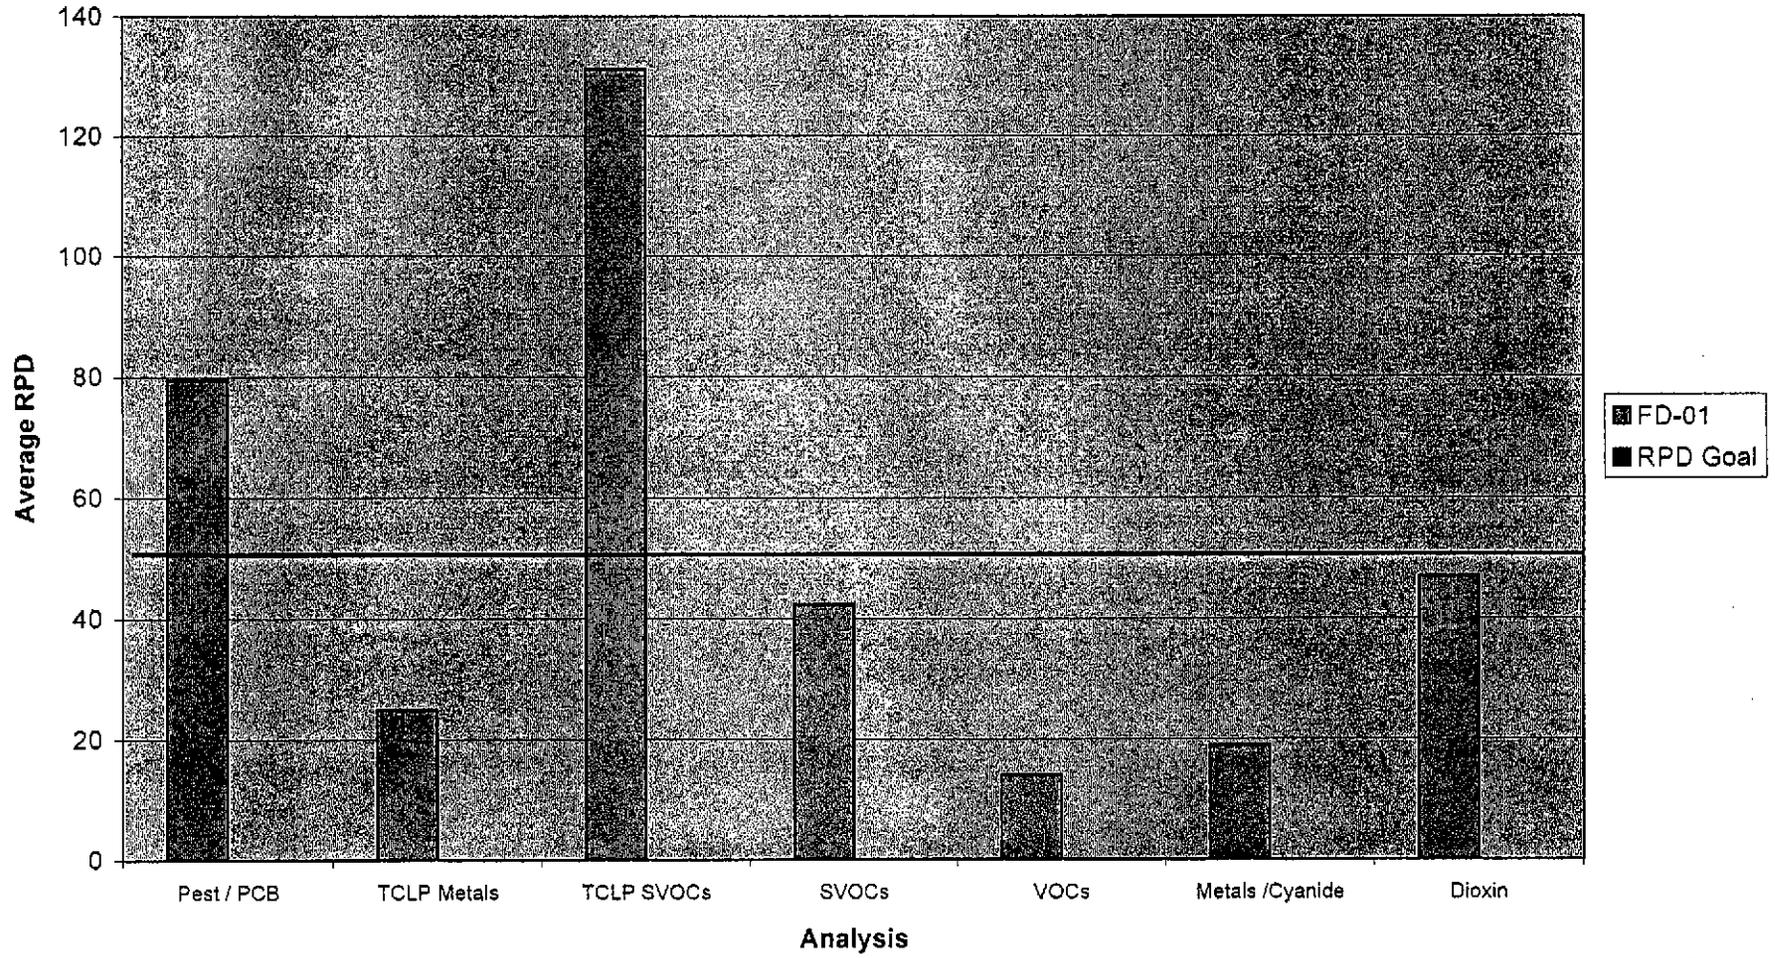


Figure 14
Field Duplicate Results
Warehouse Soil

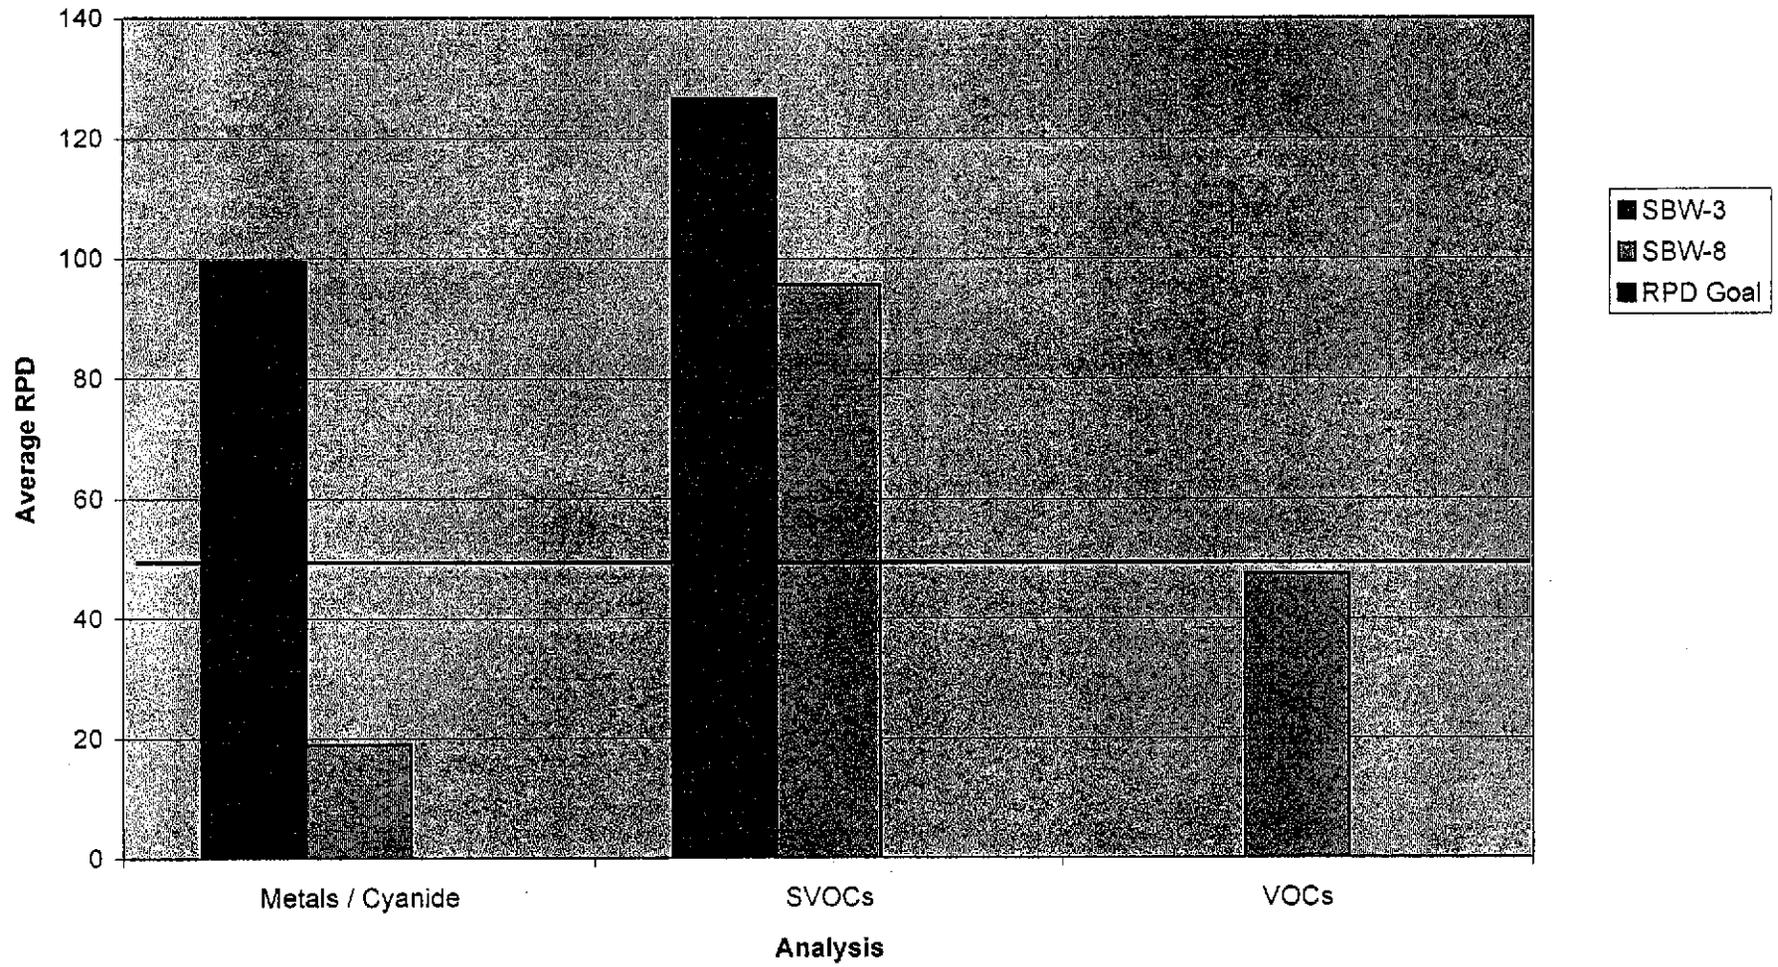


Figure 15
Field Duplicate Results
Surface Soil

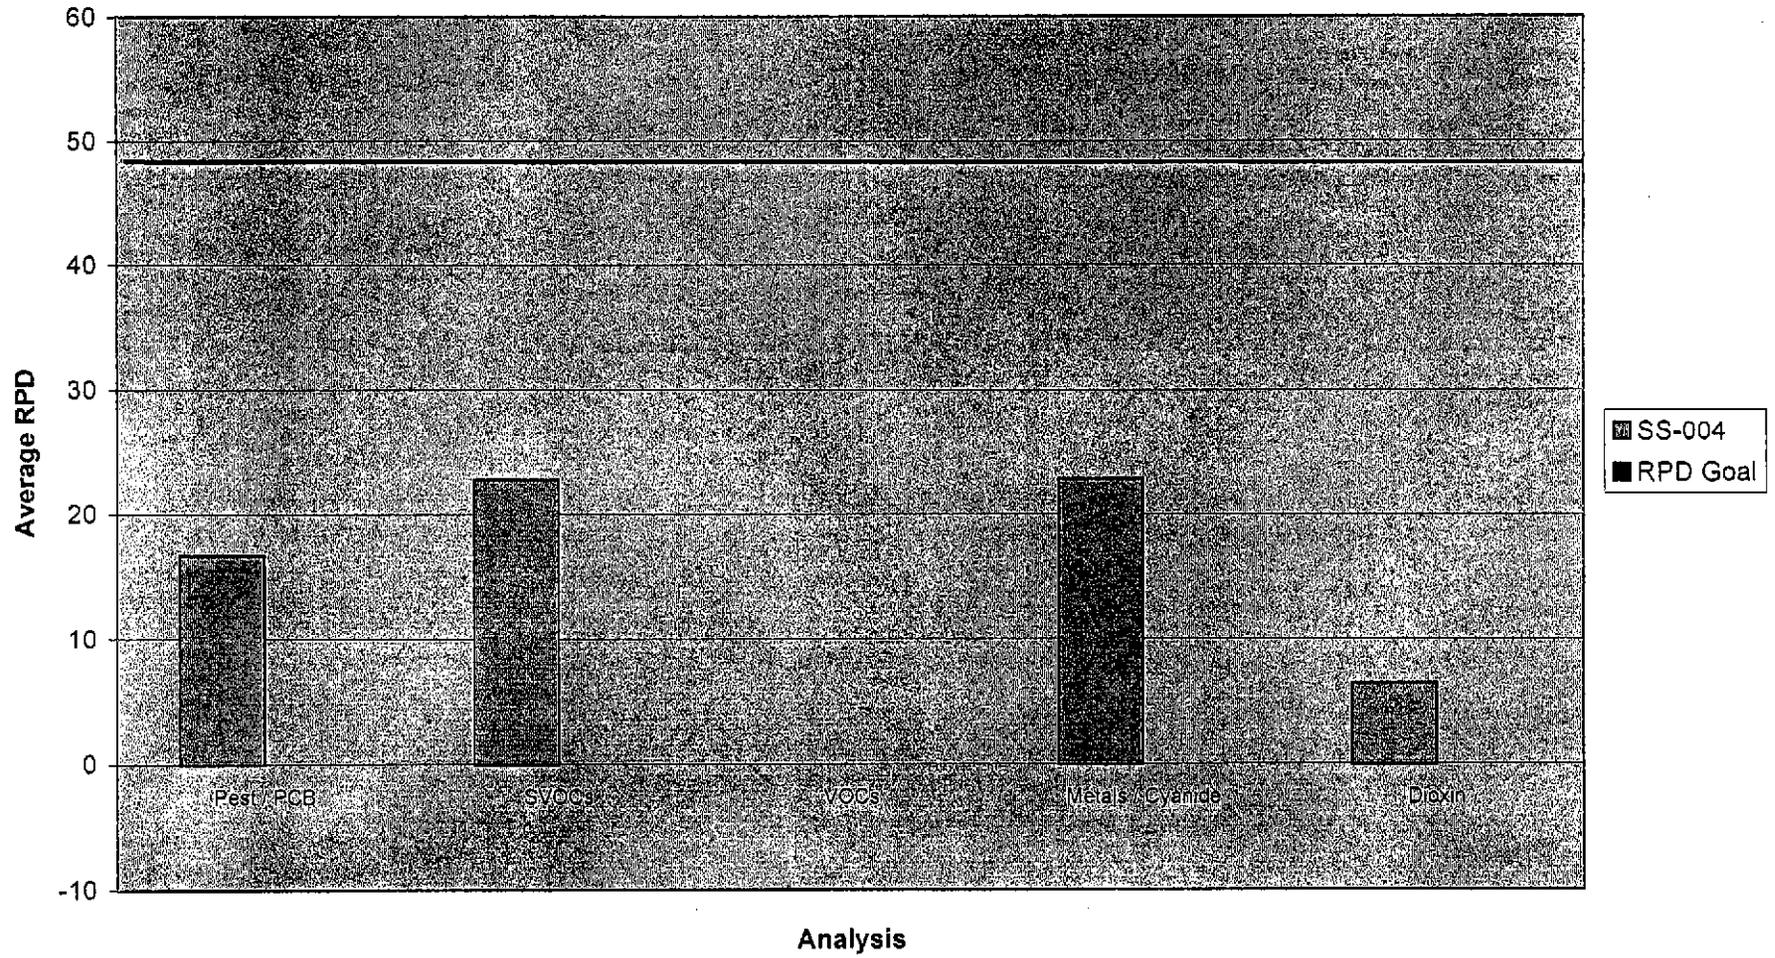


Figure 16
Field Duplicate Results
Woods Road Disposal Area Test Pits

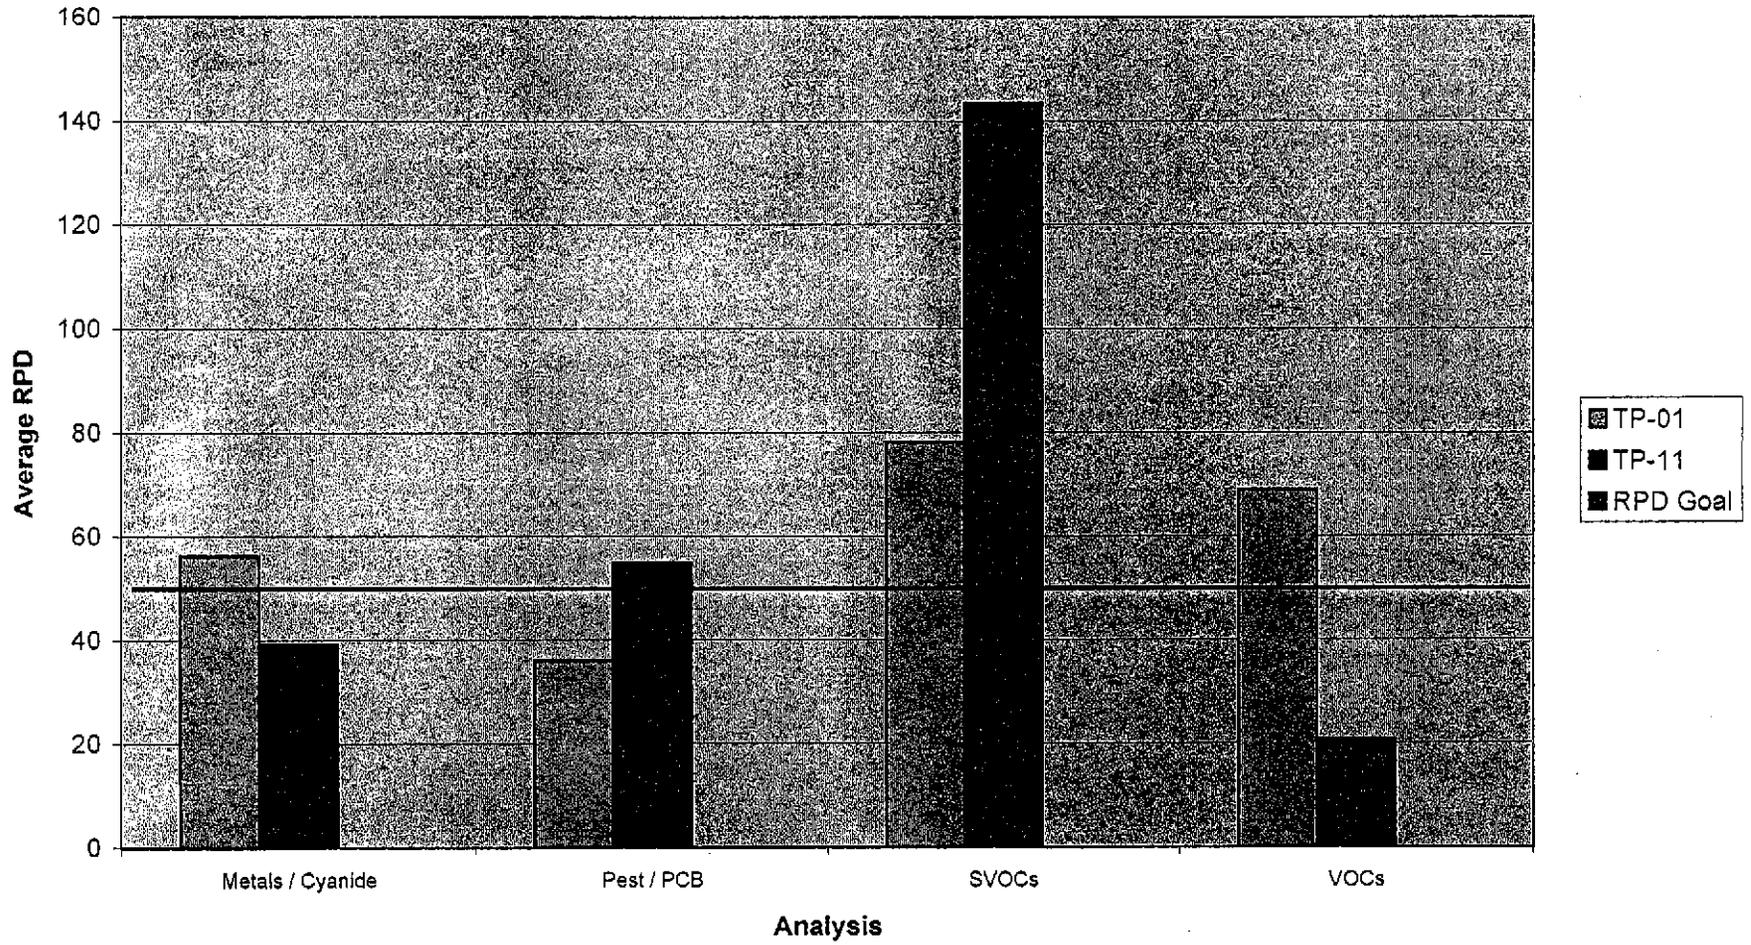


Figure 17
Field Duplicate Results
Lagoon Test Pits

