

Note: This is a reference cited in *AP 42, Compilation of Air Pollutant Emission Factors, Volume I Stationary Point and Area Sources*. AP42 is located on the EPA web site at www.epa.gov/ttn/chief/ap42/

The file name refers to the reference number, the AP42 chapter and section. The file name "ref02_c01s02.pdf" would mean the reference is from AP42 chapter 1 section 2. The reference may be from a previous version of the section and no longer cited. The primary source should always be checked.

AP-42
Section 1.2
7

EMISSION FACTOR DOCUMENTATION FOR

AP-42 SECTION 1.2

ANTHRACITE COAL COMBUSTION

Prepared by:

Edward Aul & Associates, Inc.
Chapel Hill, NC 27514

E. H. Pechan & Associates, Inc.
Rancho Cordova, CA 95742

Contract No. 68-DO-0120
EPA Work Assignment Officer: Michael Hamlin

Office of Air Quality Planning and Standards
Office Of Air And Radiation
U.S. Environmental Protection Agency
Research Triangle Park, NC 27711
April 1993

EMISSION FACTOR DOCUMENTATION FOR
AP-42 SECTION 1.2
ANTHRACITE COAL COMBUSTION

Prepared by:

Edward Aul & Associates, Inc.
Chapel Hill, NC 27514

E. H. Pechan & Associates, Inc.
Rancho Cordova, CA 95742

Contract No. 68-DO-0120
EPA Work Assignment Officer: Michael Hamlin

Office of Air Quality Planning and Standards
Office Of Air And Radiation
U.S. Environmental Protection Agency
Research Triangle Park, NC 27711
April 1993

DISCLAIMER

This report has been reviewed by the Office of Air Quality Planning and Standards, U. S. Environmental Protection Agency, and approved for publication. Mention of trade names or commercial products does not constitute endorsement or recommendation for use.

TABLE OF CONTENTS

	<u>Page</u>
LIST OF FIGURES.....	v
LIST OF TABLES.....	v
CHAPTER 1. INTRODUCTION.....	1-1
CHAPTER 2. INDUSTRY DESCRIPTION.....	2-1
2.1 CHARACTERIZATION OF THE INDUSTRY.....	2-1
2.2 PROCESS DESCRIPTION.....	2-1
2.2.1 Fuel Characteristics.....	2-1
2.2.2 Combustor Types.....	2-2
2.3 EMISSIONS.....	2-4
2.4 EMISSION CONTROLS.....	2-5
REFERENCES.....	2-13
CHAPTER 3. GENERAL DATA REVIEW AND ANALYSIS PROCEDURES.....	3-1
3.1 LITERATURE SEARCH AND SCREENING.....	3-1
3.2 EMISSION DATA QUALITY RATING SYSTEM.....	3-2
3.3 PARTICLE SIZE DETERMINATION.....	3-4
3.4 EMISSION FACTOR QUALITY RATING SYSTEM.....	3-5
REFERENCES.....	3-6
CHAPTER 4. POLLUTANT EMISSION FACTOR DEVELOPMENT.....	4-1
4.1 REVIEW OF SPECIFIC DATA SETS.....	4-1
4.1.1 Reference 1.....	4-2
4.1.2 Reference 2.....	4-2
4.1.3 Reference 3.....	4-3
4.1.4 Reference 4.....	4-3
4.1.5 Reference 5.....	4-3
4.1.6 Reference 6.....	4-4
4.1.7 Reference 7.....	4-4
4.2 RESULTS OF DATA ANALYSIS.....	4-5
4.2.1 Filterable Particulate Matter.....	4-6
4.2.2 Condensable Particulate Matter.....	4-6
4.2.3 Particulate Matter Less Than 10 Microns (PM-10).....	4-6
4.2.4 Lead.....	4-6
4.2.5 Sulphur Oxides.....	4-6
4.2.6 Nitrogen Oxides.....	4-7
4.2.7 Carbon Monoxide.....	4-7

TABLE OF CONTENTS (continued)

	<u>Page</u>
4.2.8 Total Organic Compounds.....	4-7
4.2.9 Speciated Organic Compounds.....	4-7
4.2.10 Trace Elements.....	4-7
4.2.11 Carbon Dioxide.....	4-7
4.2.12 Methane.....	4-8
4.3 PROTOCOL FOR DATA BASE.....	4-8
4.3.1 Engineering Methodology.....	4-8
REFERENCES.....	4-16
CHAPTER 5. AP-42 SECTION 1.2: ANTHRACITE COAL COMBUSTION.....	 5-1
APPENDIX A. MARKED-UP 1988 AP-42 SECTION 1.2.....	A-1
APPENDIX B. EMISSION SOURCE DATA RATING FORMS.....	B-1

LIST OF FIGURES

<u>Figure</u>		<u>Page</u>
2-1	Construction details for chain-grate/ traveling grate stoker.....	2-9
2-2	Typical stoker installation for anthracite coal.....	2-10
2-3	Cross-section of a single-retort side-dump stoker with stationary grates.....	2-11

LIST OF TABLES

<u>Table</u>		
2-1	TYPICAL ANALYSES FOR ANTHRACITE COAL AND CULM.....	2-12
4-1	SUMMARY OF EMISSION FACTORS FOR SPECIATED METALS FROM ANTHRACITE COMBUSTORS.....	4-11
4-2	SUMMARY OF EMISSION FACTORS FOR TOTAL ORGANIC COMPOUNDS (TOC) AND METHANE (CH ₄) FROM ANTHRACITE COMBUSTORS.....	4-12
4-3	SUMMARY OF EMISSION FACTORS FOR SPECIATED ORGANIC COMPOUNDS FROM ANTHRACITE COMBUSTORS.....	4-13
4-4	SUMMARY OF EMISSION FACTORS FOR PARTICULATE MATTER (PM), AND LEAD FROM ANTHRACITE COMBUSTORS.....	4-14
4-5	SUMMARY OF EMISSION FACTORS FOR NITROGEN OXIDE COMPOUNDS (NO _x) AND SULPHUR DIOXIDE (SO ₂) FROM ANTHRACITE COMBUSTORS.....	4-14
4-6	SUMMARY OF EMISSION FACTORS FOR CARBON MONOXIDE (CO) AND CARBON DIOXIDE (CO ₂) FROM ANTHRACITE COMBUSTORS.....	4-15

1. INTRODUCTION

The document "Compilation of Air Pollutant Emission Factors" (AP-42) was first published by the U.S. Environmental Protection Agency (EPA) in 1970. Supplements to AP-42 have been routinely published to add new emission source categories and to update existing emission factors. The AP-42 is routinely updated by EPA to respond to new emission factor needs of EPA, State, and local air pollution control programs and industry.

An emission factor relates the quantity (mass) of pollutants emitted to a unit of activity of the source. The uses for the emission factors reported in AP-42 include:

1. Estimates of area-wide emissions;
2. Emission estimates for a specific facility; and
3. Evaluation of emissions relative to ambient air quality.

The purpose of this report is to provide background information from over 17 test reports to support revision of emission factors for anthracite coal combustion.

Including the introduction (Chapter 1), this report contains five chapters. Chapter 2 gives a description of the use of anthracite coal for combustion in boilers, furnaces, and space heaters. It includes a characterization of the industry; an overview of the different forms of anthracite fuel (i.e., coal and culm) and boiler types; a discussion of factors affecting emissions; and a description of the technology used to control emissions resulting from anthracite coal combustion. Chapter 3 is a review of emissions data collection and analysis procedures. It describes the literature search, the screening of emission data reports, and the quality rating system for both emission data and emission factors. It also describes particle size determination and particle size data analysis methodology. Chapter 4 details pollutant emission factor development. It includes the review of specific data sets, the results of data analysis,

and the data base protocol. Chapter 5 presents the new AP-42 Section 1.2 for Anthracite Coal Combustion.

2. INDUSTRY DESCRIPTION

2.1 CHARACTERIZATION OF THE INDUSTRY¹⁻³

Nearly all anthracite coal in the U.S. is mined in northeastern Pennsylvania; smaller quantities are produced in Rhode Island and Virginia. Anthracite coal is consumed mostly in Pennsylvania and its surrounding states. The largest use of anthracite is for space heating. Lesser amounts are employed for steam/electric production; coke manufacturing, sintering and pelletizing; and other industrial uses. Anthracite currently represents only a small fraction of the total quantity of coal combusted in the U. S.

2.2 PROCESS DESCRIPTION

2.2.1 Fuel Characteristics⁴⁻⁶

Anthracite coal is a high-rank coal with more fixed carbon and less volatile matter than either bituminous coal or lignite; anthracite coal also has higher ignition temperatures and ash fusion temperatures than these other common coal types. As shown in Table 2-1, anthracite coal typically contains approximately 5 percent moisture, 4 percent volatile matter, 10 percent ash, less than 1 percent sulfur, less than 1 percent nitrogen, and 80 percent fixed carbon. Heating values are normally in the range of 6,700 to 7,800 kcal/kg (12,000 to 14,000 Btu/lb).

Another form of anthracite coal burned in boilers is anthracite refuse, commonly known as culm. Culm was produced as breaker reject material from the mining/sizing of anthracite coal and was typically dumped by miners on the ground near operating mines. It is estimated that there are over 15 million Mg (16 million tons) of culm scattered in piles up to 200 meters (600 feet) high throughout northeastern Pennsylvania.⁴ As shown in Table 2-1, culm is characterized by a higher ash content,

higher moisture content, and lower heating value; i.e., 1,400 to 2,800 kcal/kg (2,500 to 5,000 Btu/lb) relative to mined anthracite coal.

2.2.2 Combustor Types

Due to its low volatile matter content, and non-clinkering characteristics, anthracite coal is largely used in medium-sized industrial and institutional stoker boilers using stationary and traveling grates. Anthracite coal is not used in spreader stokers because of its low volatile matter content and relatively high ignition temperature. This fuel may also be burned in pulverized coal-fired (PC-fired) units, but due to ignition difficulties, this practice is limited to only a few plants in eastern Pennsylvania. Anthracite coal has also been widely used in hand-fired furnaces. Because of its high ash content and low heating value, culm has been combusted primarily in fluidized bed combustion (FBC) boilers. The operating principles of each of these combustors are summarized below.

Combustion of anthracite coal on a traveling grate is characterized by a coal bed of 8 to 13 cm (3 to 5 inches) in depth and a high blast of underfire air at the rear or dumping end of the grate. Typical arrangements for traveling grate stokers are shown in Figures 2-1 and 2-2. This high blast of air lifts incandescent fuel particles and combustion gases from the grate and reflects the particles against a long rear arch over the grate towards the front of the fuel bed where fresh or "green" fuel enters. This special furnace arch design is required to assist in the ignition of the green fuel. At the far end of the grate, ash is discharged into an ash pit.

Additional underfire air passes up through the grate through manually-adjusted air boxes. Coal feed rates are controlled by a manually-adjusted leveling gate at the front of the traveling grate which regulates the bed depth. Combustion rates are controlled by the speed of the grate and by the underfire air rates. When automatic controls are used, the grate speed and air rates are regulated by steam pressure. Some of the smaller traveling grate and hand-fired units use only natural draft to supply air.

A second type of stoker boiler used to burn anthracite coal is the underfeed stoker. Various types of underfeed stokers are used in industrial boiler applications but the most common for anthracite coal firing is the single-retort side-dump stoker

with stationary grates (see Figure 2-3). In this unit, coal is fed intermittently to the fuel bed by a ram. In very small units, the coal is fed continuously by a screw. Feed coal is pushed through the retort and upwards towards the tuyere blocks. Air is supplied through the tuyere blocks on each side of the retort and through openings in the side grates. Overfire air is commonly used with underfeed stokers to provide combustion air and turbulence in the flame zone directly above the active fuel bed. The air is provided by a separate overfire-air fan and is injected through small nozzles in the furnace walls. Single or double retort boilers are generally less than 73 MW (250 million Btu/hr) in heat input capacity.

In PC-fired boilers, the fuel is pulverized to the consistency of light powder and pneumatically injected through the burners into the furnace. Injected coal particles burn in suspension within the furnace area of the boiler. Hot flue gases rise from the furnace and provide heat exchange with boiler tubes in the walls and upper regions of the boiler. Small particles of ash (i.e., fly ash) are carried overhead with the hot flue gases. Larger ash particles (i.e., bottom ash) drop to the floor of the furnace where they are collected and removed. Pulverized coal-fired boilers may operate either in a wet-bottom or dry-bottom mode, depending on whether or not the ash is allowed to slag. Because of its high ash fusion temperature, anthracite coal is burned in dry-bottom furnaces.

For anthracite culm, combustion in conventional boiler systems is difficult to achieve due to the fuel's high ash content, high moisture content, and low heating value. However, the burning of culm in a fluidized bed system was demonstrated at a steam generation plant in Pennsylvania. A fluidized bed consists of inert particles (e.g., rock and ash) through which air is blown so that the bed behaves as a fluid. Anthracite coal enters in the space above the bed and burns in the bed. Because of the large thermal mass represented by the hot inert bed particles, fluidized beds can handle fuels with moisture contents up to near 70 percent (total basis). Fluidized beds can also handle fuels with ash contents as high as 75 percent. Heat released by combustion is transferred to in-bed steam-generating tubes.

Fuel is pyrolyzed faster in a fluidized bed than on a grate due to immediate contact with hot bed material. As a result, combustion is rapid and results in nearly

complete combustion of the organic matter, thereby minimizing emissions of unburned organic compounds. In addition, limestone may be added to the bed to capture sulfur dioxide (SO₂) formed by combustion of fuel sulfur. Operating bed temperatures for FBC units are typically in the range of 790-900 °C (1450-1650 °F).

2.3 EMISSIONS^{2,5,7}

Uncontrolled particulate matter (PM) emissions from coal-fired boilers depend primarily on fuel ash content, firing mechanism, and boiler load. Stokers generally have lower PM emissions than do PC-fired units because the coal is burned on a bed, which leads to less entrainment of PM than does suspension firing. Hand-fired and some small natural draft units have lower particulate emissions due to relatively lower underfire air rates. Larger units equipped with forced draft fans may produce high rates of particulate emissions, especially when operating at or near rated capacity. Firing coals with higher ash contents generally results in higher PM emissions. Particulate emissions from stoker units will also be higher if fly ash collected by mechanical collectors is reinjected into the furnace; emissions from all stokers will increase during sootblowing operations.

Coals with higher ash fusion temperatures, such as anthracite, are generally fired in dry-bottom units which emit higher levels of PM than do wet-bottom boilers. The PM emission levels from coal-fired boilers also depend on boiler load. Limited test data indicate that mass emissions of PM on a heat input basis tend to decrease with decreasing load.

Traveling grate stokers emit coarser particles than do underfeed stokers and PC-fired units. Hence, emissions of PM less than 10 microns (PM-10) will also be lower for the former unit relative to the latter units.

Sulfur oxide emissions are directly proportional to the sulfur content of fuel. Some minor differences will occur from unit to unit, however, due to (1) ash partitioning between fly ash and bottom ash and (2) the sodium content of the coal (which tends to react with and bind coal sulfur in the bottom ash as sodium sulfite or sodium sulfate). For FBC boilers, sulfur oxide emissions are inversely proportional, in general, to the molar ratio of calcium (in the limestone) to sulfur (in the fuel) added to the bed.

Nitrogen oxide (NO_x) emissions are lower in traveling grate and underfeed stokers compared to PC-fired boilers. Underfeed and traveling grate stokers have large furnace areas and consequently lower volumetric- and surface area-based heat release rates. Lower heat release rates reduce peak combustion temperatures and, hence, contribute to lower NO_x emissions. In addition, the partially staged combustion that naturally occurs in all stokers due to the use of underfire and overfire air contributes to reduced NO_x emissions relative to PC-fired units. The low operating temperatures which characterize FBC boilers firing culm also favor relatively low NO_x emissions. Reducing boiler load tends to decrease combustion intensity which, in turn, leads to decreased NO_x emissions for all boiler types.

Carbon monoxide (CO) and total organic compound (TOC) emissions are dependent on combustion efficiency. Generally their emission rates, defined as mass of emissions per unit of heat input, decrease with increasing boiler size. The TOC emissions are expected to be lower for PC-units and higher for underfeed and overfeed stokers as a result of relative combustion efficiency levels.

2.4 EMISSION CONTROLS^{5,7}

Air pollution control equipment on anthracite coal-fired boilers has been applied primarily for PM emissions control. The most efficient particulate control systems [fabric filters and electrostatic precipitators (ESPs)] have typically been applied to larger pulverized anthracite-fired boilers and FBC units burning culm. Venturi scrubbers and mechanical collectors are normally used for PM control on smaller stoker boilers. Operating principles and factors affecting emissions for each of these control technologies are summarized below.

Mechanical collectors, or cyclones, use centrifugal separation to remove PM from flue gas streams. At the entrance of the cyclone, a spin is imparted to the particle-laden gas. This spin creates a centrifugal force which causes the PM to move away from the axis of rotation and towards the walls of the cyclone. Particles which contact the walls of the cyclone tube are directed to a dust collection hopper where they are deposited.

In a typical single cyclone, the gas enters tangentially to initiate the spinning motion. In a multitube cyclone (or multiclone), the gas approaches the entrance

axially and has the spin imparted by a stationary "spin" vane that is in its path. This allows the use of many small, higher efficiency cyclone tubes operating parallel to the gas flow stream, with a common inlet and outlet header.

One variation of the multitube cyclone is to place two similar mechanical collectors in series. This system is often referred to as a dual or double mechanical collector. The first collector removes the bulk of the dust and the second removes smaller particles. Single mechanical collectors have been reported to have PM collection efficiencies up to 80 percent.

Particulate emissions from coal-fired boilers are considered to be abrasive and can cause erosion within the mechanical collector. Such erosion reduces PM collection efficiency over time unless corrective maintenance procedures are employed.

A wet scrubber is a collection device which uses an aqueous stream or slurry to remove particulate and/or gaseous pollutants. There are three basic mechanisms involved with collecting PM in wet scrubbers: interception, inertial impaction, and diffusion of particles on droplets. The interception and inertial impaction effects dominate at large particle diameters; the diffusion effects dominate at small particle diameters.

Wet scrubbers are usually classified by energy consumption (in terms of gas-phase pressure drop). Low-energy scrubbers, represented by spray chambers and towers, have pressure drops of less than 1 kPa (5 inches of water). Medium-energy scrubbers such as impingement scrubbers have pressure drops of 1 to 4 kPa (5 to 15 inches of water). High-energy scrubbers such as high-pressure-drop venturi scrubbers have pressure drops exceeding 4 kPa (15 inches of water). Higher removal levels of PM are usually achieved with higher-energy scrubbers.

The most widely used wet scrubbers for anthracite coal-fired boilers are venturi scrubbers. In a typical venturi scrubber, the particle-laden gas first contacts the liquor stream in the core and throat of the venturi section. The gas and liquid streams then pass through the annular orifice formed by the core and throat, atomizing the liquid into droplets which are impacted by particles in the gas stream. Impaction results mainly from the high differential velocity between the gas stream and the atomized

droplets. The droplets are then removed from the gas stream by centrifugal action in a cyclone separator and (if present) a mist eliminator section.

Wet scrubbers have reported PM collection efficiencies of 90 percent or greater. Operational problems can occur with wet scrubbers due to clogged spray nozzles, sludge deposits, dirty recirculation water, improper water levels, and unusually low pressure drops.

Gaseous emissions such as SO_2 , NO_x , CO , and organics may also be absorbed to a significant extent in a wet scrubber. In addition, alkali compounds are sometimes utilized in the scrubber to prevent low pH conditions. If carbon dioxide (CO_2)-generating compounds (such as sodium carbonate or calcium carbonate) are used, CO_2 emissions may increase.

Particulate collection in an ESP occurs in three steps: suspended particles are given an electrical charge; the charged particles migrate to a collecting electrode of opposite polarity while subjected to a diverging electric field; and the collected PM is dislodged from the collecting electrodes.

Charging of the particles to be collected is usually caused by ions produced in a high voltage direct current corona. The electric fields and the corona necessary for particle charging are provided by high voltage transformers and rectifiers. Removal of the collected PM is accomplished mechanically by rapping or vibrating the collecting electrodes. When applied to coal-fired boilers, ESPs are often used downstream of mechanical collector precleaners which remove larger-sized particles. When applied to anthracite coal-fired boilers, ESPs typically are only 90 to 97 percent efficient, because of the characteristic high resistivity of low sulfur anthracite fly ash. It is reported that higher efficiencies can be achieved using larger precipitators and flue gas conditioning.

In fabric filters (also known as baghouses), particulate-laden dust passes through a set of filters mounted inside the collector housing. Dust particles in the inlet air are retained on the filters by inertial impaction, diffusion, direct interception, and sieving. The first three processes prevail only briefly during the first few minutes of filtration with new or recently cleaned filters, while the sieving action of the dust layer accumulating on the fabric surface soon predominates. The sieving mechanism leads to high efficiency PM collection unless defects such as pinhole leaks or cracks appear

in the filter cake. The PM collection efficiencies for fabric filters operating on coal-fired boilers can exceed 99 percent.

Cleaning of the bag filters typically occurs in one of three ways. In shaker cleaning, the bags are oscillated by a small electric motor. The oscillation shakes most of the collected dust into a hopper. In reverse air cleaning, backwash air is introduced to the bags to collapse them and fracture the dust cake. Both shaker cleaning and reverse air cleaning require a sectionalized baghouse to permit cleaning of one section while other sections are functioning normally. The third cleaning method, pulse jet cleaning, does not require sectionalizing. A short pulse of compressed air is introduced through venturi nozzles and directed from the top to the bottom of each bag. The primary pulse of air aspirates secondary air as it passes through the nozzles. The resulting air mass expands the bag and fractures the cake.

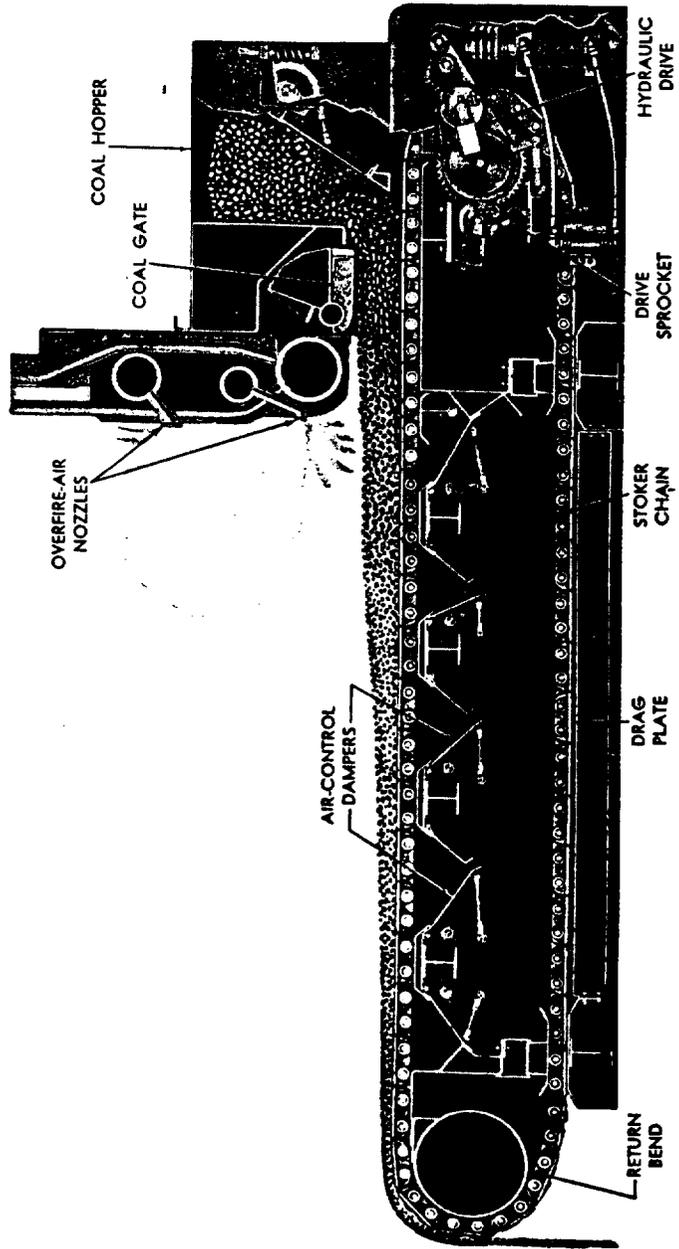


Figure 2-1. Construction details for chain-grate/traveling grate stoker.⁶

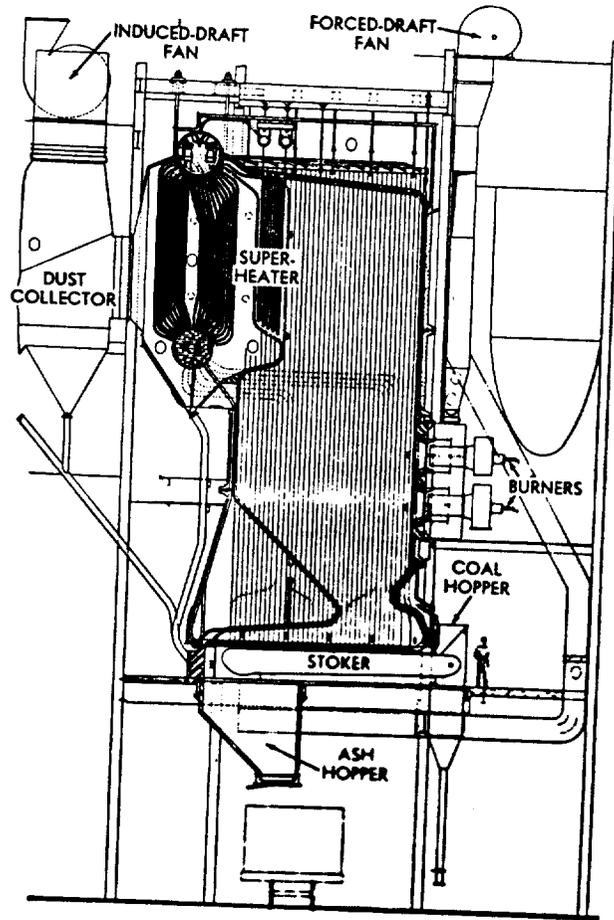


Figure 2-2. Typical stoker installation for anthracite coal.⁶

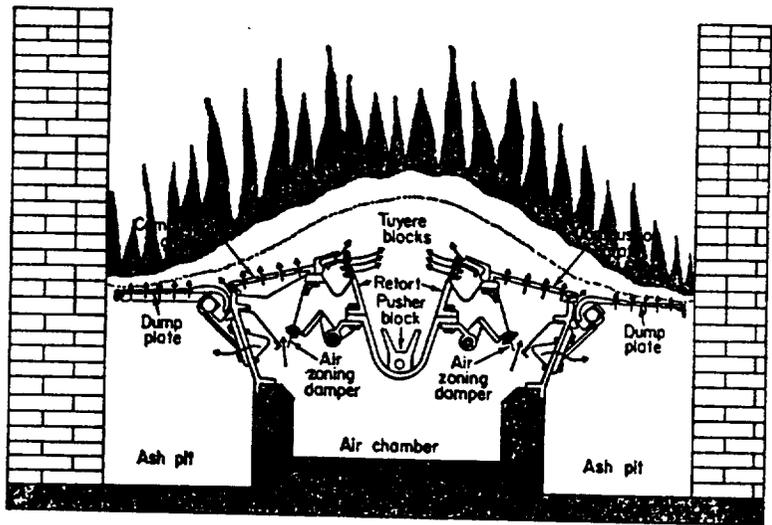
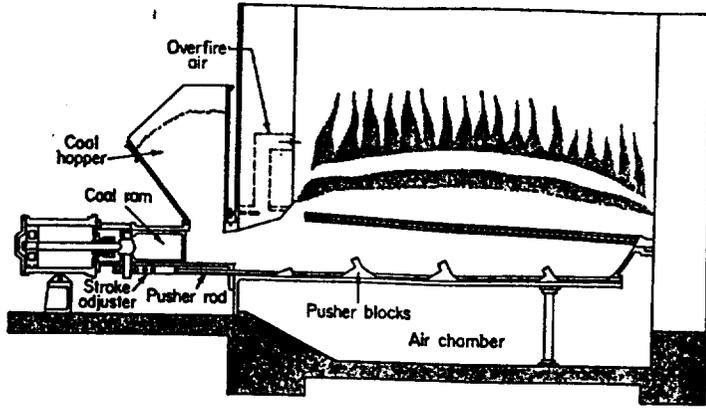


Figure 2-3. Cross-section of a single-retort side-dump stoker with stationary grates.³

TABLE 2-1. TYPICAL ANALYSES FOR ANTHRACITE COAL AND CULM^{3,4}

Parameter	As-fired weight percent	
	Anthracite coal ^a	Anthracite culm
<u>Proximate Analysis</u>		
Moisture	2.1-2.3	-
Volatile Matter	3.1-7.5	-
Fixed Carbon	80.3-87.7	-
Ash	6.9-10.1	67-74
<u>Ultimate Analysis</u>		
Carbon	80.9-86.7	24.2-26.6
Hydrogen	2.2-3.3	0.9-1.0
Oxygen	2.9-4.2	3.1-5.3
Sulfur	0.5	0.3-0.9
Nitrogen	0.8-1.0	0.5-0.6
Heating Value	7,500-7,600 kcal/kg (13,480-13,540 Btu/lb)	1,500-2,350 kcal/kg (2,700-4,160 Btu/lb)

^a From the Mammoth and Big Lykens seams in Pennsylvania.

REFERENCES FOR CHAPTER 2

1. Minerals Yearbook, 1978-1979, Bureau of Mines, U.S. Department of the Interior, Washington, DC, 1981.
2. Air Pollutant Emission Factors, APTD-0923, U. S. Environmental Protection Agency, Research Triangle Park, NC, April 1970.
3. Chemical Engineers' Handbook, Fourth Edition, J. Perry, Editor, McGraw-Hill Book Company, New York, NY, 1963.
4. "Operating Experience at the Shamokin Culm Burning Steam Generation Plant", P. Bender, D. Samela, W. Smith, G. Tsoumpas, Stone & Webster Engineering Group, New York, New York, J. Laukaitis, Shamokin Area Industrial Corporation, Shamokin, Pennsylvania, Presented at the 76th Annual Meeting of the Air Pollution Control Association, Atlanta, GA, June 1983.
5. Background Information Document For Industrial Boilers, EPA 450/3-82-006a, U. S. Environmental Protection Agency, Research Triangle Park, NC, March 1982.
6. Steam: Its Generation and Use, Thirty-Seventh Edition, The Babcock & Wilcox Company, New York, NY, 1963.
7. Compilation of Air Pollutant Emission Factors, Volume I, Fourth Edition, AP-42, U. S. Environmental Protection Agency, Research Triangle Park, NC, September 1985.

3. GENERAL DATA REVIEW AND ANALYSIS PROCEDURES

3.1 LITERATURE SEARCH AND SCREENING

The first step of this investigation involved a search of available literature relating to criteria and noncriteria pollutant emissions associated with bagasse combustion in sugar mills. This search included the following sources:

- AP-42 background files,
- Files and dockets maintained by the Emission Standards Division of OAQPS for relevant NSPSs and NESHAPs,
- "Locating and Estimating" reports available through EPA's Clearinghouse for Inventories and Emission Factors (CHIEF) bulletin board system,
- PM-10 "gap filling" documents in the OAQPS library,
- Publications available through EPA's Control Technology Center,
- Reports and project summaries from EPA's Office of Research and Development,
- Control Techniques Guideline documents generated by the Emission Standards Division of OAQPS,
- Information in the Air Facility System (AFS) of EPA's Aerometric Information Retrieval System (AIRS),
- Handbook of Emission Factors, Parts I and II, Ministry of Health and Environmental Protection, The Netherlands,
- EPA's CHIEF and National Air Toxics Information Clearinghouse (NATICH),
- EPA databases, including SPECIATE, XATEF, and TSAR,

- Various EPA contractor reports, and
- In-house files maintained the Contractor.

To reduce the large amount of literature collected to a final group of references pertinent to this report, the following general criteria were used:

1. Emissions data must be from a primary reference:
 - a. Source testing must be from a referenced study that does not reiterate information from previous studies.
 - b. The document must constitute the original source of test data. For example, a technical paper was not included if the original study was contained in the previous document. If the exact source of the data could not be determined, the document was eliminated.
2. The referenced study must contain test results based on more than one test run.
3. The report must contain sufficient data to evaluate the testing procedures and source operating conditions (e.g., one-page reports were generally rejected).

A final set of reference materials was compiled after a thorough review of the pertinent reports, documents, and information according to these criteria.

3.2 EMISSION DATA QUALITY RATING SYSTEM¹

As part of the Contractor's analysis of the emission data, the quantity and quality of the information contained in the final set of reference documents were evaluated. The following data were always excluded from consideration.

1. Test series averages reported in units that cannot be converted to the selected reporting units;
 2. Test series representing incompatible test methods (i.e., comparison of EPA method 5 front-half with EPA method 5 front- and back- half);
 3. Test series of controlled emissions for which the control device is not specified;
 4. Test series in which the source process is not clearly identified and described;
- and

5. Test series in which it is not clear whether the emissions were measured before or after the control device.

Data sets that were not excluded were assigned a quality rating. The rating system used was that specified by the OAQPS for the preparation of AP-42 sections. The data were rated as follows:

A--Multiple tests performed on the same source using sound methodology and reported in enough detail for adequate validation. These tests do not necessarily conform to the methodology specified in either the inhalable particulate (IP) protocol documents or the EPA reference test methods, although these documents and methods were certainly used as a guide for the methodology actually used.

B--Tests that were performed by a generally sound methodology but lack enough detail for adequate validation.

C--Tests that were based on an untested or new methodology or that lacked a significant amount of background data.

D--Tests that were based on a generally unacceptable method but may provide an order-of-magnitude value for the source.

The following criteria were used to evaluate source test reports for sound methodology and adequate detail:

1. Source operation. The manner in which the source was operated is well documented in the report. The source was operating within typical parameters during the test.

2. Sampling procedures. The sampling procedures conformed to a generally acceptable methodology. If actual procedures deviated from accepted methods, the deviations are well documented. When this occurred, an evaluation was made of the extent such alternative procedures could influence the test results.

3. Sampling and process data. Adequate sampling and process data are documented in this report. Many variations can occur unnoticed and without warning during testing. Such variations can include wide deviations in sampling results. If a large spread between test results cannot be explained by information contained in the test report, the data are suspect and are given a lower rating.

4. Analysis and calculations. The test reports contain original raw data sheets. The nomenclature and equations used were compared to those (if any) specified by EPA to establish equivalency. The depth of review of the calculations was dictated by the reviewer's confidence in the ability and conscientiousness of the tester, which in turn was based on factors such as consistency of results and completeness of other areas of the test report.

3.3 PARTICLE SIZE DETERMINATION

There is no one method which is universally accepted for the determination of particle size. A number of different techniques can be used which measure the size of particles according to their basic physical properties. Since there is no "standard" method for particle size analysis, a certain degree of subjective evaluation was used to determine if a test series was performed using a sound methodology for particle sizing.

For pollution studies, the most common types of particle sizing instruments are cyclones and cascade impactors. Traditionally, cyclones have been used as a preseparator ahead of a cascade impactor to remove the larger particles. These cyclones are of the standard reverse-flow design whereby the flue gas enters the cyclone through a tangential inlet and forms a vortex flow pattern. Particles move outward toward the cyclone wall with a velocity that is determined by the geometry and flow rate in the cyclone and by their size. Large particles reach the wall and are collected. A series of cyclones with progressively decreasing cut-points can be used to obtain particle size distributions.

Cascade impactors used for the determination of particle size in process streams consist of a series of plates or stages containing either small holes or slits with the size of the openings decreasing from one plate to the next. In each stage of an impactor, the gas stream passes through the orifice or slit to form a jet that is directed toward an impaction plate. For each stage, there is a characteristic particle diameter that has a 50 percent probability of impaction. This characteristic diameter is called the cut-point (D_{50}) of the stage. Typically, commercial instruments have six to eight impaction stages with a backup filter to collect those particles which are either

too small to be collected by the last stage or which are re-entrained off the various impaction surfaces by the moving gas stream.

3.4 EMISSION FACTOR QUALITY RATING SYSTEM

The quality of the emission factors developed from analysis of the test data was rated utilizing the following criteria:

A--Excellent: Developed only from A-rated test data taken from many randomly chosen facilities in the industry population. The source category is specific enough so that variability within the source category population may be minimized.

B--Above average: Developed only from A-rated test data from a reasonable number of facilities. Although no specific bias is evident, it is not clear if the facilities tested represent a random sample of the industries. As in the A-rating, the source category is specific enough so that variability within the source category population may be minimized.

C--Average: Developed only from A- and B-rated test data from a reasonable number of facilities. Although no specific bias is evident, it is not clear if the facilities tested represent a random sample of the industry. As in the A-rating, the source category is specific enough so that variability within the source category population may be minimized.

D--Below average: The emission factor was developed only from A- and B-rated test data from a small number of facilities, and there is reason to suspect that these facilities do not represent a random sample of the industry. There also may be evidence of variability within the source category population. Limitations on the use of the emission factor are noted in the emission factor table.

E--Poor: The emission factor was developed from C- and D-rated test data, and there is reason to suspect that the facilities tested do not represent a random sample of the industry. There also may be evidence of variability within the source category population. Limitations on the use of these factors are always noted.

The use of these criteria is somewhat subjective and depends to an extent on the individual reviewer. Details of the rating of each candidate emission factor are provided in Chapter 4 of this report.

REFERENCES FOR CHAPTER 3

1. Technical Procedures for Developing AP-42 Emission Factors and Preparing AP-42 Sections, Office of Air Quality Planning and Standards, U.S. Environmental Protection Agency, Research Triangle Park, NC, March 1992.

4. POLLUTANT EMISSION FACTOR DEVELOPMENT

This chapter describes the test data and methodology used to develop pollutant emission factors for external combustion processes using anthracite coal as a fuel.

4.1 REVIEW OF SPECIFIC DATA SETS

A total of 17 references reporting emissions data were documented and reviewed during the literature search. Useful data for emission factor development were found in 7 of the 17 references. For the 10 documents not used, the reasons for rejection were:

- Reference 8: Engineering estimates with rating of E;
- Reference 9: Higher quality data available;
- Reference 10: Insufficient data for fuel;
- Reference 11: Higher quality data available;
- Reference 12: Potential for air inleakage, also Reference 5 reports results of concurrent testing on the same sources;
- Reference 13: Better documentation of same test program in Reference 7;
- Reference 14: Better documentation of same test program in Reference 7;
- Reference 15: Engineering estimates with rating of E or sources inadequately described;
- Reference 16: Engineering estimates with rating of E or sources inadequately described;
- Reference 17: Inadequate documentation, not the primary reference.

The seven documents used to develop the revised emission factors included four documents (i.e., References 1 to 4) used for the previous AP-42 supplement (1988).¹⁸ In the subsections to follow, emission measurements qualifying for emission factor development are described for each reference.

4.1.1 Reference 1

Emission tests were conducted at three sites on small boilers described only as stoker fired. Emissions were not controlled.

A Source Assessment Sampling System (SASS) train was used for field sampling. Samples of the flue gas were also collected in gas sampling bags and analyzed onsite for low molecular weight hydrocarbons, using a gas chromatograph with a flame ionization detector.

Samples collected with the SASS train were analyzed for total organic carbon (TOC), metal species (filterable and condensible), and polycyclic organic matter (POM).

Given that the SASS train is designed for screening studies, the data resulting from this test program were of questionable quality. Also, documentation of the test data was sparse. Based on these data quality and documentation limitations, a rating of D was assigned to the data.

4.1.2 Reference 2

The test program described in this document measured total PM and NO_x in the uncontrolled flue gases from each of two small, steam generating boilers. Coal for the two boilers was fed by traveling grate stoker. Orsat analysis was used to determine emission factors for CO₂.

EPA Method 5 was used to determine PM concentrations. Since front-half and back-half catches were measured and reported separately, the determination of emission factors for both filterable and condensible PM was possible.

The manual version of EPA Method 7 was employed to determine NO_x concentrations.

The tests were performed by a sound methodology and their results were well documented. A rating of A was assigned to the data.

4.1.3 Reference 3

The concentrations of total PM and NO_x were measured in the emissions from two small, steam generating boilers. Emissions were not controlled.

Three sampling runs were conducted for each boiler, using EPA Method 5. The filterable and condensable catches from the Method 5 sampling train were reported separately.

Nitrogen oxides were determined, using the manual version of EPA Method 7.

Complete documentation of the test program was not included in the report. Therefore, a rating of B was assigned to the data.

4.1.4 Reference 4

The total PM concentration of the combined emission stream from two small, steam generating boilers was determined. The emissions were uncontrolled.

Traveling grate stokers were used in each of the two boilers.

Particulate matter concentrations were determined for both the front-half and back-half material collected with an EPA Method 5 sampling train. Therefore, both filterable and condensable PM emission factors could be developed.

Valid data were obtained from two of the three sampling runs. Data from the first sampling run were not used because the volume of sample collected did not meet Method 5 requirements. Because the test program was not completed as planned, the data were assigned a B rating.

4.1.5 Reference 5

Carbon dioxide emission factors were calculated from data obtained during a test to measure PM emissions. Three small, steam generating boilers were tested. Flue gas was sampled downstream of mechanical collectors. The PM emissions data from this test program were not used because of an inadequate number of points on the sampling traverse.

Two sampling runs were conducted on each boiler. During each run, a gas sample was collected from the exhaust duct of each boiler; CO₂ was determined by Orsat analysis.

The method for measuring coal consumption was not specified. The data for this source category were assigned a rating of B.

4.1.6 Reference 6

The emissions from residential space heaters were sampled and analyzed for methane and polynuclear aromatic hydrocarbons (PAH).

One of the space heaters was designed to burn either anthracite or bituminous coal. The grates were fed from a magazine which was not replenished during the test. The other space heater was designed to burn either coal or wood. The firebox could hold 7-9 kilograms (15-20 pounds) of coal before having to be replenished.

The space heaters were placed on weigh scales and coal consumption rates were determined by weight loss. A flexible connection was installed on the flue gas duct to isolate the weight of the space heater from the rest of the structure.

Particulate matter and PAH concentrations were determined using the modified EPA Method 5 sampling train. The Method 5 sampling train was modified by inserting a XAD-2 resin trap to collect organics. Analyses of combined extracts of filterable material and the resin trap were accomplished with gas chromatography/mass spectrometry (GC/MS).

The data and results were clearly presented but documentation was limited. Modifications of the space heaters to obtain a firing rate introduced some uncertainty about whether the sampling runs typified normal operation. For these reasons, a rating of C was assigned to the data.

4.1.7 Reference 7

Anthracite culm was burned in a FBC boiler. Culm is the breaker refuse discarded during the mining process; it is typically composed of 20 to 30 percent coal. The fluidized bed consisted of culm, inerts, coal ash, and limestone; the latter was used to absorb SO_2 .

As part of a series of parametric tests to demonstrate the turndown capability of the FBC unit, continuous sampling and instrumental analyses were employed to determine flue gas concentrations of SO_2 , NO_x , and CO. Gas analysis methods were as follows:

- SO_2 : pulsed fluorescence,
- NO_x : chemiluminescence, and

- CO: infra-red.

Flue gas samples were collected at the inlet to the air preheater. The air preheater was located downstream of primary and secondary cyclones but upstream of a fabric filter used for removal of PM. Ash from the primary cyclone was reinjected into the fluidized bed to improve carbon utilization. Thirty-six parametric tests, typically four hours in duration, were conducted. Gas analyses data were complete for 11 of these tests; emission factors were calculated for these 11 tests.

Because of the demonstration nature of the test program and of the process variations introduced by the parametric testing, the data quality rating was lowered. Additionally, better sampling protocols than those employed would have insured a more representative sample. Based on these potentials for sub-standard data quality, a rating of D was assigned to the data.

4.2 RESULTS OF DATA ANALYSIS

This section discusses the development of emission factors for tested pollutants based on the data contained in the reference documents described above. In all cases, emission factors were developed using manual and computer spreadsheet manipulation to convert emission data expressed in various units of concentrations or flow rates to mass of the pollutant per ton or kilogram of coal/culm feed.

Using the guidelines described in Chapter 2 for developing the data quality ratings, new test data were utilized if they improved the ratings of an existing factor. Existing criteria pollutant emission factors were dropped in favor of emission factors calculated with new data or with a combination of new data and existing data.

If emission factors from the previous (i.e., 1988) version of AP-42 Section 1.2 were not changed as a result of new data, the previous emission factors and associated factor ratings have been carried forward for the current update. It should be noted that the 1988 version of AP-42 Section 1.2 utilized emission factors from Section 1.1 - Bituminous and Subbituminous Coal Combustion for anthracite coal combusted in PC-fired boilers. Because no recent data were located for combustion of pulverized anthracite coal, the 1988 emission factors are used for this update.

A summary of developed emission factors for tested pollutants is presented in Tables 4-1 to 4-6.

4.2.1 Filterable Particulate Matter

Uncontrolled filterable PM emission factors were determined from the data contained in References 2, 3, and 4. The units tested were all stoker-fired traveling grate units. Data from a total of six boilers were used to calculate the new emission factors. The six boilers ranged in capacity from 11,250 to 11,700 kg steam/hour (25,000 to 26,000 lbs steam/hr).

Filterable PM emission factors from the 1988 version of AP-42 Section 1.2 were retained for hand fired units. A copy of the 1988 version of AP-42 Section 1.2 is contained in Appendix A.

4.2.2 Condensable Particulate Matter

Emission factors for condensable PM were developed from the same sampling run data taken from References 2, 3, and 4, discussed above for filterable PM.

4.2.3 Particulate Matter Less Than 10 Microns (PM-10)

No useful data for PM-10 were found that could provide an update of the previous emission factor. Therefore, 1988 PM-10 emission factors are retained for controlled and uncontrolled PC boilers and for traveling grate stoker-fired boilers. The data were obtained from Reference 19.

4.2.4 Lead

Lead emissions data were found in the Reference 1 document for three stoker-fired boilers using unspecified grate types. The three boilers ranged in design capacity from 2.6 to 3.2 MW (9 to 11 million Btu/hour).

4.2.5 Sulfur Oxides

Uncontrolled sulfur oxides emission factors were retained from the previous AP-42 supplement. Controlled emissions were reported as SO₂ in the Reference 7 document, from which an emission factor was determined. The source category - culm burning in an FBC boiler - is new to the anthracite coal section of AP-42. The tested boiler in this category was rated at 9.7 MW (33 million Btu/hour) heat input.

4.2.6 Nitrogen Oxides

Uncontrolled NO_x emission factors for boilers with traveling grate stokers were determined from data found in Reference 2 and 3. Data from a total of four boilers were used to calculate the new emission factors. All four boilers were rated at a steam capacity of 11,250 kg/hr (25,000 lbs/hr). A NO_x emission factor was determined for the culm-burning FBC boiler. The test data were taken from Reference 7. Nitrogen oxide emission factors from the 1988 AP-42 supplement were retained for PC-fired and hand fired units.

4.2.7 Carbon Monoxide

A CO emission factor was determined for the culm-burning fluidized bed boiler (see Section 4.2.5). The test data were taken from Reference 7. The uncontrolled emission factor from the last AP-42 supplement was retained for traveling grate stoker-fired units.

4.2.8 Total Organic Compounds

Data to determine TOCs were reported in the Reference 1 document. Three stoker fired boilers (types of grates unspecified) were tested for organics. The three boilers were rated at 2.6 to 3.2 MW (9 to 11 million Btu/hr) heat input.

4.2.9 Speciated Organic Compounds

Uncontrolled emission factors were determined for a number of organic species in the general classifications of POM and PAH. Useful data were found in Reference 1 and Reference 6 documents. For small stoker-fired boilers, emission data were available to determine emission factors for three speciated organic compounds. The three boilers tested were rated at 2.6 to 3.2 MW (9 to 11 million Btu/hr) heat input capacity. For the residential space heaters tested, useful data were available to determine emission factors for 18 speciated organic compounds.

4.2.10 Trace Elements

Emission factors for nine trace element species were developed from the data reported in Reference 1. The three boilers tested were rated at 2.6 to 3.2 MW (9 to 11 million Btu/hr) heat input capacity.

4.2.11 Carbon Dioxide

Uncontrolled emission factors for CO₂ were calculated using test data from References 2 and 5. The data reported in the Reference 2 document consisted of PM sampling data and Orsat analysis of gases from two boilers with traveling grate stokers, each with 11,250 kg/hr (25,000 lbs/hr) of steam generating capacity. The data reported in the Reference 5 document consisted of PM sampling data and Orsat analysis of gases obtained from two boilers ranging in steam capacity from 10,530 to 17,960 kg/hr (23,400 to 39,900 lbs/hr).

4.2.12 Methane

During the test program reported in Reference 6, residential space heaters were tested to determine emission concentrations of toxic metals and various organics. Actual firing rates varied from 1 to 2 kg/hr (2 to 4 lb/hr) of anthracite coal.

4.3 PROTOCOL FOR DATA BASE

4.3.1 Engineering Methodology

The seven references discussed in Section 4.1 were thoroughly reviewed to establish a data base for the pollutants discussed above. Data rating forms (see Appendix B) were created to facilitate the evaluation of exclusion criteria, methodology/detail criteria, and data rating criteria. These forms were completed for each reference in order to document the rationale for either excluding the reference from emission factor development consideration or for including the reference and assigning ratings to relevant source test data.

The emissions data from source test reports were averaged as the arithmetic mean of different sampling runs prior to inclusion in the data base. Where two or more combustion devices were reported in the same document, averages were compiled for each combustion device and these averages incorporated into the data base.

Generally, the analysis consisted of one of six methods:

1. Acceptance of reported emission factor.
2. Calculation, using reported time-based rates for pollutant and coal/culm.

3. Calculation, using reported concentrations of pollutant in flue gas as volume percent, ppmv, or weight per volume ratio, or using reported flow rates for flue gas and coal/culm.
4. Calculation, using reported concentrations of pollutant in volume or weight, based on thermal input to the combustion device.
5. Use of an F-factor and a representative heating value for coal to determine stoichiometric volume of flue gas per mass of coal burned. (An F-factor is a typical ratio of flue gas generated to heat input combusted for a given fuel type.) Converted stoichiometric volume to total volume by correcting for reported excess oxygen content of flue gas. Used reported concentrations of pollutants as in method 3.
6. Accept emission factors reported in previous AP-42 version.

One of the six methods described above was chosen (based on the information available in a particular reference) and an emission factor was calculated or chosen for a given sampling run. The procedure was repeated for each sampling run, or for averaged sets of replicate sampling runs, until a data base was assembled for each source category.

In addition to unit conversions, EPA Methods 3, 4 and 5 required some preprocessing to convert data expressed in terms of ppmv or lb pollutant/million Btu to lb pollutant/ton of coal. This was accomplished using the reported heating value of feed coal and an F-Factor of 10,100 dscf/million Btu at 0 percent oxygen (O₂).²⁰ This factor was adjusted to other O₂ flue gas concentrations using the equation:

$$F = 10,100 \text{ dscf}/10^6 \text{ Btu} [20.9/(20.9-\%O_{2d})]$$

where %O_{2d} was the actual flue gas O₂ content measured on a dry basis.

Determinations of emission factors were made only when coal or culm feed rates were documented or derivable from plant records.

Emission factors for PM and SO₂ were corrected to a feed pollutant concentration basis. The calculated emission factor was divided by the weight percent of pollutant precursor in the feed (such as weight percent ash in the coal for PM factors); the reported emission factor includes the pollutant precursor as a multiplier.

SITE 120: RESIDUAL OIL-FIRED SOURCE

ELEMENT	FILTER	XAD	COMPOSITE	TOTAL	EMISSION	FUEL	EMISSION	CALCULATED
U	< 0.0002	< 0.041	< 0.44	< 0.48	< 0.015	< 0.40	< 0.015	< 0.029
TH	< 0.0003	< 0.059	< 0.63	< 0.69	< 0.022	< 0.58	< 0.022	< 0.042
BI	< 0.0001	< 0.018	< 0.20	< 0.21	< 0.0068	< 0.18	< 0.0068	< 0.013
PB	0.028	< 0.075	< 0.41	0.028 TU	0.015	< 0.37	0.0009 TU	< 0.027
TL	< 0.0001	< 0.023	< 0.24	< 0.27	< 0.0085	< 0.23	< 0.0085	< 0.016
HG	< 0.0003	< 0.053	< 0.56	< 0.62	< 0.020	< 0.26	< 0.020	< 0.0001
AU	< 0.0002	< 0.030	< 0.33	< 0.36	< 0.011	< 0.30	< 0.011	< 0.022
PT	< 0.0005	< 0.089	< 1.0	< 1.0	< 0.033	< 0.44	< 0.033	< 0.0001
IR	< 0.0002	< 0.047	< 0.50	< 0.55	< 0.017	< 0.46	< 0.017	< 0.033
US	< 0.0003	< 0.051	< 0.60	< 0.60	< 0.019	< 0.50	< 0.019	< 0.036
RE	< 0.0002	< 0.032	< 0.35	< 0.38	< 0.012	< 0.32	< 0.012	< 0.023
M	< 0.0006	< 0.043	< 0.46	< 0.51	< 0.016	< 0.84	< 0.016	< 0.060
TA	< 0.0001	< 0.019	< 0.21	< 0.23	< 0.0072	< 0.095	< 0.0072	< 0.0001
HF	< 0.0003	< 0.054	< 0.63	< 0.63	< 0.020	< 0.53	< 0.020	< 0.038
LU	< 0.0001	< 0.013	< 0.14	< 0.15	< 0.0047	< 0.12	< 0.0047	< 0.0084
YB	< 0.0001	< 0.018	< 0.20	< 0.22	< 0.0068	< 0.18	< 0.0068	< 0.013
TM	< 0.0001	< 0.011	< 0.12	< 0.13	< 0.0042	< 0.11	< 0.0042	< 0.0079
ER	< 0.0002	< 0.033	< 0.35	< 0.39	< 0.012	< 0.33	< 0.012	< 0.023
HU	< 0.0001	< 0.011	< 0.12	< 0.13	< 0.0040	< 0.11	< 0.0040	< 0.0077
DY	< 0.0005	< 0.019	< 0.20	< 0.22	< 0.0070	< 0.19	< 0.0070	< 0.013
TB	< 0.0001	< 0.0051	< 0.055	< 0.060	< 0.0019	< 0.051	< 0.0019	< 0.0036
GO	< 0.0002	< 0.019	< 0.20	< 0.22	< 0.0070	< 0.19	< 0.0070	< 0.015
EU	< 0.0001	< 0.0085	< 0.091	< 0.100	< 0.0032	< 0.084	< 0.0032	< 0.0060
SM	< 0.0009	< 0.033	< 0.35	< 0.38	< 0.012	< 0.52	< 0.012	< 0.023
VD	< 0.0019	< 0.041	< 0.44	0.0019 TU	< 0.0001 TU	< 0.40	< 0.0001 TU	< 0.029
PR	0.0004	< 0.072	< 0.078	0.0004 TU	0.0001 TU	< 0.072	0.0001 TU	< 0.0051
CE	0.0012	< 0.0098	< 0.100	0.0012 TU	0.0001 TU	< 0.096	0.0001 TU	< 0.0069
LA	0.0018	< 0.011	< 0.11	0.0018 TU	0.0001 TU	< 0.100	0.0001 TU	< 0.0075
BA	0.074	< 0.020	< 0.16	0.094	0.0030	< 0.20	0.0030	< 0.014
CS	< 0.0001	< 0.0017	< 0.018	< 0.0001 TU	< 0.0001 TU	< 0.017	< 0.0001 TU	< 0.0012
I	< 0.0004	< 0.028	< 0.30	0.028 TU	0.0009 TU	< 0.28	0.0009 TU	< 0.020
TE	< 0.0001	< 0.024	< 0.25	< 0.28	< 0.0086	< 0.23	< 0.0086	< 0.017
SB	< 0.0002	< 0.016	< 0.18	0.0002 TU	0.0001 TU	< 0.16	0.0001 TU	< 0.012
SW	< 0.0019	< 0.023	< 0.25	< 0.27	< 0.0087	< 0.23	< 0.0087	< 0.016
CD	< 0.0004	< 0.029	< 0.31	0.0004 TU	0.0001 TU	< 0.29	0.0001 TU	< 0.021
AG	< 0.0001	< 0.0085	< 0.091	< 0.099	< 0.0032	< 0.042	< 0.0032	< 0.0001
PU	< 0.0001	< 0.024	< 0.25	< 0.28	< 0.0088	< 0.23	< 0.0088	< 0.017
HH	< 0.0001	< 0.0082	< 0.088	< 0.096	< 0.0031	< 0.081	< 0.0031	< 0.0058

TABLE 4-2. SUMMARY OF EMISSION FACTORS FOR TOTAL ORGANIC COMPOUNDS (TOC) AND METHANE (CH₄) FROM ANTHRACITE COMBUSTORS

Source category/ reference/rating	TOC		CH ₄	
	kg/Mg	lb/ton	kg/Mg	lb/ton
<u>Stoker fired boiler</u>				
1,d	1.7E-01	3.4E-01		
1,d	2.2E-01	4.3E-01		
1,d	7.0E-02	1.4E-01		
<u>Residential Space heaters</u>				
6,c			1	2
6,c			3	6
6,c			8	16

TABLE 4-3. SUMMARY OF EMISSION FACTORS FOR SPECIATED ORGANIC COMPOUNDS FROM UNCONTROLLED ANTHRACITE COMBUSTORS

Pollutant	Source category/reference/rating					
	Stoker fired boilers/1/d		Residential space heaters/6/b			
	kg/Mg	lb/ton	kg/Mg	lb/ton	kg/Mg	lb/ton
Biphenyl	1.3E-02	2.5E-02				
Phenanthrene	3.2E-03	6.8E-03	2.1E-01	4.2E-01	4.6E-02	9.1E-02
Naphthalene	6.5E-02	1.3E-01	1.0E-01	2.0E-01	4.5E-03	9.0E-03
Acenaphthene			1.8E-02	3.6E-02	7.0E-01	1.4E-02
Acenaphthylene			1.9E-02	3.8E-02	7.0E-01	1.4E-02
Fluorene			1.7E-02	3.4E-02	4.5E-03	9.0E-03
Anthracene			2.3E-02	4.5E-02	4.5E-03	9.0E-03
Fluoranthrene			1.7E-01	3.3E-01	4.8E-02	9.6E-02
Pyrene			1.2E-01	2.4E-01	2.7E-02	5.4E-02
Benzo(a)anthracene			1.0E-01	2.0E-01	7.0E-01	1.4E-02
Chrysene			1.1E-01	2.2E-01	1.2E-02	2.3E-02
Benzo(k)fluoranthrene			1.3E-02	2.6E-02	7.0E-01	1.4E-02
Benzo(e)pyrene			3.1E-03	6.1E-03	2.3E-03	4.5E-03
Benzo(a)pyrene			1.9E-03	3.8E-03	4.5E-03	9.0E-03
Perylene			3.8E-04	7.6E-04	1.2E-03	2.3E-03
Indeno(123-cd)perylene			7.0E-01	1.4E-02	2.3E-03	4.5E-03
Benzo(g,h,i)perylene			6.0E-01	1.2E-02	2.3E-03	4.5E-03
Anthanthrene			9.5E-03	1.9E-04	5.5E-04	1.1E-03
Coronene			4.0E-03	8.0E-03	5.5E-04	1.1E-03
					2.17E-01	4.34E-01
					3.38E-01	6.75E-01
					3.38E-01	6.75E-01
					1.98E-02	3.95E-02
					2.89E-02	5.78E-02
					2.17E-02	4.34E-02
					1.14E-01	2.27E-01
					8.90E-02	1.78E-01
					2.65E-02	5.30E-02
					3.62E-02	7.23E-02
					3.14E-02	6.27E-02
					7.25E-03	1.45E-02
					4.10E-03	8.19E-03
					9.65E-04	1.93E-03
					4.10E-03	8.19E-03
					2.17E-02	4.34E-03
					4.82E-04	9.64E-04
					3.14E-02	6.27E-03

TABLE 4-4. SUMMARY OF EMISSION FACTORS FOR PARTICULATE MATTER (PM), AND LEAD FROM ANTHRACITE COMBUSTORS

Source category/ reference/rating	Filterable PM		Condensable PM		Lead	
	kg/Mg	lb/ton	kg/Mg	lb/ton	kg/Mg	lb/ton
Stoker fired boilers						
2,a	0.4A ^a	0.8A ^a	0.1A	0.2A		
2,a	0.4A	0.8A	0.015A	0.03A		
3,b	0.6A	1.1A	0.5A	0.1A		
3,b	0.4A	0.8A	0.03A	0.06A		
4,b	0.2A	0.3A	0.005A	0.01A		
1,d					2.0E-03	4.0E-03
1,d					7.0E-03	1.4E-02
1,d					4.4E-03	8.7E-03

^aA=ash content of fuel, weight percent.

TABLE 4-5. SUMMARY OF EMISSION FACTORS FOR NITROGEN OXIDE COMPOUNDS (NO_x) AND SULFUR DIOXIDE (SO₂) FROM ANTHRACITE COMBUSTORS

Source category/reference/rating	NO _x		SO ₂	
	kg/Mg	lb/ton	kg/Mg	lb/ton
Stoker fired boilers				
2,a	7	14		
2,a	3	6		
3,b	4.5	9		
3,b	3.5	7		
Fluidized bed^a				
7,d	0.9 ^b	1.8 ^b	1.5 ^b	2.9 ^b

^aFluidized bed combustors used culm fuel only. All other sources used anthracite.

^bEmissions for fluidized bed combustors controlled with mechanical collector/fabric filter. All other emission sources were uncontrolled. Gaseous FBC emissions measured downstream of mechanical collector and upstream of fabric filter.

TABLE 4-6. SUMMARY OF EMISSION FACTORS FOR CARBON MONOXIDE (CO) AND CARBON DIOXIDE (CO₂) FROM ANTHRACITE COMBUSTORS

Source category/reference/rating	CO		CO ₂	
	kg/Mg	lb/ton	kg/Mg	lb/ton
<u>Stoker fired boilers</u>				
2,a			3200	6400
2,a			2000	4000
5,b			3200	6400
5,b			2450	4900
5,b			3350	6700
<u>Fluidized bed^a</u>				
7,d	1.5E-02 ^b	0.3b ^b		

^a Fluidized bed combustors used culm fuel only. All other sources used anthracite.

^b Emissions for fluidized bed combustors controlled with MC/fabric filter. All other emission sources were uncontrolled. Gaseous FBC emissions measured downstream of MC and upstream of fabric filter.

REFERENCES FOR CHAPTER 4

1. Emissions Assessment of Conventional Stationary Combustion Systems, EPA Contract No. 68-02-2197, GCA Corp., Bedford, MA, October 1980.
2. Source Sampling of Anthracite Coal Fired Boilers. RCA-Electronic Components, Lancaster, PA, Final Report, Scott Environmental Technology, Inc., Plumsteadville, PA, April 1975.
3. Source Sampling of Anthracite Coal Fired Boilers. Shippensburg State College, Shippensburg, PA, Final Report, Scott Environmental Technology, Inc, Plumsteadville, PA, May 1975.
4. Source Sampling of Anthracite Coal Fired Boilers. Pennhurst Center, Spring City, PA, Final Report, TRC Environmental Consultants, Inc., Wethersfield, CT, January 23, 1980.
5. Source Sampling of Anthracite Coal Fired Boilers. West Chester State College, West Chester, PA, Pennsylvania Dept. of Environmental Resources, Harrisburg, PA, 1980.
6. Characterization of Emissions of PAHs From Residential Coal Fired Space Heaters, Vermont Agency of Environmental Conservation, 1983.
7. Design, Construction, Operation, and Evaluation of a Prototype Culm Combustion Boiler/Heater Unit, Contract No. AC21-78ET12307, U. S. Dept. of Energy, Morgantown Energy Technology Center, Morgantown, WV, October 1983.
8. Air Pollutant Emission Factors, APTD-0923, U. S. Environmental Protection Agency, Research Triangle Park, NC, April 1970.
9. Source Sampling of Anthracite Coal Fired Boilers. Ashland State General Hospital, Ashland, PA, Final Report, Pennsylvania Dept. of Environmental Resources, Harrisburg, PA, March 16, 1977.
10. Source Sampling of Anthracite Coal Fired Boilers. Norristown State Hospital, Norristown, PA, Final Report, January 19, 1980.
11. Source Sampling of Anthracite Coal Fired Boilers. West Chester State, West Chester, PA, Final Report, Roy Weston, Inc., West Chester, PA, April 4, 1977.
12. Report on Particulate Emissions from Boilers 1, 3, & 4 at West Chester State College, West Chester, PA, TRC Environmental Consultants, Inc., Wethersfield, CT, May 1, 1980.

13. "Operating Experience at the Shamokin Culm Burning Steam Generation Plant", P. Bender, D. Samela, W. Smith, G. Tsoumpas, Stone & Webster Engineering Group, New York, New York, J. Laukaitis, Shamokin Area Industrial Corporation, Shamokin, Pennsylvania, Presented at the 76th Annual Meeting of the Air Pollution Control Association, Atlanta, GA, June 1983.
14. "Utilization of Solid Waste Fuels Through Fluidized Bed Combustion", H. Kwon, Dorr-Oliver, Inc., Stamford, Connecticut, J. Laukaitis, Keeler/Dorr-Oliver, Williamsport, Pennsylvania, and J. Leglise, OTV, Proceedings of the National Waste Processing Conference, Paris, France, Volume 11, 1984.
15. Locating and Estimating Air Emissions from Sources of Nickel, EPA-450/4-84-007f, U. S. Environmental Protection Agency, Research Triangle Park, NC, March 1984.
16. Locating and Estimating Air Emissions from Sources of Polycyclic Organic Matter (POM), EPA-450/4-84-007p, U.S. Environmental Protection Agency, Research Triangle Park, NC, September 1987.
17. Characterization and Fate of Vapor-Phase Organic Constituents from Atmospheric Pressure Fluidized Bed Combustors (AFBC) - East Stroudsburg University AFBC, Lovelace Biomedical and Environmental Research Institute, Albuquerque, NM, August 1987.
18. Section 1.2. Anthracite Coal Combustion. AP-42, U. S. Environmental Protection Agency, Research Triangle Park, NC, 1988.
19. Inhalable Particulate Source Category Report for External Combustion Sources, EPA Contract No. 68-02-3156, Acurex Corporation, Mountain View, CA, January 1985.
20. 40 Code of Federal Regulations, Chapter 1, July 1991 Edition, Part 60, Appendix A, Method 19.

5. AP-42 SECTION 1.2: ANTHRACITE COAL COMBUSTION

The revision to Section 1.2 of AP-42 is presented in the following pages as it would appear in the document. A marked-up copy of the 1988 version of this section is included in Appendix A.

1.2 ANTHRACITE COAL COMBUSTION

1.2.1 General¹⁻⁴

Anthracite coal is a high-rank coal with more fixed carbon and less volatile matter than either bituminous coal or lignite; anthracite also has higher ignition and ash fusion temperatures. In the United States, nearly all anthracite is mined in northeastern Pennsylvania and consumed in Pennsylvania and its surrounding states. The largest use of anthracite is for space heating. Lesser amounts are employed for steam/electric production; coke manufacturing, sintering and pelletizing; and other industrial uses. Anthracite currently is only a small fraction of the total quantity of coal combusted in the United States.

Another form of anthracite coal burned in boilers is anthracite refuse, commonly known as culm. Culm was produced as breaker reject material from the mining/sizing of anthracite coal and was typically dumped by miners on the ground near operating mines. It is estimated that there are over 15 million Mg (16 million tons) of culm scattered in piles throughout northeastern Pennsylvania. The heating value of culm is typically in the 1,400 to 2,800 kcal/kg (2,500 to 5,000 Btu/lb) range, compared to 6,700 to 7,800 kcal/kg (12,000 to 14,000 Btu/lb) for anthracite coal.

1.2.2 Firing Practices⁵⁻⁷

Due to its low volatile matter content, and non-clinkering characteristics, anthracite coal is largely used in medium-sized industrial and institutional stoker boilers equipped with stationary or traveling grates. Anthracite coal is not used in spreader stokers because of its low volatile matter content and relatively high ignition temperature. This fuel may also be burned in pulverized coal-fired (PC-fired) units, but due to ignition difficulties, this practice is limited to only a few plants in eastern Pennsylvania. Anthracite coal has also been widely used in hand-fired furnaces. Culm has been combusted primarily in fluidized bed combustion (FBC) boilers because of its high ash content and low heating value.

Combustion of anthracite coal on a traveling grate is characterized by a coal bed of 8 to 13 cm (3 to 5 inches) in depth and a high blast of underfire air at the rear or dumping end of the grate. This high blast of air lifts incandescent fuel particles and combustion gases from the grate and reflects the particles against a long rear arch over the grate towards the front of the fuel bed where fresh or "green" fuel enters. This special furnace arch design is required to assist in the ignition of the green fuel.

A second type of stoker boiler used to burn anthracite coal is the underfeed stoker. Various types of underfeed stokers are used in industrial boiler applications but the most common for anthracite coal firing is the single-retort side-dump stoker with stationary grates. In this unit, coal is fed intermittently to the fuel bed by a ram. In very small units the coal is fed continuously by a screw. Feed coal is pushed through the retort and upward towards the tuyere blocks. Air is supplied through the tuyere blocks on each side of the retort and through openings in the side grates. Overfire air is commonly used with underfeed stokers to provide combustion air and turbulence in the flame zone directly above the active fuel bed.

In PC-fired boilers, the fuel is pulverized to the consistency of powder and pneumatically injected through burners into the furnace. Injected coal particles burn in suspension within the furnace region of the boiler. Hot flue gases rise from the furnace and provide heat exchange with boiler tubes in the walls and upper regions of the boiler. In general, PC-fired boilers operate either in a wet-bottom or dry bottom mode; because of its high ash fusion temperature, anthracite coal is burned in dry-bottom furnaces.

For anthracite culm, combustion in conventional boiler systems is difficult due to the fuel's high ash content, high moisture content, and low heating value. However, the burning of culm in a fluidized bed system was demonstrated at a steam generation plant in Pennsylvania. A fluidized bed consists of inert particles (e.g., rock and ash) through which air is blown so that the bed behaves as a fluid. Anthracite coal enters in the space above the bed and burns in the bed. Fluidized beds can handle fuels with moisture contents up to near 70 percent (total basis) because of the large thermal mass represented by the hot inert bed particles. Fluidized beds can also handle fuels with ash contents as high as 75 percent. Heat released by combustion is transferred to in-bed steam-generating tubes. Limestone may be added to the bed to capture sulfur dioxide formed by combustion of fuel sulfur.

1.2.3 Emissions And Controls⁴⁻⁶

Particulate matter (PM) emissions from anthracite coal combustion are a function of furnace firing configuration, firing practices (boiler load, quantity and location of underfire air, soot blowing, flyash reinjection, etc.), and the ash content of the coal. Pulverized coal-fired boilers emit the highest quantity of PM per unit of fuel because they fire the anthracite in suspension, which results in a high percentage of ash carryover into exhaust gases. Traveling grate stokers and hand fired units produce less PM per unit of fuel fired, and coarser particulates, because combustion takes place in a quiescent fuel bed without significant ash carryover into the exhaust gases. In general, PM emissions from traveling grate stokers will increase during soot blowing and flyash reinjection and with higher fuel bed underfeed air flowrates. Smoke production during combustion is rarely a problem, because of anthracite's low volatile matter content.

Limited data are available on the emission of gaseous pollutants from anthracite combustion. It is assumed, based on bituminous coal combustion data, that a large fraction of the fuel sulfur is emitted as sulfur oxides. Also, because combustion equipment, excess air rates, combustion temperatures, etc., are similar between anthracite and bituminous coal combustion, nitrogen oxide emissions are also assumed to be similar. Nitrogen oxide emissions from FBC units burning culm are typically lower than from other anthracite coal-burning boilers due to the lower operating temperatures which characterize FBC beds.

Carbon monoxide and total organic compound emissions are dependent on combustion efficiency. Generally their emission rates, defined as mass of emissions per unit of heat input, decrease with increasing boiler size. Organic compound emissions are expected to be lower for pulverized coal units and higher for underfeed and overfeed stokers due to relative combustion efficiency levels.

Controls on anthracite emissions mainly have been applied to PM. The most efficient particulate controls, fabric filters, scrubbers, and electrostatic precipitators, have been installed on large pulverized anthracite-fired boilers. Fabric filters can achieve collection efficiencies exceeding 99 percent. Electrostatic precipitators typically are only 90 to 97 percent efficient, because of the

characteristic high resistivity of low sulfur anthracite fly ash. It is reported that higher efficiencies can be achieved using larger precipitators and flue gas conditioning. Mechanical collectors are frequently employed upstream from these devices for large particle removal.

Older traveling grate stokers are often uncontrolled. Indeed, particulate control has often been considered unnecessary, because of anthracite's low smoking tendencies and the fact that a significant fraction of large size flyash from stokers is readily collected in flyash hoppers as well as in the breeching and base of the stack. Cyclone collectors have been employed on traveling grate stokers, and limited information suggests these devices may be up to 75 percent efficient on particulate. Flyash reinjection, frequently used in traveling grate stokers to enhance fuel use efficiency, tends to increase PM emissions per unit of fuel combusted. High-energy venturi scrubbers can generally achieve PM collection efficiencies of 90 percent or greater.

Emission factors and ratings for pollutants from anthracite coal combustion and anthracite culm combustion are given in Tables 1.2-1 through 1.2-7. Cumulative size distribution data and size specific emission factors and ratings for particulate emissions are summarized in Table 1.2-8. Uncontrolled and controlled size specific emission factors are presented in Figure 1.2-1. Particle size distribution data for bituminous coal combustion may be used for uncontrolled emissions from pulverized anthracite-fired furnaces, and data for anthracite-fired traveling grate stokers may be used for hand fired units.

Table 1.2-1. EMISSION FACTORS FOR SPECIATED METALS FROM ANTHRACITE COAL COMBUSTION IN STOKER FIRED BOILERS^a

EMISSION FACTOR RATING: E

Pollutant	Emission Factor Range		Average Emission Factor	
	kg/Mg	lb/ton	kg/Mg	lb/ton
Mercury	4.4E-05 - 6.5E-05	8.7E-05 - 1.3E-04	6.5E-05	1.3E-04
Arsenic	BDL ^b - 1.2E-04	BDL - 2.4E-04	9.3E-05	1.9E-04
Antimony	BDL	BDL	BDL	BDL
Beryllium	1.5E-05 - 2.7E-04	3.0E-05 - 5.4E-04	1.5E-04	3.1E-04
Cadmium	2.3E-05 - 5.5E-03	4.5E-05 - 1.1E-04	3.6E-05	7.1E-05
Chromium	3.0E-03 - 2.5E-02	5.9E-03 - 4.9E-02	1.4E-02	2.8E-02
Manganese	4.9E-04 - 2.7E-03	9.8E-04 - 5.3E-03	1.8E-03	3.6E-03
Nickel	3.9E-03 - 1.8E-02	7.8E-03 - 3.5E-02	1.3E-02	2.6E-02
Selenium	2.4E-04 - 1.1E-03	4.7E-04 - 2.1E-03	6.3E-04	1.3E-03

^aReference 9. Units are kg of pollutant/Mg of coal burned and lbs. of pollutant/ton of coal burned. Source Classification Codes are 10100102, 10200104, and 10300102.

^bBDL = Below detection limit.

Table 1.2-2. EMISSION FACTORS FOR TOTAL ORGANIC COMPOUNDS (TOC) AND METHANE (CH₄) FROM ANTHRACITE COAL COMBUSTORS^a

Source Category (SCC) ^b	TOC Emission Factor			CH ₄ Emission Factor		
	kg/Mg	lb/ton	Rating	kg/Mg	lb/ton	Rating
Stoker fired boilers ^c (SCC 10100102, 10200104, 10300102)	0.10	0.20	E	ND	ND	-
Residential space ^d heaters (no SCC)	ND ^e	ND	-	4	8	E

^aUnits are kg of pollutant/Mg of coal burned and lbs. of pollutant/ton of coal burned.

^bSCC = Source Classification Code.

^cReference 9.

^dReference 14.

^eND = No data.

Table 1.2-3 (Metric Units). EMISSION FACTORS FOR SPECIATED ORGANIC COMPOUNDS FROM ANTHRACITE COAL COMBUSTORS^a

EMISSION FACTOR RATING: E

Pollutant	Stoker Fired Boilers ^b (SCC 10100102, 10200104, 10300102)	Residential Space Heaters ^c (No SCC)	
	Emission Factor	Emission Factor Range	Emission Factor
Biphenyl	1.25E-02	ND	ND
Phenanthrene	3.4E-03	4.6E-02 - 2.1E-02	1.6E-01
Naphthalene	0.65E-01	4.5E-03 - 2.4E-02	1.5E-01
Acenaphthene	ND ^d	7.0E-03 - 3.4E-01	3.5E-01
Acenaphthalene	ND	7.0E-03 - 2.0E-02	2.5E-01
Fluorene	ND	4.5E-03 - 2.9E-02	1.7E-02
Anthracene	ND	4.5E-03 - 2.3E-02	1.6E-02
Fluoranthrene	ND	4.8E-02 - 1.7E-01	1.1E-01
Pyrene	ND	2.7E-02 - 1.2E-01	7.9E-02
Benzo(a)anthracene	ND	7.0E-03 - 1.0E-01	2.8E-01
Chrysene	ND	1.2E-02 - 1.1E-01	5.3E-02
Benzo(k)fluoranthrene	ND	7.0E-03 - 3.1E-02	2.5E-01
Benzo(e)pyrene	ND	2.3E-03 - 7.3E-03	4.2E-03
Benzo(a)pyrene	ND	1.9E-03 - 4.5E-03	3.5E-03
Perylene	ND	3.8E-04 - 1.2E-03	8.5E-04
Indeno(123-cd) perylene	ND	2.3E-03 - 7.0E-03	2.4E-01
Benzo(g,h,i) perylene	ND	2.2E-03 - 6.0E-03	2.1E-01
Anthanthrene	ND	9.5E-05 - 5.5E-04	3.5E-03
Coronene	ND	5.5E-04 - 4.0E-03	1.2E-02

^aUnits are kg of pollutant/Mg of anthracite coal burned. SCC = Source Classification Code.

^bReference 9.

^cReference 14.

^dND = No data.

Table 1.2-4 (English Units). EMISSION FACTORS FOR SPECIATED ORGANIC COMPOUNDS FROM ANTHRACITE COAL COMBUSTORS^a

EMISSION FACTOR RATING: E

Pollutant	Stoker Fired Boilers ^b (SCC 10100102, 10200104, 10300102)	Residential Space Heaters ^c (No SCC)	
	Emission Factor	Emission Factor Range	Emission Factor
Biphenyl	2.5E-02	ND	ND
Phenanthrene	6.8E-03	9.1E-02 - 4.3E-02	3.2E-01
Naphthalene	1.3E-01	9.0E-03 - 4.8E-02	3.0E-01
Acenaphthene	ND ^d	1.4E-02 - 6.7E-01	7.0E-01
Acenaphthalene	ND	1.4E-02 - 3.0E-01	4.9E-01
Fluorene	ND	9.0E-03 - 5.8E-02	3.4E-02
Anthracene	ND	9.0E-03 - 4.5E-02	3.3E-02
Fluoranthrene	ND	9.6E-02 - 3.3E-01	2.2E-01
Pyrene	ND	5.4E-02 - 2.4E-01	1.6E-01
Benzo(a)anthracene	ND	1.4E-02 - 2.0E-01	5.5E-01
Chrysene	ND	2.3E-02 - 2.2E-01	1.1E-01
Benzo(k)fluoranthrene	ND	1.4E-02 - 6.3E-02	5.0E-01
Benzo(e)pyrene	ND	4.5E-03 - 1.5E-02	8.4E-03
Benzo(a)pyrene	ND	3.8E-03 - 9.0E-03	7.0E-03
Perylene	ND	7.6E-04 - 2.3E-03	1.7E-03
Indeno(123-cd) perylene	ND	4.5E-03 - 1.4E-02	4.7E-01
Benzo(g,h,i,) perylene	ND	4.3E-03 - 1.2E-02	4.2E-01
Anthanthrene	ND	1.9E-04 - 1.1E-03	7.0E-03
Coronene	ND	1.1E-03 - 8.0E-03	2.4E-02

^aUnits are lbs. of pollutant/ton of anthracite coal burned. SCC = Source Classification Code.

^bReference 9.

^cReference 14.

^dND = No data.

Table 1.2-5. EMISSION FACTORS FOR PARTICULATE MATTER (PM), AND LEAD (Pb)
FROM ANTHRACITE COAL COMBUSTORS^a

Source Category (SCC) ^b	Filterable PM Emission Factor			Condensable PM Emission Factor			Pb Emission Factor		
	kg/Mg	lb/ton	Rating	kg/Mg	lb/ton	Rating	kg/Mg	lb/ton	Rating
Stoker fired boilers ^c (SCC 10100102, 10200104, 10300102)	0.4A ^d	0.8A	C	0.04A	0.08A	C	4.5E-03	8.9E-03	E
Hand fired units ^e (SCC 10200207, 10300103)	5	10	B	ND ^f	ND	ND	ND	ND	ND

^aUnits are kg of pollutant/Mg of coal burned and lbs. of pollutant/ton of coal burned.

^bSCC = Source Classification Code.

^cReferences 9-12.

^dA = ash content of fuel, weight percent.

^eReference 16.

^fND = No data.

Table 1.2-6. EMISSION FACTORS FOR NITROGEN OXIDE COMPOUNDS (NO_x) AND SULFUR DIOXIDE (SO₂) FROM ANTHRACITE COAL COMBUSTORS^a

Source Category (SCC) ^b	NO _x Emission Factor ^c			SO ₂ Emission Factor ^d		
	kg/Mg	lb/ton	Rating	kg/Mg	lb/ton	Rating
Stoker fired boilers ^e (SCC 10100102, 10200104, 10300102)	4.6	9.0	C	19.5S ^f	39S	B
FBC boilers ^g (no SCC)	0.9	1.8	E	1.5	2.9	E
Pulverized coal boilers (SCC 10100101, 10200101, 10300101)	9	18	B	19.5S	39S	B
Residential space heaters (no SCC)	1.5	3	B	19.5S	39S	B

^aUnits are kg of pollutant/Mg of coal burned and lbs. of pollutant/ton of coal burned.

^bSCC = Source Classification Code.

^cReferences 17-18.

^dReference 19.

^eReferences 10-11.

^fS = weight percent sulfur.

^gReference 15. FBC = Fluidized bed combustion; FBC boilers burning culm fuel; all other sources burning anthracite coal.

Table 1.2-7. EMISSION FACTORS FOR CARBON MONOXIDE (CO) AND CARBON DIOXIDE (CO₂) FROM ANTHRACITE COAL COMBUSTORS^a

Source Category (SCC) ^b	CO Emission Factor			CO ₂ Emission Factor		
	kg/Mg	lb/ton	Rating	kg/Mg	lb/ton	Rating
Stoker fired boilers ^c (SCC 10100102, 10200104, 10300102)	0.3	0.6	B	2840	5680	C
FBC boilers ^d (no SCC)	0.15	0.3	E	ND ^e	ND	

^aUnits are kg of pollutant/Mg of coal burned and lbs. of pollutant/ton of coal burned.

^bSCC = Source Classification Code.

^cReferences 10, 13.

^dReference 15. FBC = Fluidized bed combustion; FBC boilers burning culm fuel; all other sources burning anthracite coal.

^eND = No data.

Table 1.2-8. CUMULATIVE PARTICLE SIZE DISTRIBUTION AND SIZE SPECIFIC EMISSION FACTORS FOR DRY BOTTOM BOILERS BURNING PULVERIZED ANTHRACITE COAL^a

EMISSION FACTOR RATING: D

Particle Size ^b (µm)	Cumulative Mass % ≤ stated size			Cumulative Emission Factor ^d kg/Mg (lb/ton) coal, as fired		
	Uncontrolled	Controlled ^c		Uncontrolled	Controlled ^c	
		Multiple Cyclone	Baghouse		Multiple Cyclone	Baghouse
15	32	63	79	1.6A (3.2A) ^e	0.63A (1.26A)	0.0079A (0.016A)
10	23	55	67	1.2A (2.3A)	0.55A (1.10A)	0.0067A (0.013A)
6	17	46	51	0.9A (1.7A)	0.46A (0.92A)	0.0051A (0.010A)
2.5	6	24	32	0.3A (0.6A)	0.24A (0.48A)	0.0032A (0.006A)
1.25	2	13	21	0.1A (0.2A)	0.13A (0.26A)	0.0021A (0.004A)
1.00	2	10	18	0.1A (0.2A)	0.10A (0.20A)	0.0018A (0.004A)
0.625	1	7		0.05A (0.1A)	0.07A (0.14A)	f
TOTAL	100	100	100	5A (10A)	1A (2A)	0.01A (0.02A)

^aReference 8. Source Classification Codes are 10100101, 10200101, and 10300101.

^bExpressed as aerodynamic equivalent diameter.

^cEstimated control efficiency for multiple cyclone is 80%; for baghouse, 99.8%.

^dUnits are kg of pollutant/Mg of coal burned and lbs. of pollutant/ton of coal burned.

^eA = coal ash weight %, as fired.

^fInsufficient data.

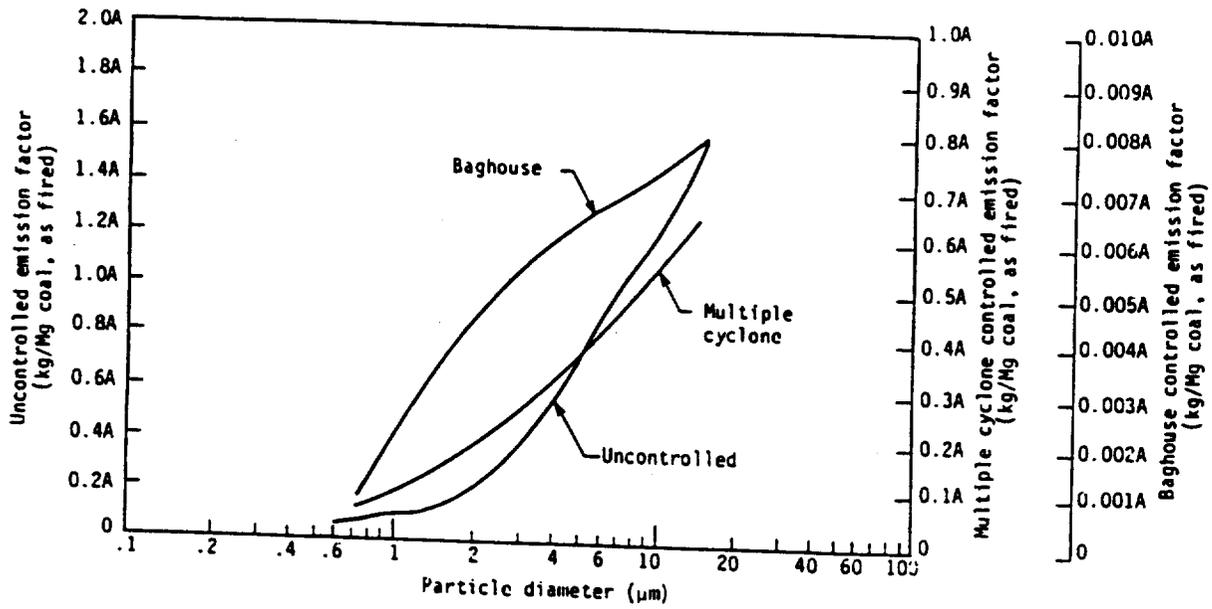


Figure 1.2-1. Cumulative size specific emission factors for dry bottom boilers burning pulverized anthracite coal.

References For Section 1.2

1. *Minerals Yearbook, 1978-79*, Bureau of Mines, U. S. Department of the Interior, Washington, DC, 1981.
2. *Air Pollutant Emission Factors*, APTD-0923, U. S. Environmental Protection Agency, Research Triangle Park, NC, April 1970.
3. P. Bender, D. Samela, W. Smith, G. Tsoumpas, and J. Laukaitis, "Operating Experience at the Shamokin Culm Burning Steam Generation Plant", Presented at the 76th Annual Meeting of the Air Pollution Control Association, Atlanta, GA, June 1983.
4. *Chemical Engineers' Handbook, Fourth Edition*, J. Perry, Editor, McGraw-Hill Book Company, New York, NY, 1963.
5. *Background Information Document For Industrial Boilers*, EPA 450/3-82-006a, U. S. Environmental Protection Agency, Research Triangle Park, NC, March 1982.
6. *Steam: Its Generation and Use, Thirty-Seventh Edition*, The Babcock & Wilcox Company, New York, NY, 1963.
7. *Emission Factor Documentation for AP-42 Section 1.2 - Anthracite Coal Combustion (Draft)*, Technical Support Division, Office of Air Quality Planning and Standards, U. S. Environmental Protection Agency, Research Triangle Park, NC, April 1993.
8. *Inhalable Particulate Source Category Report for External Combustion Sources*, EPA Contract No. 68-02-3156, Acurex Corporation, Mountain View, CA, January 1985.
9. *Emissions Assessment of Conventional Stationary Combustion Systems*, EPA Contract No. 68-02-2197, GCA Corp., Bedford, MA, October 1980.
10. *Source Sampling of Anthracite Coal Fired Boilers, RCA-Electronic Components, Lancaster, PA, Final Report*, Scott Environmental Technology, Inc., Plumsteadville, PA, April 1975.
11. *Source Sampling of Anthracite Coal Fired Boilers, Shippensburg State College, Shippensburg, PA, Final Report*, Scott Environmental Technology, Inc., Plumsteadville, PA, May 1975.
12. *Source Sampling of Anthracite Coal Fired Boilers, Pennhurst Center, Spring City, PA, Final Report*, TRC Environmental Consultants, Inc., Wethersfield, CT, January 23, 1980.
13. *Source Sampling of Anthracite Coal Fired Boilers, West Chester State College, West Chester, PA*, Pennsylvania Department of Environmental Resources, Harrisburg, PA 1980.
14. *Characterization of Emissions of PAHs From Residential Coal Fired Space Heaters*, Vermont Agency of Environmental Conservation, 1983.

References For Section 1.2 (Continued)

15. *Design, Construction, Operation, and Evaluation of a Prototype Culm Combustion Boiler/Heater Unit*, Contract No. AC21-78ET12307, U. S. Dept. of Energy, Morgantown Energy Technology Center, Morgantown, WV, October 1983.
16. *Air Pollutant Emission Factors*, APTD-0923, U. S. Environmental Protection Agency, Research Triangle Park, NC, April 1970.
17. *Source Test Data on Anthracite Fired Traveling Grate Stokers*, Office of Air Quality Planning and Standards, U. S. Environmental Protection Agency, Research Triangle Park, NC, 1975.
18. N. F. Suprenant, *et al.*, *Emissions Assessment of Conventional Stationary Combustion Systems, Volume IV: Commercial/Institutional Combustion Sources*, EPA Contract No. 68-02-2197, GCA Corporation, Bedford, MA, October 1980.
19. R. W. Cass and R. W. Bradway, *Fractional Efficiency of a Utility Boiler Baghouse: Sunbury Steam Electric Station*, EPA-600/2-76-077a, U. S. Environmental Protection Agency, Washington, DC, March 1976.

APPENDIX A
MARKED-UP 1988 AP-42 SECTION 1.2

1.2 ANTHRACITE COAL COMBUSTION

1.2.1 General ~~1-2~~ 1-4

anthracite also

Anthracite coal is a high-rank coal with more fixed carbon and less volatile matter than either bituminous coal or lignite; ~~and it~~ has higher ignition and ash fusion temperatures. ~~Because of its low volatile matter content and slight clinkering, anthracite is most commonly fired in medium sized traveling grate stokers and small hand fired units. Some anthracite (occasionally with petroleum coke) is used in pulverized coal fired boilers. It is also blended with bituminous coal. None is fired in spreader stokers. For its low sulfur content (typically less than 0.8 weight percent) and minimal smoking tendencies, anthracite is considered a desirable fuel where readily available.~~

In the United States, ^{nearly} all anthracite is mined ⁱⁿ its northeastern Pennsylvania and is consumed mostly in Pennsylvania and several surrounding states. The largest use of anthracite is for space heating. Lesser amounts are employed for steam/electric production; coke manufacturing, sintering and pelletizing; and other industrial uses. Anthracite currently is only a small fraction of the total quantity of coal combusted in the United States.

1.2.2 Emissions And Controls ~~2-14~~ 5-7

~~Insert~~
A

Particulate emissions from anthracite combustion are a function of furnace firing configuration, firing practices (boiler load, quantity and location of underfire air, sootblowing, flyash reinjection, etc.), and the ash content of the coal. Pulverized coal fired boilers emit the highest quantity of particulate per unit of fuel because they fire the anthracite in suspension, which results in a high percentage of ash carryover into exhaust gases. ~~Pulverized anthracite fired boilers operate in the dry tap or dry bottom mode, because of anthracite's characteristically high ash fusion temperature.~~ Traveling grate stokers and hand fired units produce much less particulate per unit of fuel fired, because combustion takes place in a quiescent fuel bed without significant ash carryover into the exhaust gases. In general, particulate emissions from traveling grate stokers will increase during sootblowing and flyash reinjection and with higher fuel bed underfeed air from forced draft fans. Smoking is rarely a problem, because of anthracite's low volatile matter content.

Limited data are available on the emission of gaseous pollutants from anthracite combustion. It is assumed from bituminous coal combustion data that a large fraction of the fuel sulfur is emitted as sulfur oxides. Also, because combustion equipment, excess air rates, combustion temperatures, etc., are similar between anthracite and bituminous coal combustion, nitrogen oxide and carbon monoxide emissions are assumed to be similar, too. ~~volatile organic compound (VOC) emissions, however, are expected to be considerably lower. Since the volatile matter content of anthracite is significantly less than that of bituminous coal.~~

~~Insert~~ B

~~Total organic compound (TOC)~~
of HCx External Combustion Sources

9/88
Emissions from FBC units by ~~unit~~ are expected to be lower than other anthracite coal-firing boilers due to the lower operating temperatures which characterize FBC beds.

High-energy venturi scrubbers can generally achieve PM collection efficiencies of 90 percent or greater.

Controls on anthracite emissions mainly have been applied to particulate matter. The most efficient particulate controls, fabric filters, scrubbers and electrostatic precipitators, have been installed on large pulverized anthracite fired boilers. Fabric filters and venturi scrubbers can effect collection efficiencies exceeding 99 percent. Electrostatic precipitators typically are only 90 to 97 percent efficient, because of the characteristic high resistivity of low sulfur anthracite fly ash. It is reported that higher efficiencies can be achieved using larger precipitators and flue gas conditioning. Mechanical collectors are frequently employed upstream from these devices for large particle removal.

Traveling grate stokers are often uncontrolled. Indeed, particulate control has often been considered unnecessary, because of anthracite's low smoking tendencies and of the fact that a significant fraction of large size flyash from stokers is readily collected in flyash hoppers as well as in the breaching and base of the stack. Cyclone collectors have been employed on traveling grate stokers, and limited information suggests these devices may be up to 75 percent efficient on particulate. Flyash reinjection, frequently used in traveling grate stokers to enhance fuel use efficiency, tends to increase particulate emissions per unit of fuel combusted.

Emission factors for pollutants and factor ratings from anthracite coal combustion are given in Table 1.2-1, and factor ratings in Table 1.2-2. Cumulative size distribution data and size specific emission factors and ratings for particulate emissions are in Tables 1.2-3 and 1.2-4. Uncontrolled and controlled size specific emission factors are presented in Figures 1.2-1 and 1.2-2. Size distribution data for bituminous coal combustion may be used for uncontrolled emissions from pulverized anthracite fired furnaces, and data for anthracite fired traveling grate stokers may be used for hand fired units.

See new emission factor tables

TABLE 1.2-2. ANTHRACITE COAL EMISSION FACTOR RATINGS

Furnace type	Particulate	Sulfur oxides	Nitrogen oxides	Carbon monoxide	Volatile organics	
					Nonmethane	Methane
Pulverized coal	B	B	B	B	C	C
Traveling grate stoker	B	B	B	B	C	C
Hand fired units	B	B	B	B	D	D

TABLE 1.2-1. UNCONTROLLED EMISSION FACTORS FOR ANTHRACITE COMBUSTION^a

Boiler type	Particulate ^b		Sulfur oxides ^c		Nitrogen oxides ^d		Carbon monoxide ^e		Volatile organics	
	kg/Mg	lb/ton	kg/Mg	lb/ton	kg/Mg	lb/ton	kg/Mg	lb/ton	Nonmethane	Methane
									f	f
Pulverized coal fired	f	f	19.5S	39S	9	18	f	f	f	f
Traveling grate stoker	4.68	9.18	19.5S	39S	5	10	0.3	0.6	f	f
Hand fed units	5h	10h	19.5S	39S	1.5	3	f	f	f	f

^aFactors are for uncontrolled emissions and should be applied to coal consumption as fired.

^bBased on EPA Method 5 (front half catch).

^cAssumes, as with bituminous coal combustion, most fuel sulfur is emitted as SO_x. Limited data in Reference 5 verify this for pulverized anthracite fired boilers. Emissions are mostly SO₂, with 1 - 3% SO₃. S indicates that weight % sulfur should be multiplied by the value given.

^dFor pulverized anthracite fired boilers and hand fed units, assumed to be similar to bituminous coal combustion. For traveling grate stokers, see References 8, 11.

^eMay increase by several orders of magnitude with boilers not properly operated or maintained. For traveling grate stokers, based on limited information in Reference 8. For pulverized coal fired boilers, substantiated by additional data in Reference 14.

^fFactors in Table 1.1-1 may be used, based on similarity of anthracite and bituminous coal.

^gReferences 12-13, 15-18. Accounts for limited fallout that may occur in fallout chambers and stack breeching. Factors for individual boilers may be 2.5 - 25 kg/Mg (5 - 50 lb/ton), highest during soot blowing.

^hReference 2.

TABLE 1.2-3. CUMULATIVE PARTICLE SIZE DISTRIBUTION AND SIZE SPECIFIC EMISSION FACTORS FOR DRY BOTTOM BOILERS BURNING PULVERIZED ANTHRACITE COAL^a

EMISSION FACTOR RATING: D

Particle size ^b (μ m)	Cumulative mass % \leq stated size			Cumulative emission factor ^c [kg/Mg (lb/ton) bark, as fired]		
	Uncontrolled	Controlled		Uncontrolled	Controlled ^d	
		Multiple cyclone	Baghouse		Multiple cyclone	Baghouse
15	32	63	79	1.6A (3.2A)	0.63A (1.26A)	0.0079A (0.016A)
10	23	55	67	1.2A (2.3A)	0.55A (1.10A)	0.0067A (0.013A)
6	17	46	51	0.9A (1.7A)	0.46A (0.92A)	0.0051A (0.010A)
2.5	6	24	32	0.3A (0.6A)	0.24A (0.48A)	0.0032A (0.006A)
1.25	2	13	21	0.1A (0.2A)	0.13A (0.26A)	0.0021A (0.004A)
1.00	2	10	18	0.1A (0.2A)	0.10A (0.20A)	0.0018A (0.004A)
0.625	1	7		0.05A (0.1A)	0.07A (0.14A)	e
TOTAL	100	100	100	5A (10A)	1A (2A)	0.01A (0.02A)

^aReference 19.

^bExpressed as aerodynamic equivalent diameter.

CA = coal ash weight, as fired.

^dEstimated control efficiency for multiple cyclone, 80%; baghouse, 99.8%.

^eInsufficient data.

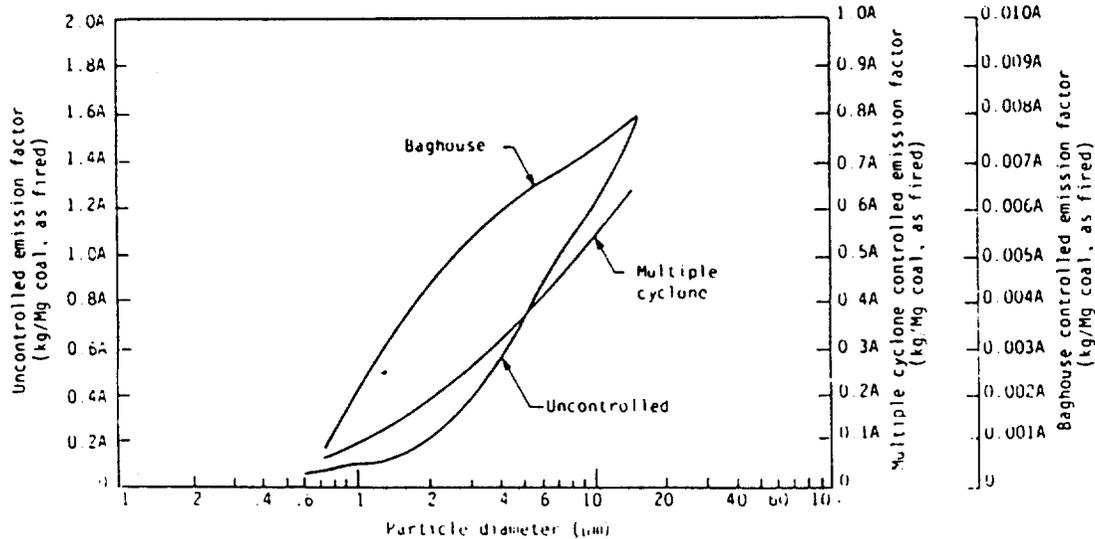


Figure 1.2-1. Cumulative size specific emission factors for dry bottom boilers burning pulverized anthracite coal.

see new references

References for Section 1.2

1. Minerals Yearbook, 1978-79, Bureau of Mines, U.S. Department of the Interior, Washington, DC, 1981.
2. Air Pollutant Emission Factors, APTD-0923, U.S. Environmental Protection Agency, Research Triangle Park, NC, April 1970.
3. Steam, 38th Edition, Babcock and Wilcox, New York, NY, 1975.
4. Fossil Fuel Fired Industrial Boilers - Background Information for Proposed Standards, Draft, Office Of Air Quality Planning And Standards, U.S. Environmental Protection Agency, Research Triangle Park, NC, June 1980.
5. R. W. Cass and R. W. Bradway, Fractional Efficiency of a Utility Boiler Baghouse: Sunbury Steam Electric Station, EPA-600/2-76-077a, U.S. Environmental Protection Agency, Washington, DC, March 1976.
6. R. P. Janaso, "Baghouse Dust Collectors on a Low Sulfur Coal Fired Utility Boiler", Presented at the 67th Annual Meeting of the Air Pollution Control Association, Denver, CO, June 1974.
7. J. H. Phelan, et al., Design and Operation Experience with Baghouse Dust Collectors for Pulverized Coal Fired Utility Boilers - Sunbury Station, Holtwood Station, Proceedings of the American Power Conference, Denver, CO, 1976.
8. Source Test Data on Anthracite Fired Traveling Grate Stokers, Office Of Air Quality Planning And Standards, U.S. Environmental Protection Agency, Research Triangle Park, NC, 1975.
9. Source and Emissions Information on Anthracite Fired Traveling Grate Stokers, Office Of Air Quality Planning And Standards, U.S. Environmental Protection Agency, Research Triangle Park, NC, 1975.
10. R. J. Milligan, et al., Review of NOx Emission Factors for Stationary Fossil Fuel Combustion Sources, EPA-450/4-79-021, U.S. Environmental Protection Agency, Research Triangle Park, NC, September 1979.
11. N. F. Suprenant, et al., Emissions Assessment of Conventional Stationary Combustion Systems, Volume IV: Commercial/institutional Combustion Sources, EPA Contract No. 68-02-2197, GCA Corporation, Bedford, MA, October 1980.
12. Source Sampling of Anthracite Coal Fired Boilers, RCA-Electronic Components, Lancaster, Pennsylvania, Final Report, Scott Environmental Technology, Inc., Plumsteadville, PA, April 1975.
13. Source Sampling of Anthracite Coal Fired Boilers, Shippensburg State College, Shippensburg, Pennsylvania, Final Report, Scott Environmental Technology, Inc., Plumsteadville, PA, May 1975.
14. W. Bartok, et al., Systematic Field Study of NOx Emission Control Methods for Utility Boilers, APTD-1163, U.S. Environmental Protection Agency, Research Triangle Park, NC, December 1971.
15. Source Sampling of Anthracite Coal Fired Boilers, Ashland State General Hospital, Ashland, Pennsylvania, Final Report, Pennsylvania Department of Environmental Resources, Harrisburg, PA, March 16, 1977.
16. Source Sampling of Anthracite Coal Fired Boilers, Norristown State Hospital, Norristown, Pennsylvania, Final Report, Pennsylvania Department of Environmental Resources, Harrisburg, PA, January 19, 1980.

17. Source Sampling of Anthracite Coal Fired Boilers, Pennhurst Center, Spring City, Pennsylvania, Final Report, TRC Environmental Consultants, Inc., Wethersfield, CT, January 23, 1980.
18. Source Sampling of Anthracite Coal Fired Boilers, West Chester State, West Chester, Pennsylvania, Final Report, Roy Weston, Inc., West Chester, PA, April 4, 1977.
19. Inhalable Particulate Source Category Report for External Combustion Sources, EPA Contract No. 68-02-3156, Acurex Corporation, Mountain View, CA, January 1985.

APPENDIX B
EMISSION SOURCE DATA RATING FORMS

SOURCE CATEGORY: _____
EXCLUSION CRITERIA CHECKLIST

REFERENCE _____

CRITERIA	YES	NO
1. Test series averages are reported in units that can be converted to the selected reporting units?		
2. Test series represent compatible test methods?		
3. In tests in which emission control devices were used, the control devices are fully specified?		
4. Is it clear whether or not the emissions were controlled (or not controlled)?		

Form filled out by _____

Date _____

INDICATE WHETHER ANSWER IS YES OR NO WITH AN "X" IN APPROPRIATE BOX.

IF ALL ANSWERS ARE "YES" PROCEED TO METHODOLOGY/DETAIL CRITERIA CHECKLIST.

SOURCE CATEGORY _____
 METHODOLOGY/DETAIL CRITERIA CHECKLIST

REFERENCE _____

CRITERIA	YES	NO	COMMENTS
1. Is the manner in which the source was operated well documented in the report?			
Was the source operating within typical parameters during the test?			
2. Did sampling procedures deviate from standard methods?			
If so, were the deviations well documented?			
Were the deviations appropriate?			
Comment on how any alterations in sampling procedure may have influenced the results.			
3. Were there wide variations in the results?			
If yes, can the variations be adequately explained by information in the report?			
If the variations are not well explained, should the data be considered of poor quality?			
4. Do the test reports contain the raw data sheets?			
Are the nomenclature and equations used equivalent to those specified by the EPA?			
Comment on the consistency and completeness of the results.			

Form filled out by _____

Date _____

INDICATE YES OR NO WITH AN "X" IN THE APPROPRIATE BOX. FILL IN COMMENTS.

IF, BASED ON ABOVE ANSWERS, THE SOURCE REPORT PROVIDES ADEQUATE DETAIL AND DEMONSTRATES SOUND METHODOLOGY, PROCEED TO RATING THE DATA IN THE RATING CRITERIA CHECKLIST.

SOURCE CATEGORY _____
RATING CRITERIA CHECKLIST

Reference _____

RATING CRITERIA	YES	NO
A Tests performed by a sound methodology and reported in enough detail for adequate validation?		
B Tests were performed by a generally sound methodology, but not enough detail for adequate validation?		
C Were tests based on untested or new methodology that lacks significant amount of background data?		
D Were tests based on generally unacceptable methods, but may provide order-of-magnitude values for the source?		

COMMENTS

Form filled out by _____
Date _____

BASED ON ANSWERS AND COMMENTS ABOVE, ASSIGN A RANK TO THIS LITERATURE SOURCE:

--

RANK ASSIGNED TO EMISSION SOURCE DATA